

# 19 | Alarms

This chapter explains how to display and manage "Alarms" in GP-Pro EX, and discusses useful Alarm features.

Please start by reading "19.1 Settings Menu" (page 19-2) and then go to the corresponding page.

19.1	Settings Menu .....	19-2
19.2	Scrolling Alarm Messages.....	19-8
19.3	Viewing Active Alarms in a List .....	19-15
19.4	Acknowledging the Alarm History .....	19-21
19.5	Working with Alarm History .....	19-31
19.6	Displaying Help (Sub Display).....	19-35
19.7	Viewing Alarms by Line .....	19-48
19.8	Storing Alarm Messages in the CF Card or USB Storage Device.....	19-54
19.9	Read Data When Alarms Occur.....	19-62
19.10	Settings Guide.....	19-69
19.11	Restrictions .....	19-157
19.12	Alarm Feature List.....	19-163

## 19.1 Settings Menu

### Scrolling Alarm Messages

Monitoring Bit Address turns ON and...

Alarm Message

Normal Pressure Abnormal

Alarm Message's scroll direction

Scroll the currently triggered Alarms on all screens.

The alarm recovers and...

Done! Erased! History does not remain.

- Setup Procedure (page 19-12)
- Introduction (page 19-8)

### Viewing Active Alarms in a List

Monitoring Bit Address turns ON and...

Display alarms

Abnormal Pressure  
Abnormal Temp.

Display the currently triggered alarms.


The alarm recovers and...

Abnormal Temp.

Done! Erased! History does not remain.

- Setup Procedure (page 19-16)
- Introduction (page 19-15)

**Acknowledging the Alarm History**

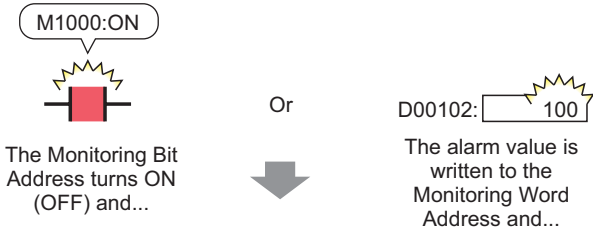

Displays the currently active alarms in the order of their trigger date/time, and the Alarm History of past alarms.

All active Alarms can be viewed in a list.

[Active]

Trigger date	Time	Alarm
08/17	10:09	Abnormal Pressure
08/17	10:10	Abnormal Temp.
08/17	10:21	Low Materials
:	:	:

The recovered alarm is cleared and no history remains.

Display Alarms separately by Trigger, Acknowledged, and Recovery.

[Log]

08/17	10:09	Abnormal Pressure		
08/17	10:10	Abnormal Pressure	10:10	
08/17	10:10	Abnormal Temp.		
08/17	10:11	Abnormal Pressure	10:11	
:	:	:	:	:

Even when the alarm recovers, the history remains.

Display the Trigger time Acknowledged time, and Recovery time for all alarms on the same row.


[History]

Triggered!	Acknowledged!	Recovered!
08/17 10:09	Abnormal Pressure	10:10 10:11
08/17 10:10	Abnormal Temp.	
08/17 10:11	Low Materials	10:11
:	:	:
:	:	:

Even when the alarm recovers, the history remains.

- ☞ Setup Procedure (page 19-22)
- ☞ Introduction (page 19-21)


### Working with Alarm History

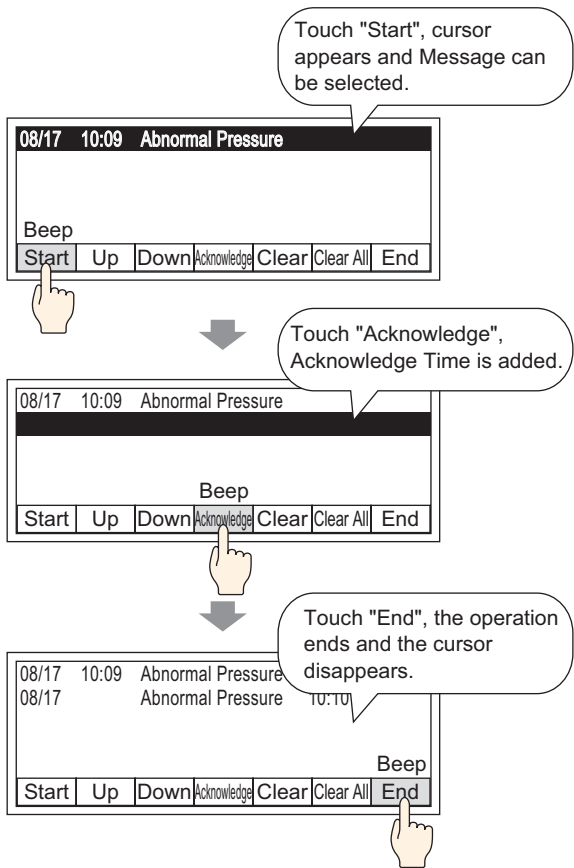

- ☞ Setup Procedure (page 19-32)
- ☞ Introduction (page 19-31)


**Displaying Help (Sub Display)**

Display a Base Screen (Change Base Screen)

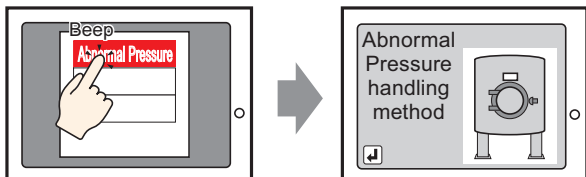

Touch the alarm, and the screen changes to another screen.

Display a window (Show Text Window)

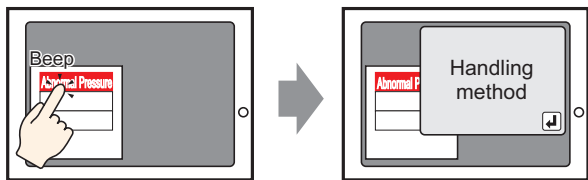


Touch the alarm and the related window is displayed.

- ☞ Setup Procedure (page 19-36)
- ☞ Introduction (page 19-35)


**Viewing Alarms by Line**

Alarm blocks displayed on each screen can be changed.

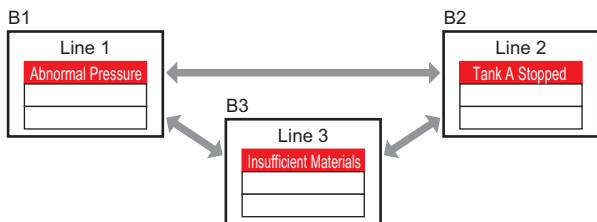

- ☞ Setup Procedure (page 19-49)
- ☞ Introduction (page 19-48)


**Storing Alarm Messages in the CF Card or USB Storage Device**

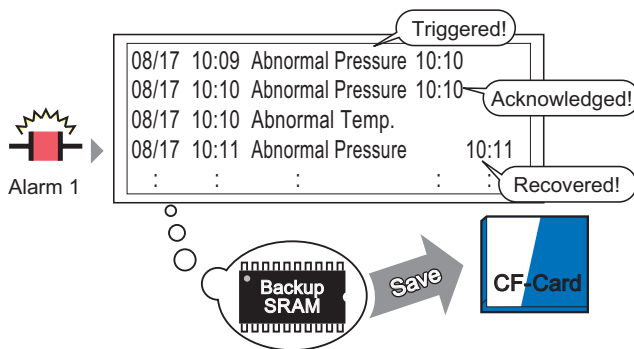

The Alarm History data stored in the backup SRAM is saved to the CF-card.

- ☞ Setup Procedure (page 19-55)
- ☞ Introduction (page 19-54)

**Read Data When Alarms Occur**

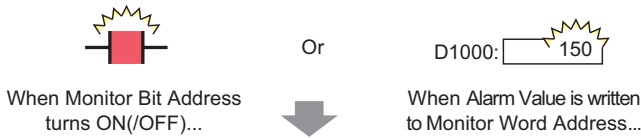

Value is displayed according to the triggered, acknowledged and recovered date and time of the current alarm.

Lists all active Alarms.

**[Active]**

Triggered	Time	Alarm	Data Value when triggered
08/17	10:09	Abnormal Pressure	50
08/17	10:10	Abnormal Temp	100
08/17	10:21	Lack of material	OFF
:	:	:	:

\*Recovered Alarms will be cleared and Alarm history will not be stored.

Display Alarms by status: Trigger, Acknowledged, or Recovery.

**[Log]**

08/17	10:09	Abnormal Pressure	50
08/17		Abnormal Pressure	50
08/17	10:10	Abnormal Temp	100
08/17		Abnormal Pressure	100
:	:	:	:

\*Alarm history will remain after recovery.

Display Alarms by Trigger, Acknowledged, or Recovery status, on the same row.

**[History]**

Triggered	Acknowledged	Recovered	Data Value when triggered
08/17 10:09	Abnormal Pressure	10:10 10:11	50
08/17 10:10	Abnormal Temp		100
08/17 10:11	Lack of Material	10:11	OFF
:	:	:	:
:	:	:	:


\*Alarm history will remain after recovery.

- ☞ Setup Procedure (page 19-63)
- ☞ Introduction (page 19-62)

## 19.2 Scrolling Alarm Messages

### 19.2.1 Introduction


When the Monitoring Bit Address turns ON, the Alarm scrolls across the screen.

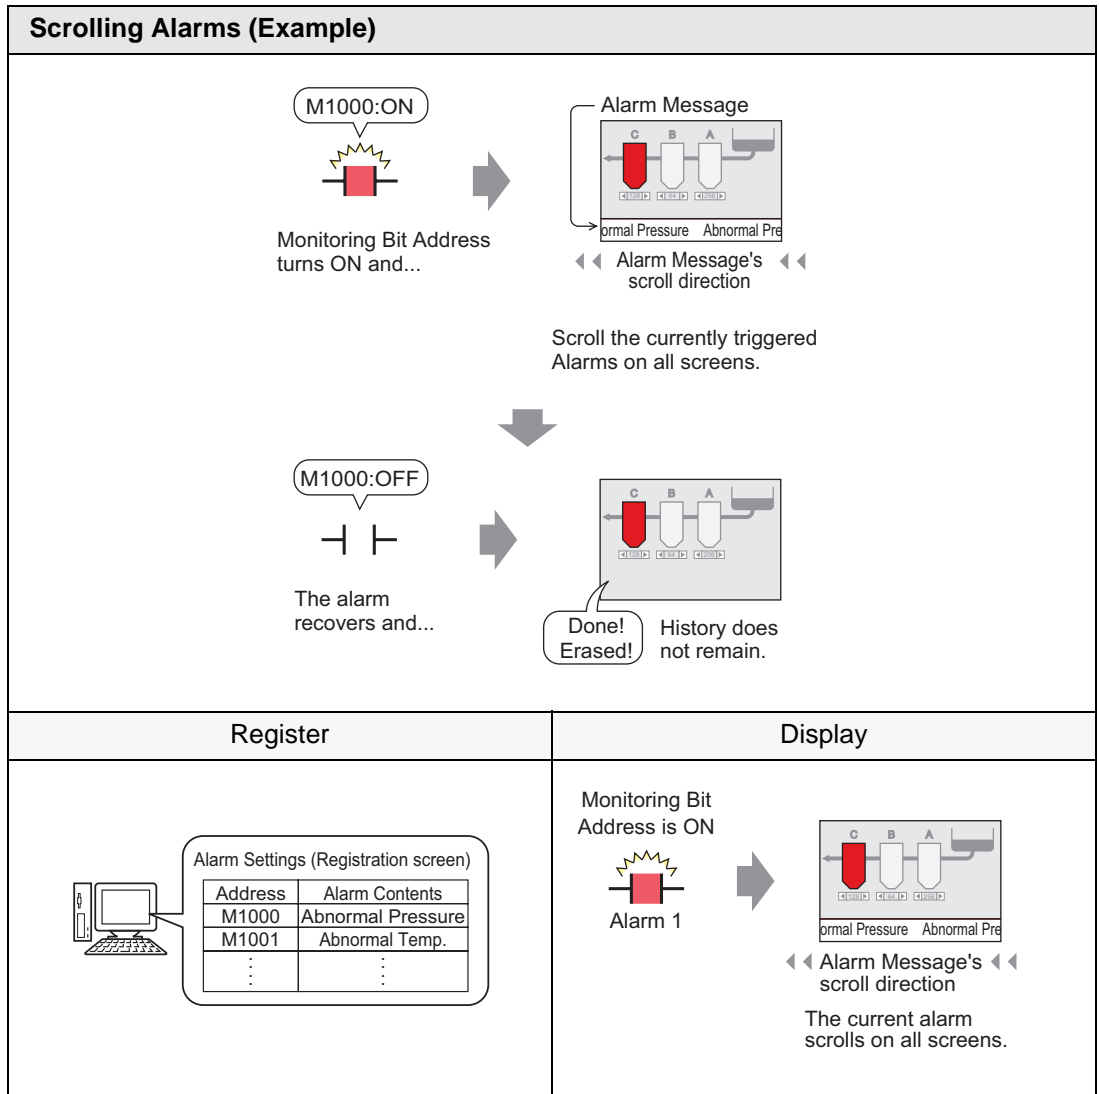




■ Display Example

◆ When a single alarm is triggered

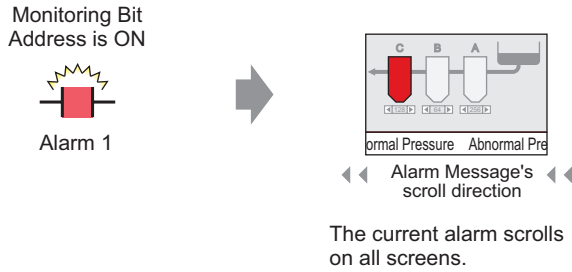


◆ When multiple alarms are triggered

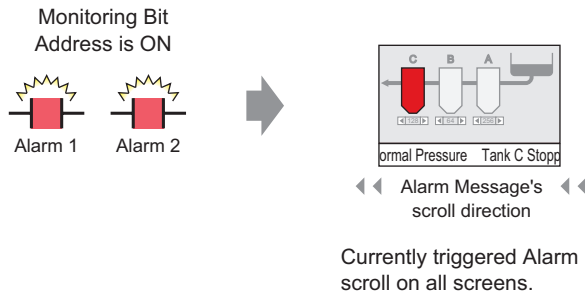

■ Display When Alarm Ends


◆ When a single alarm is triggered

While the alarm is active, a repeating Alarm Message scrolls on the screen. When the Alarm recovers, the final instance of the message scrolls until it is finished.

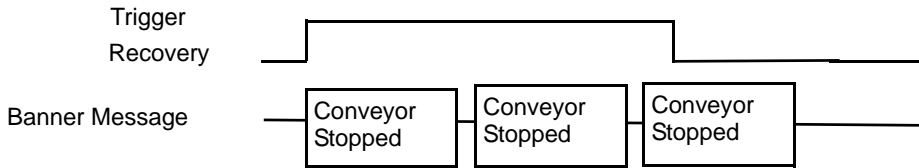

◆ **When multiple alarms are triggered**


All active Alarm messages repeatedly scroll on the screen. When the [Conveyor Stopped] alarm recovers halfway through a message, the final [Conveyor Stopped] message scrolls until it is finished. After that the [Abnormal Voltage] message displays repeatedly. When the [Abnormal Voltage] alarm recovers, the final instance of the message scrolls until it is finished.

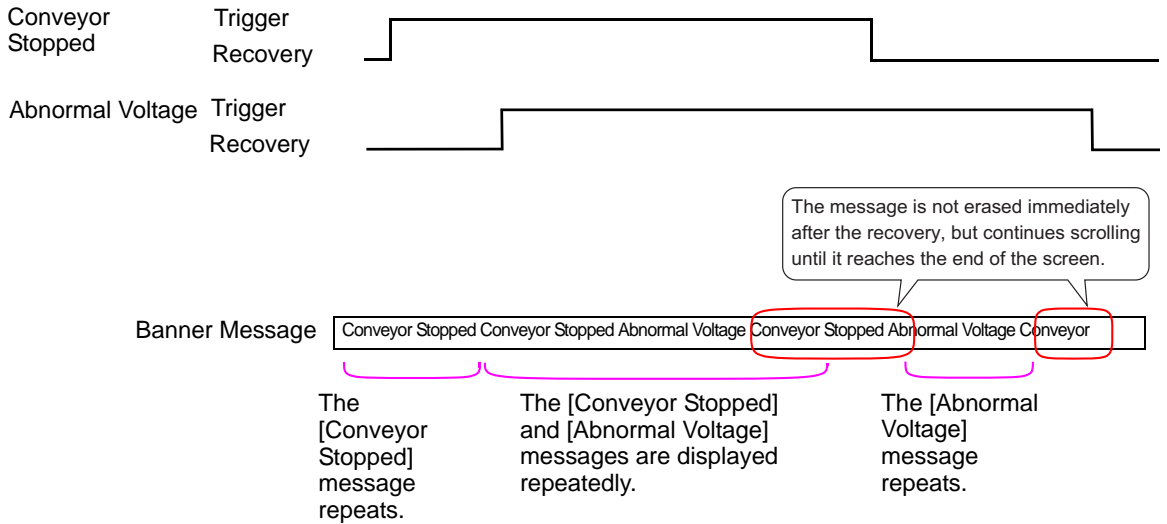




■ **Display Alarm Message (Banner) Position**

Alarm Messages (Banner) are displayed on the lower part of the GP screen but can also be displayed on the upper part, depending on the System Menu Window display setting.

◆ **Normal Display**

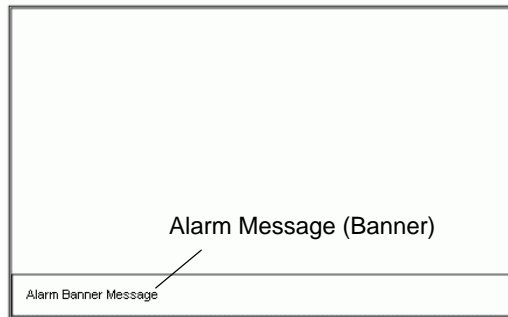

◆ Display layouts when the System Menu is combined with an Alarm Message

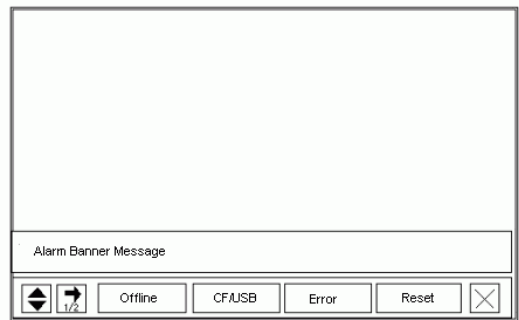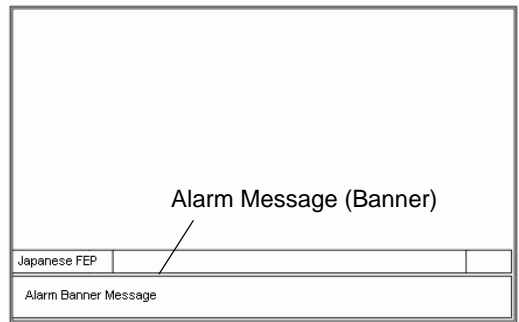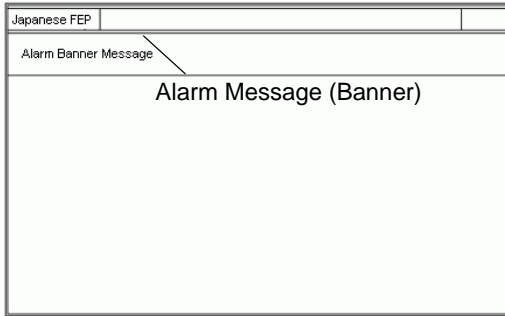



The Alarm Message banner can be displayed on the upper or lower part of the screen. If the Japanese FEP or the System menu is displayed, the Alarm Message banner will always appear below the Japanese FEP and above the System Menu.


## 19.2.2 Setup Procedure

**NOTE**


- Please refer to the Settings Guide for details.  
 "19.10.1 Common (Alarm) Settings Guide ■ Alarm (Banner) Settings Guide" (page 19-97)

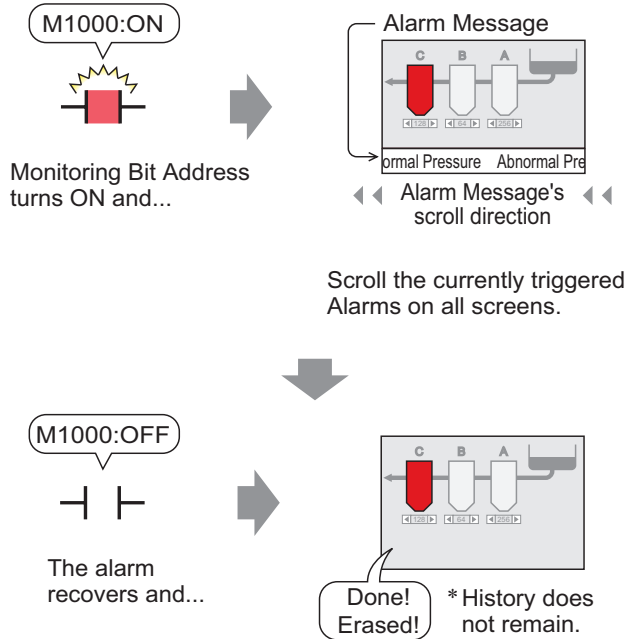



1 From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

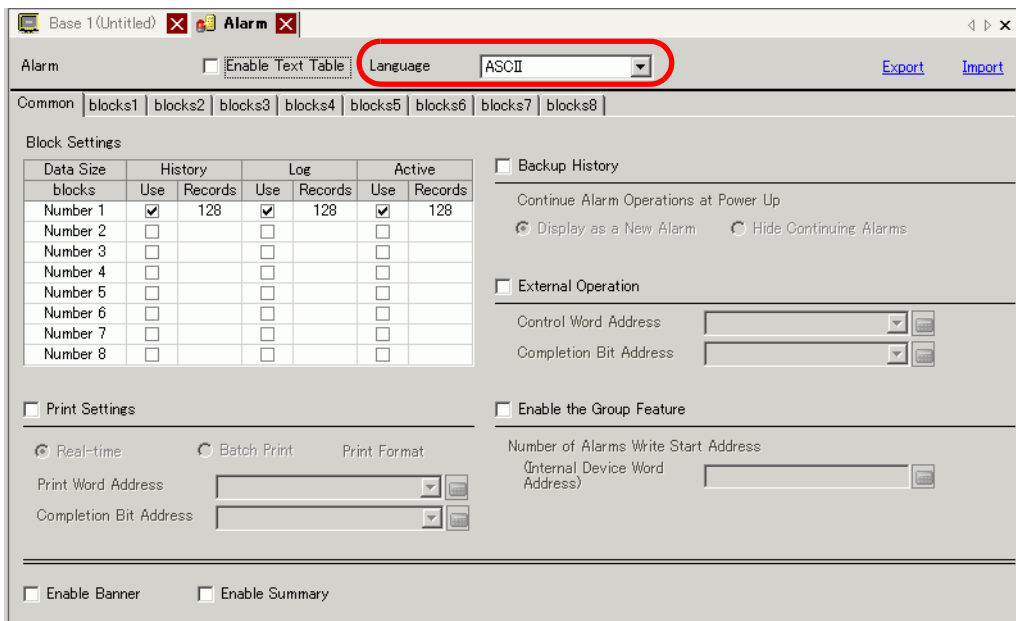

2 Select the [Enable Banner] check box.




3 When the following notice message appears, click [Yes]. The [Banner] tab is displayed.

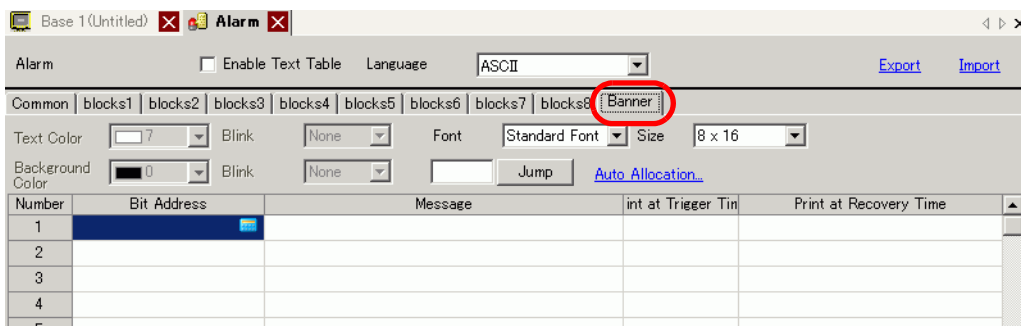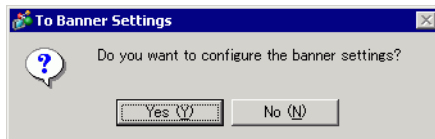

4 Set the [Bit Address] to monitor the alarm trigger. (For example, M1000)


Select device "M", input "1000" as the address, and press the "Ent" key.

Click  to display an address input keypad.



Number	Bit Address
1	[PLC1]M1000
2	

5 In the [Message] column, enter a message to scroll when an alarm is triggered, and specify [Text Color], [Background Color], and [Blink].

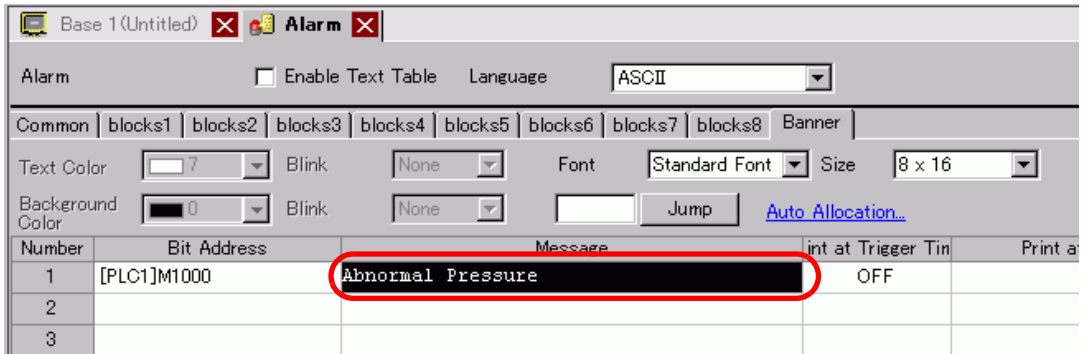


**NOTE**

- Up to 512 alarm messages can be registered.
- Set the monitoring bits within 128 Words for the whole Alarm Message (Banner).
- Up to 160 single-byte characters can be registered in a single Alarm Message.
- When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.  
 ☞ "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)
- Alarm settings can be exported or imported in CSV format.
- You can show Alarm messages in banners or Memory Link (Ethernet) messages in banners, but not both. If you set both, an error will occur and the transfer cannot be performed. Please decide between the two.
- The alarm message can be updated on startup or at any timing by reading it from the external memory without transferring the project data.  
 For details on the settings, refer to the following.  
 ☞ "17.7 Changing Text Table without Data Transmission" (page 17-38)

## 19.3 Viewing Active Alarms in a List

### 19.3.1 Introduction


When the Monitoring Bit Address turns ON, the Alarm scrolls across the screen.

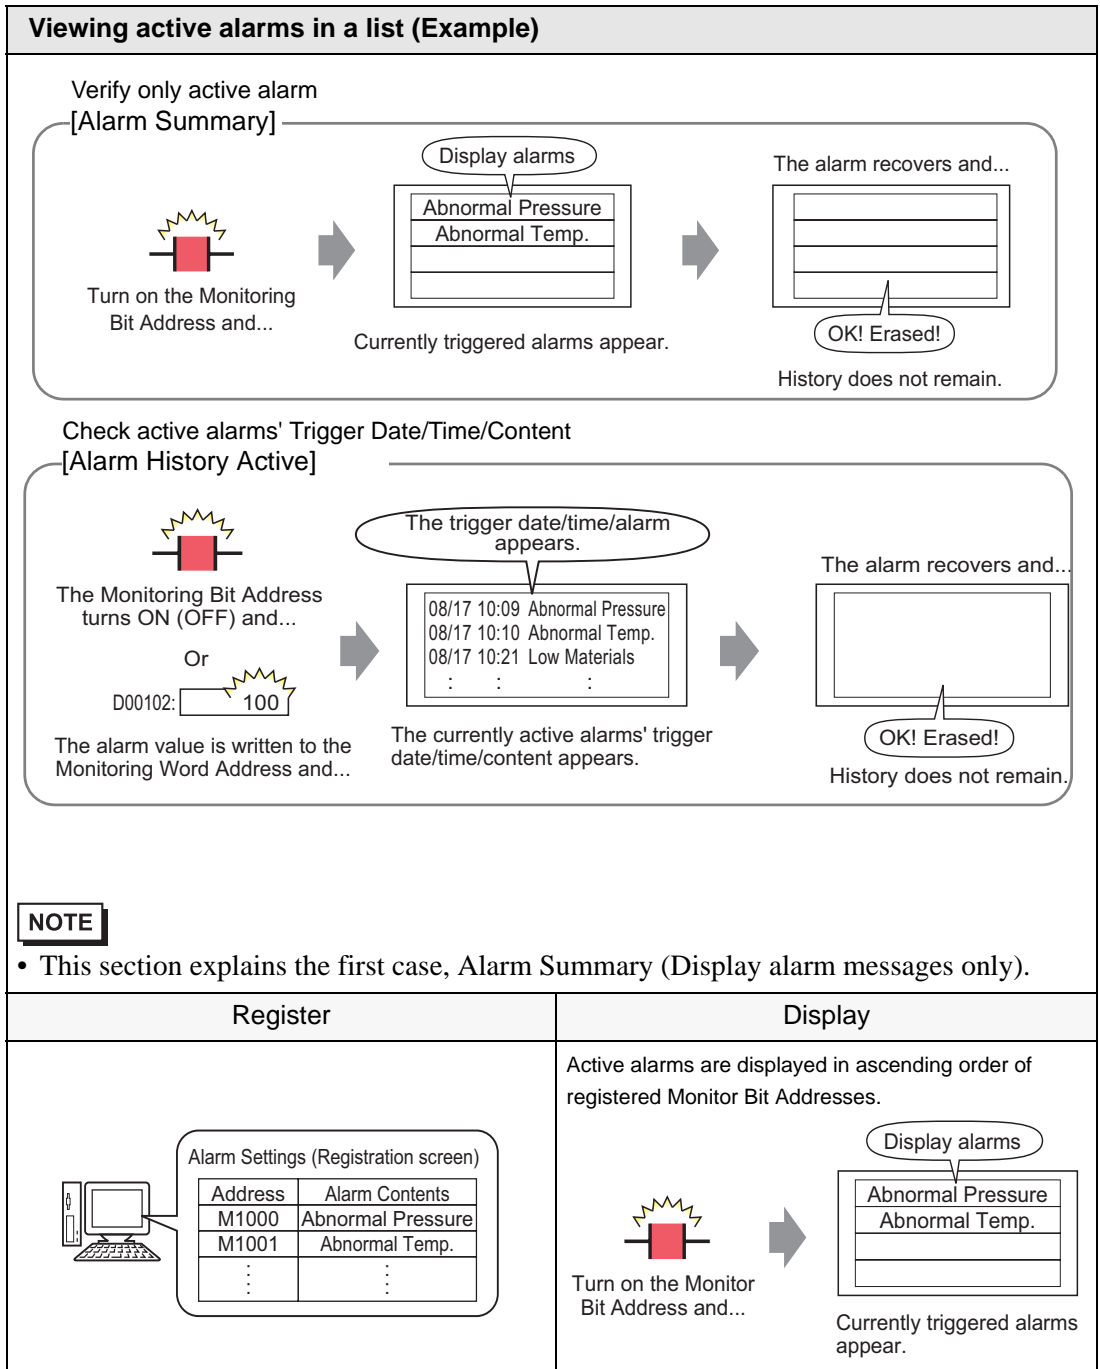


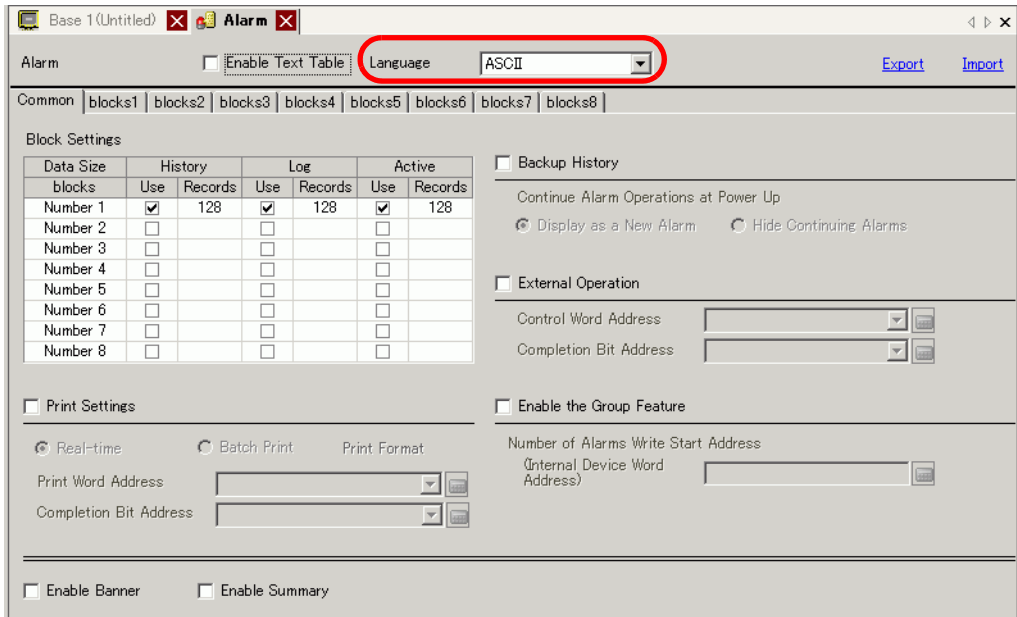
## 19.3.2 Setup Procedure

**NOTE**

- Please refer to the Settings Guide for details.
  - ☞ "19.10.1 Common (Alarm) Settings Guide ■ Alarm (Summary) Settings Guide" (page 19-100)
  - ☞ "19.10.2 Alarm Parts Settings Guide ■ Summary" (page 19-137)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)

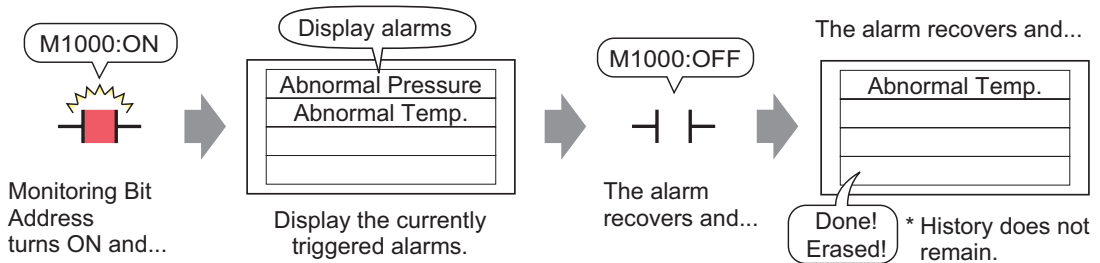



- 1 From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.



- 2 Select the [Enable Summary] check box.




3 When the following notice message appears, click [Yes]. The [Summary] tab is displayed.

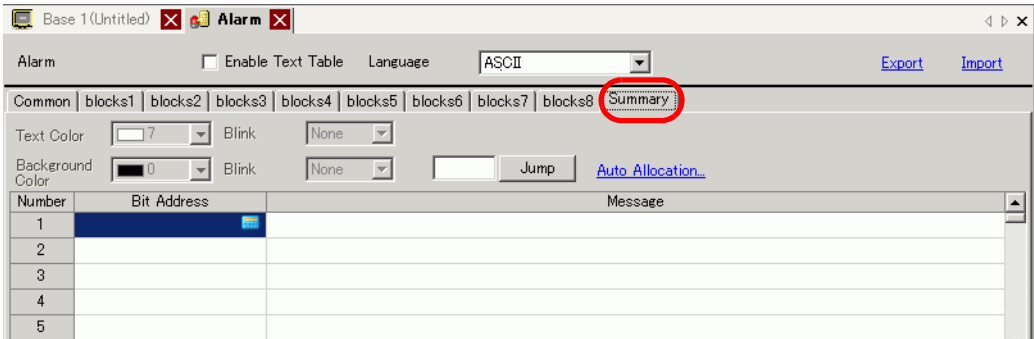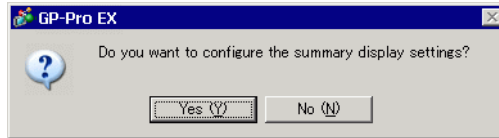


4 Set the [Bit Address] to monitor the alarm trigger. (For example, M1000)

Click  to display an address input keypad.

Select device "M", input "1000" as the address, and press the "Ent" key.

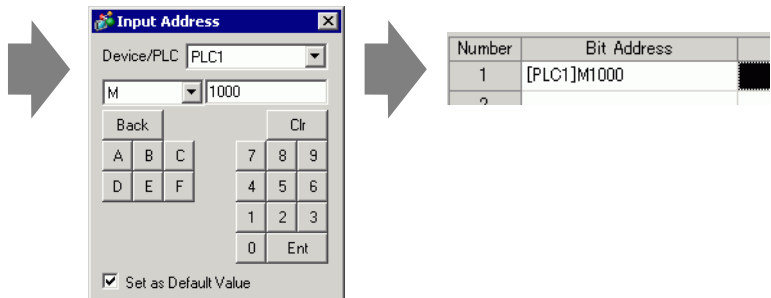


- 5 In the [Message] column, enter a message to display when an alarm is triggered, and specify [Text Color], [Background Color], and [Blink].

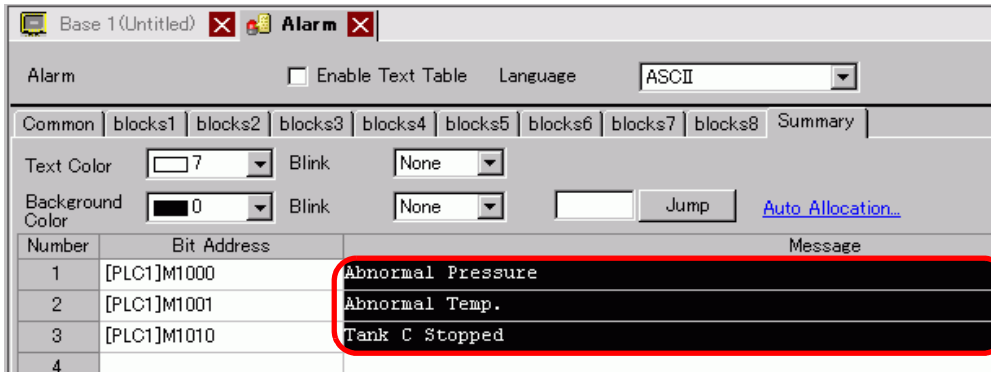
**IMPORTANT**

- Do not use the same address for multiple monitoring bits. When the same address is used for multiple monitoring bits, only the alarm message having the smallest registration number (Row Number) is displayed.
- Use consecutive Bit Addresses to set up the monitor bit for the message you want to display on 1 screen. If you set up monitor bits on different devices, or within the same device but in nonconsecutive Bit Addresses, you cannot display the message on the same screen.


**NOTE**

- Up to 8999 alarm messages can be registered.
- Up to 160 single-byte characters can be registered in a single Alarm Message.
- When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.
  - ☞ "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)
- Alarm settings can be exported or imported in CSV format.

- 6 Open the screen editor and set up the Alarm part. In the [Parts (P)] menu, select [Alarm (A)], or click  and place the Part on the screen.

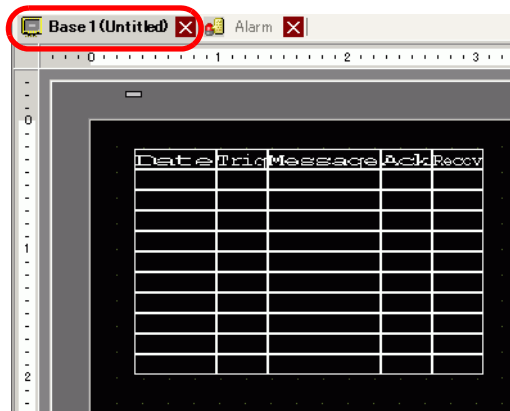


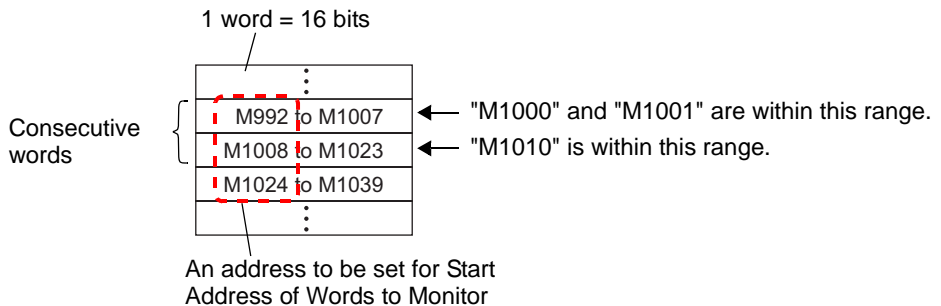


7 Double-click the placed Alarm. The Alarm dialog box appears. Select [Summary].

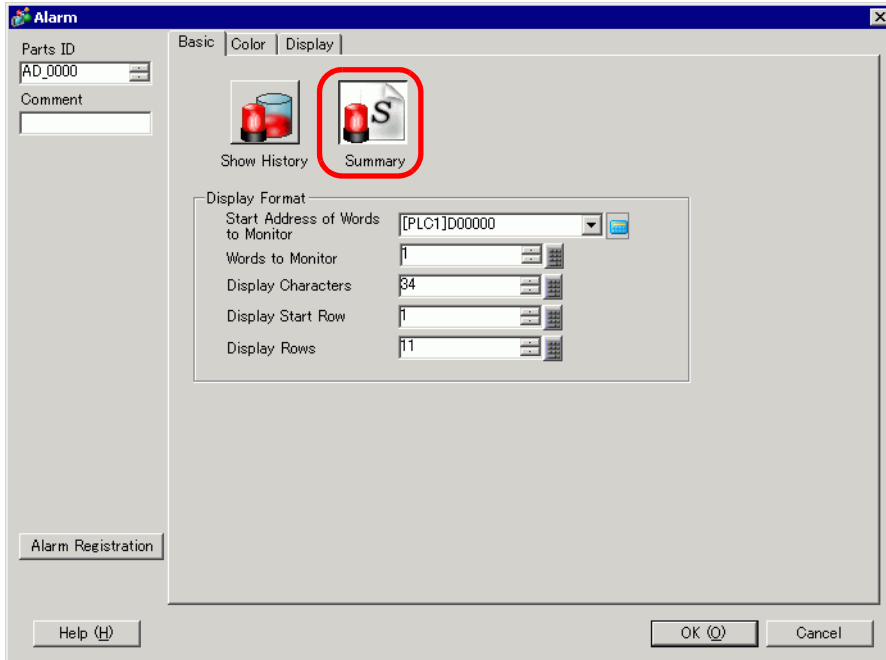


8 In [Start Address of Words to Monitor], set the start address of the Bit Address registered in [Alarm] by using the value converted into a 16-bit Word.  
 For example, to display the message of the registered monitoring bit "M1000" in a Summary, specify "M992" in [Start Address of Words to Monitor], because addresses from M992 to M1008 are included in one Word.

Select device "M", input "992" as the address, and press the "Ent" key.


Click  to display an address input keypad.



- 9 In [Words to Monitor], allocate monitoring bit addresses by defining the number of Words from the [Monitoring Word Address]. (For example, 2)



- 10 Set the [Display Characters], [Display Start Row], and [Display Rows] of the message to be displayed on the screen.

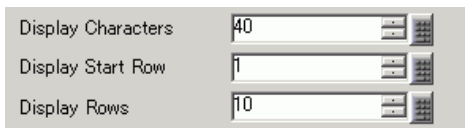

- 11 Set the color to be used when Alarm Message is recovered and cleared in the [Color] tab, then set the font and size of the message in the [Display] tab, and click [OK].

---


**NOTE**

- You can draw one alarm part (alarm summary) on one base screen. If you want multiple alarm parts on the same screen, use Window parts to load and display Window Screens set up with alarm parts.
  - Each alarm message can have a maximum 160 single-byte characters. You can display up to 50 rows on a single screen. When displaying alarms on the GP, the maximum number of characters per row and the maximum number of rows per screen depends on the GP model and the font size.
  - If the Alarm Message is wider than the display area, the portion that exceeds the area is truncated and is not displayed.
  - By setting Alarm Parts [Summary] on multiple screens, a maximum of 1,600 Alarm Messages can be displayed in an entire project.
  - Place the Alarm Parts [Summary] display areas so that they do not overlap with other parts or objects.
-

## 19.4 Acknowledging the Alarm History

### 19.4.1 Introduction

When the Monitoring Bit Address turns ON (or OFF depending on your setting preference), or when alarm data is written to the Monitoring Word Address, the Alarms are listed together with its trigger date/time. There are three ways to view the Alarms: "Active", "Log", and "History".

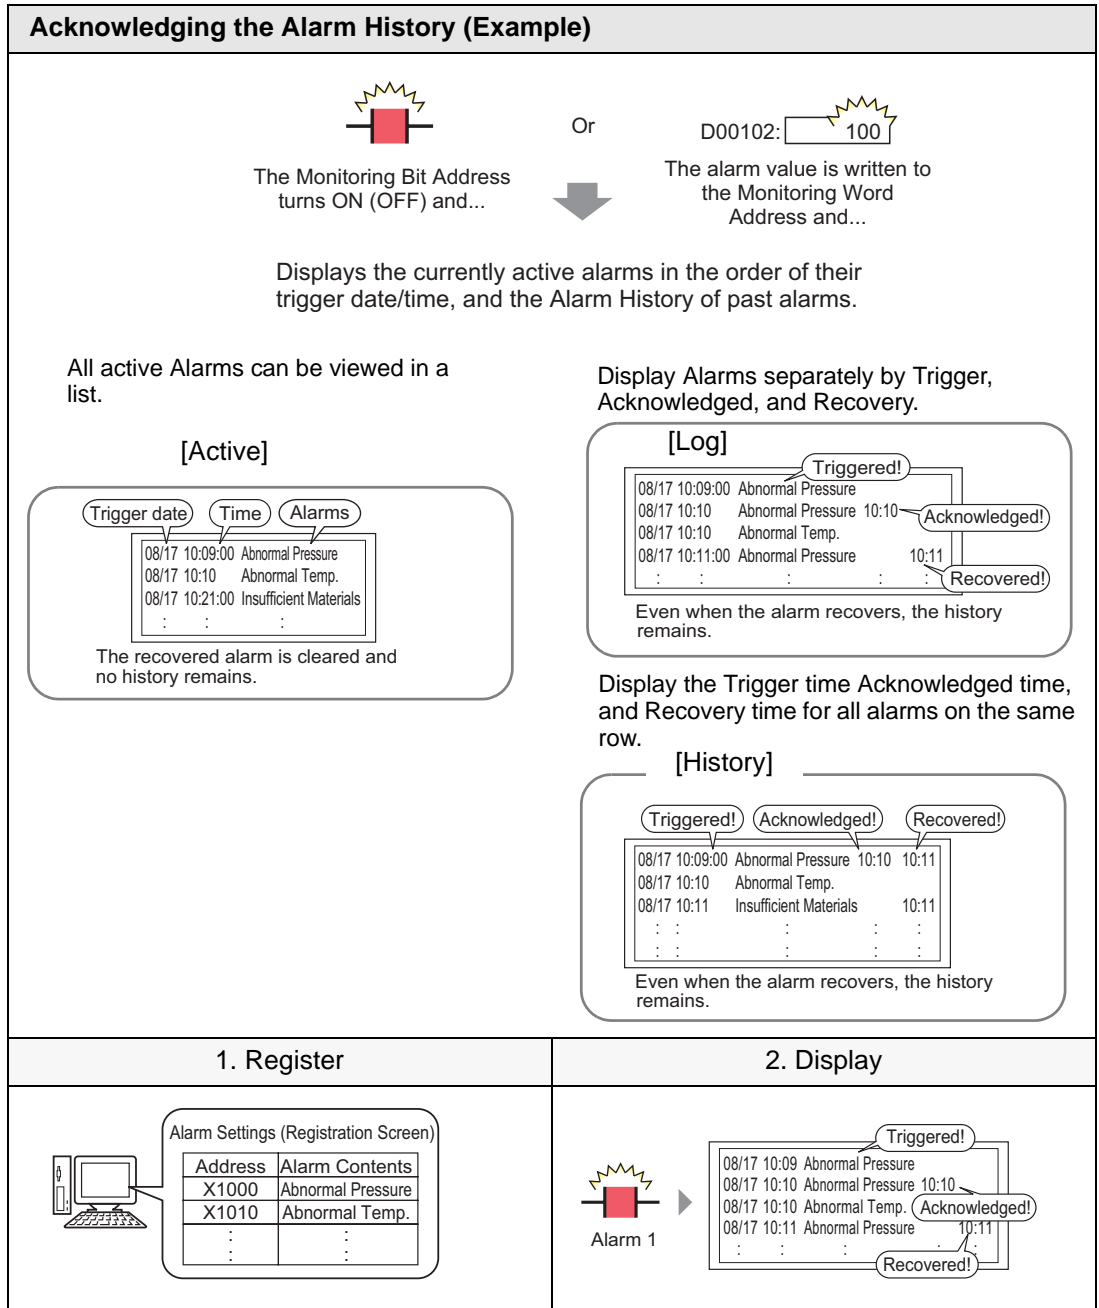

## 19.4.2 Setup Procedure


### ■ Bit Monitoring

**NOTE**


- Please refer to the Settings Guide for details.
  - ☞ 19.10.1 Common (Alarm) Settings Guide ■ Alarm (Block 1) Settings Guide ◆ Bit Monitoring 19-85
  - ☞ "19.10.2 Alarm Parts Settings Guide ■ Show History" (page 19-103)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)

When the Monitoring Bit Address turns ON, the Alarms are displayed together with their trigger date/time. When the Monitoring Bit Address turns OFF, the recovery time is added on the same row.


Display mode: [History]

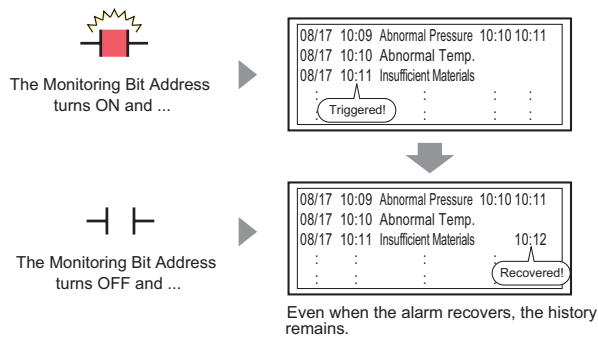


1 From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

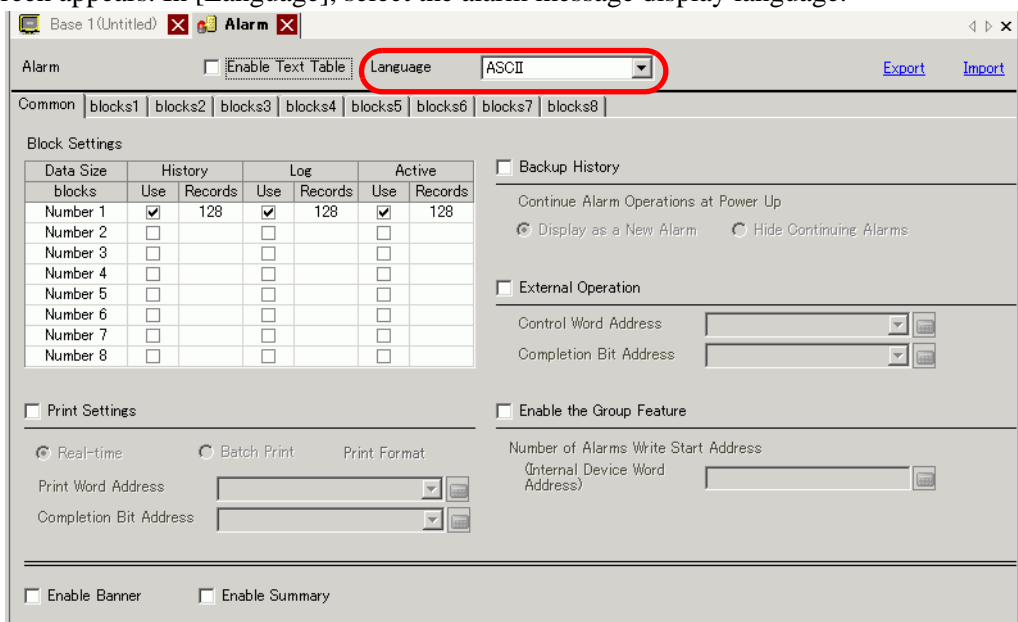

2 In the Block Settings, select the check box for the desired display mode (History/Log/Active) for the block to which the message is registered, and set the number of messages stored as history for each mode.

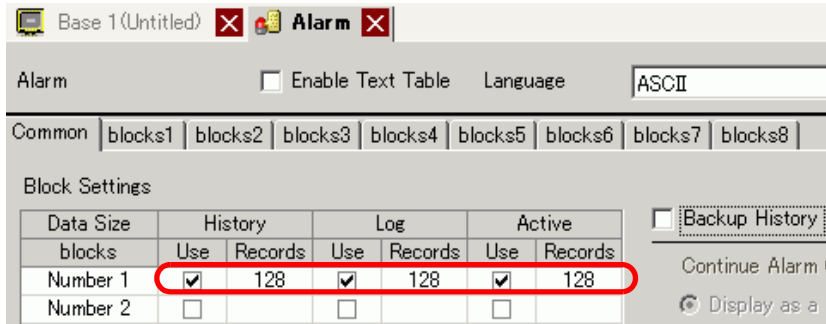


3 Select [Backup History] and define [Hide Continuing Alarms].

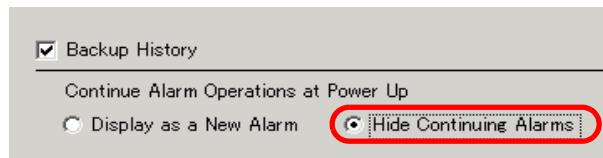


**IMPORTANT**

- When the [Backup History] check box is not selected, the alarm history data will be erased when the GP unit is turned OFF or reset.


4 From the [Block1] tab, select [Bit Monitoring].

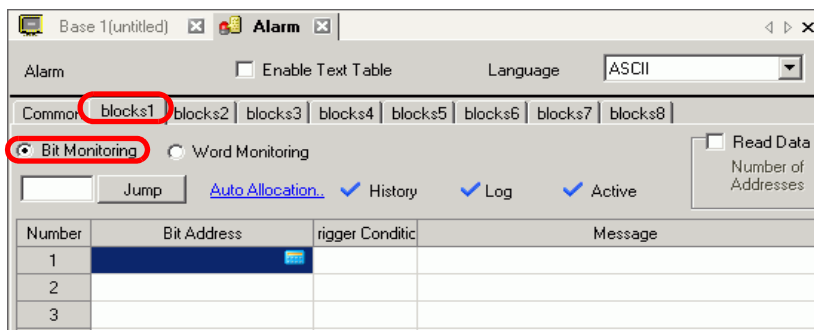


5 In [Bit Address], set the bit address to monitor the alarm trigger. (For example, M1000)

Click  to display an address input keypad.


Select device "M", input "1000" as the address, and press the "Ent" key.

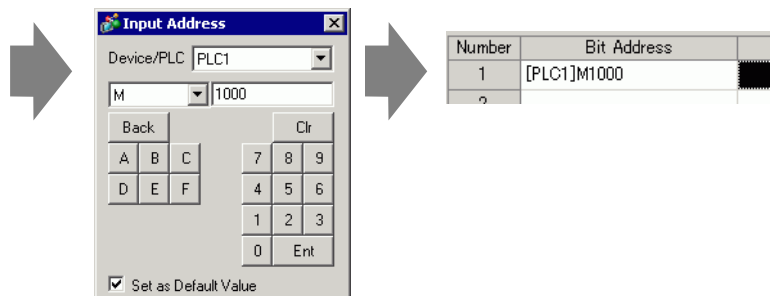

6 In the [Trigger Condition] cell, select whether the alarm is triggered when the Monitoring Bit Address turns ON or turns OFF.

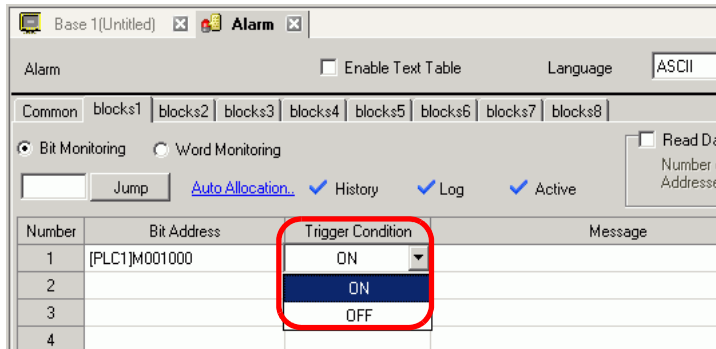


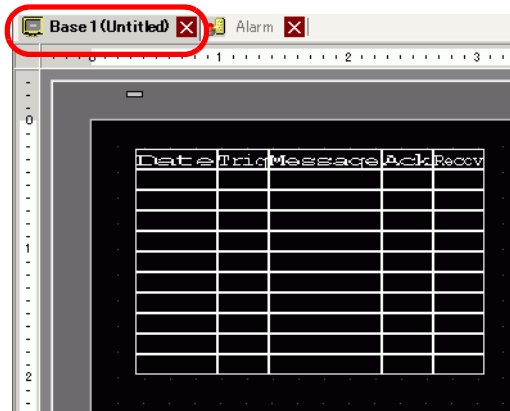
7 In the [Message] cell, input the alarm message that will display when the alarm is triggered.

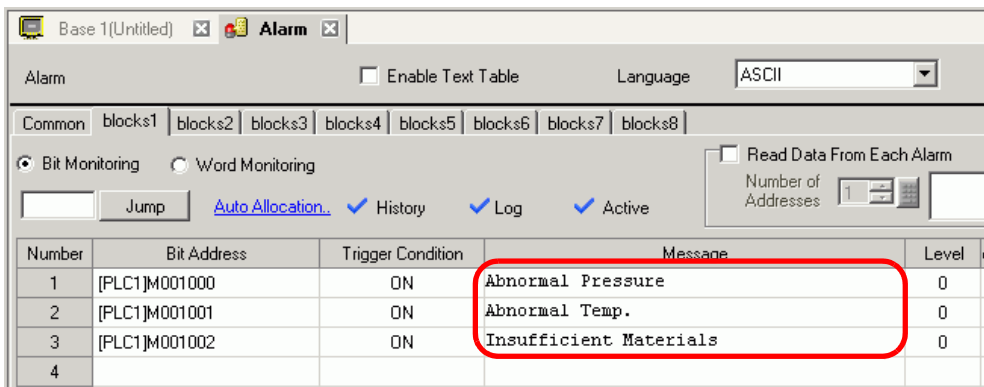

**NOTE**


- Up to 160 single-byte characters can be registered in a single Alarm Message.
- When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.  
 ☞ "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)
- Alarm settings can be exported or imported in CSV format.

8 Open the screen editor and set the Alarm part which will display the Alarm. In the [Parts (P)] menu, select [Alarm (A)], or click  and place the Part on the screen.





9 Double-click the placed Alarm. The Alarm dialog box appears.

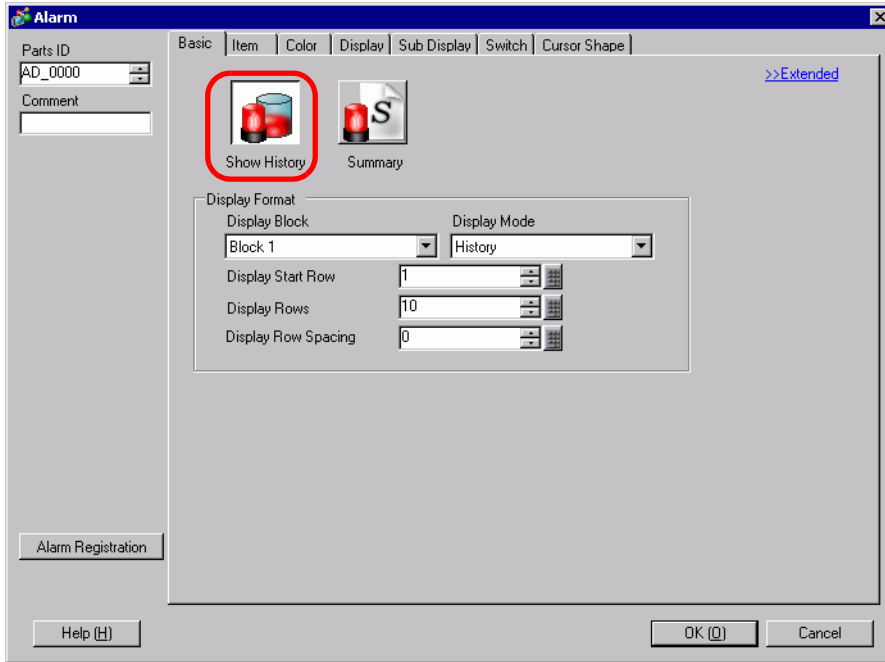

10 For the alarm, select the Block and the Mode to display.

11 Set the [Display Start Row], [Display Rows] and [Display Row Spacing].


12 As needed, use the [Item] tab, [Color] tab, and [Display] tab options to change alarm message's number of display characters, text color, background color, font, and size. Click [OK].

## ■ Word Monitoring


**NOTE**

- Please refer to the Settings Guide for details.
  - ☞ 19.10.1 Common (Alarm) Settings Guide ■ Alarm (Block 1) Settings Guide ◆ Word Monitoring 19-89
  - ☞ "19.10.2 Alarm Parts Settings Guide ■ Show History" (page 19-103)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)


When the alarm value is written to the Monitoring Word Address, the alarm is displayed together with the trigger date/time. When a value other than the alarm value is written, the recovery time is added to the same row.

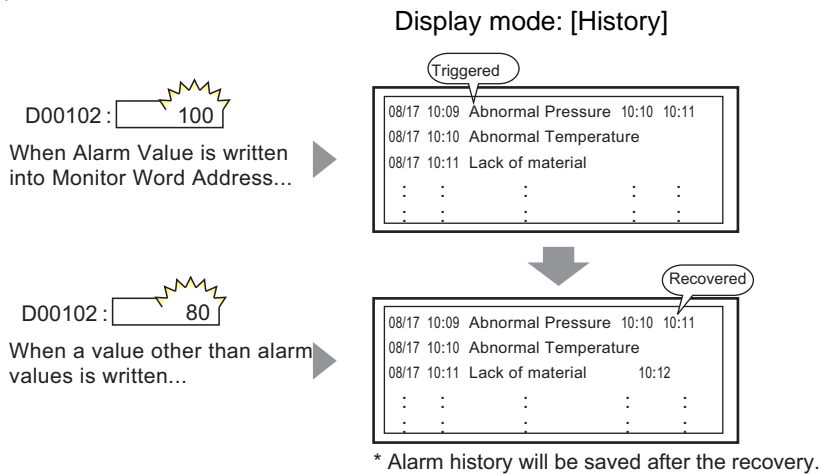

1 From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

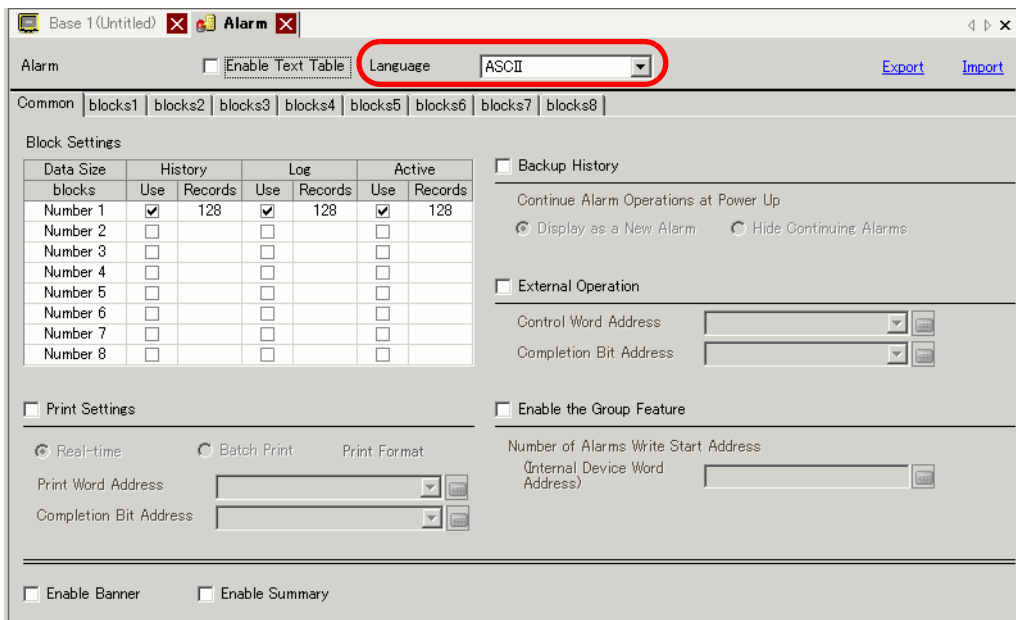

2 In the Block Settings, select the check box for the desired display mode (History/Log/Active) for the block to which the message is registered, and set the number of messages stored as history for each mode.

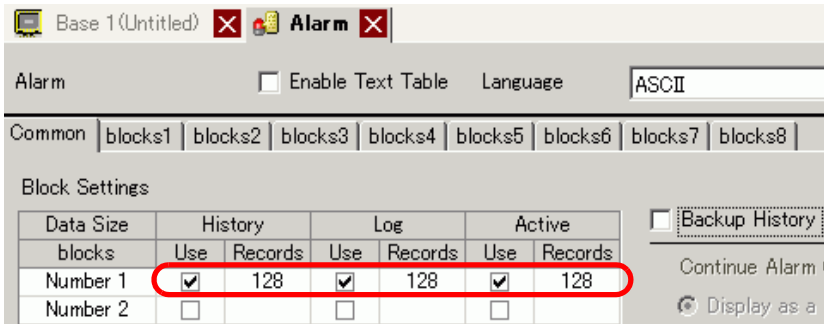


3 Select [Backup History] and define [Hide Continuing Alarms].



**IMPORTANT**

- When the [Backup History] check box is not selected, the alarm history data will be erased when the GP unit is turned OFF or reset.

4 Open the [Block 1] tab, and select [Word Monitoring].

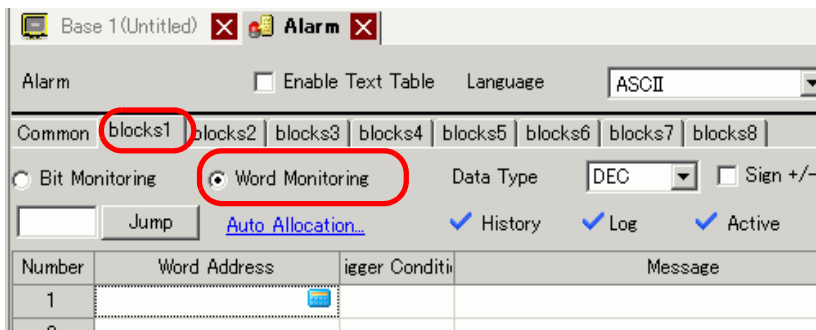

5 In [Data Type], select the data type of the [Alarm Value] to store in [Word Address].


**NOTE**

- [Sign +/-] can only be set when the [Data Type] is [DEC].


6 In [Word Address], set the Word Address to monitor the alarm trigger. (For example, D102)

Click the icon to display an address input keypad.

Select device "D", input "102" as the address, and press the "Ent" key.

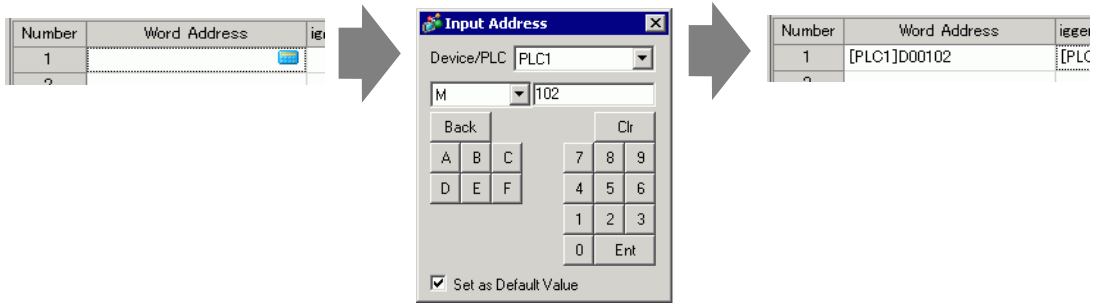


7 Click the [Trigger Condition] cell, then click . The [Trigger Condition Settings] dialog box appears.

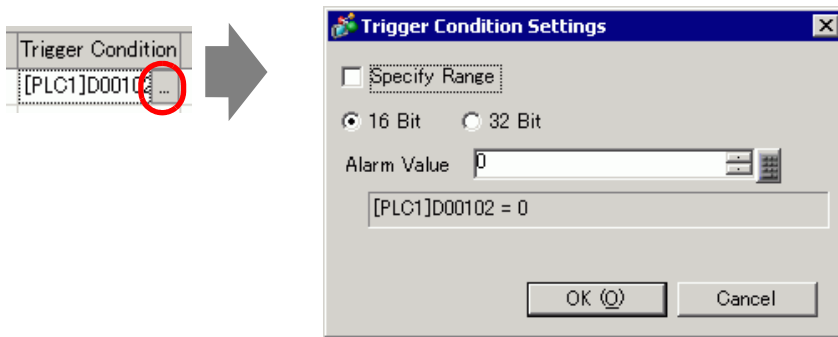


8 Select the bit length, set [Alarm Value] (e.g., 100), and click [OK].


9 In the [Message] cell, input the alarm message that will display when the alarm is triggered.

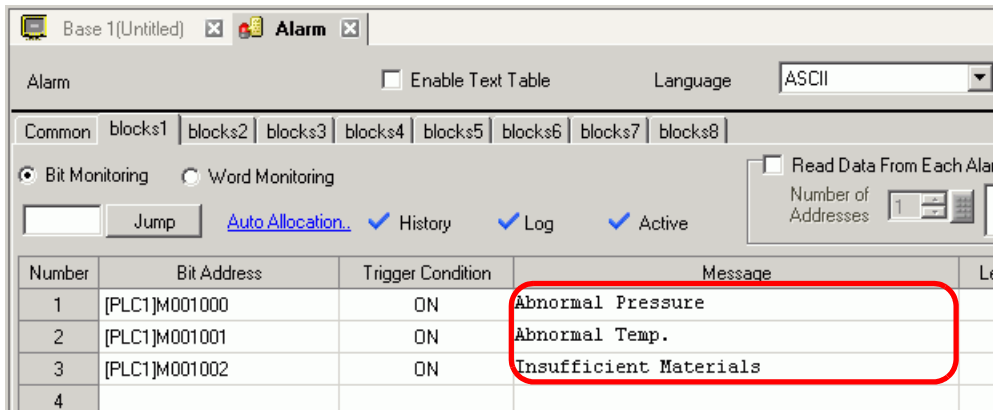


**NOTE**

- Up to 160 single-byte characters can be registered in a single Alarm Message.
- When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.  
 "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)
- Alarm settings can be exported or imported in CSV format.

- Open the screen, and set the Alarm that will display the History. In the [Parts (P)] menu, select [Alarm (A)], or click  and place the Part on the screen.

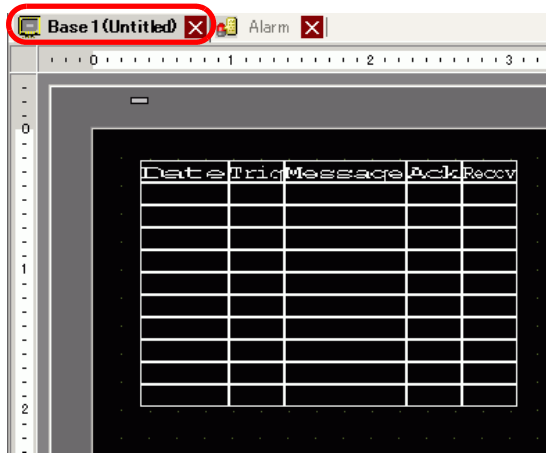

- Double-click the placed Alarm. The Alarm dialog box appears.

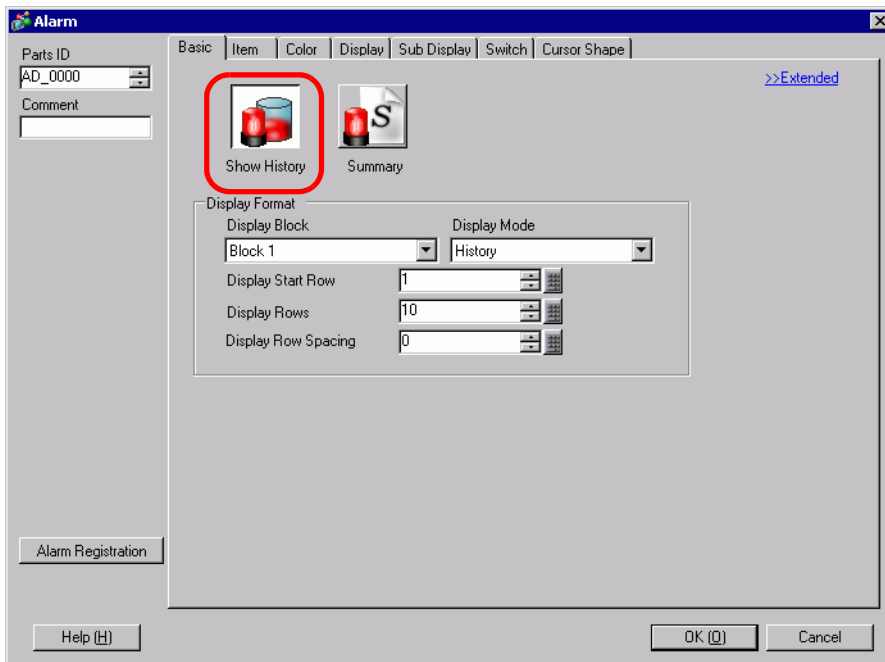


- Set the block and mode to be displayed for the Alarm.
- Set the [Display Start Row], [Display Rows] and [Display Row Spacing].
- As needed, use the [Item] tab, [Color] tab, and [Display] tab options to change alarm message's number of display characters, text color, background color, font, and size. Click [OK].

**NOTE**

- When using the GP, you can set up 2,048 alarm messages. At run time, the GP can record up to 768 History, Log and Active messages in memory. When using the IPC, you can set up 10,000 alarm messages. At run time, the IPC can record up to 10,000 messages.
- When using multiple blocks, the total Alarm Messages that can be set for all blocks is 768.
  - ☞ "19.7 Viewing Alarms by Line" (page 19-48)
- The Monitoring Bit Address and Monitoring Word Address must be set within 256 Words of the Alarm Message (History).
- The maximum number of characters on one line and lines on one screen are decided by the GP type and [Size].
- If your message is wider than the display area, the portion that exceeds the area is truncated and is not displayed.
- For [Word Monitoring], if the alarm value stored in the [Word Address] fluctuates frequently, the alarm will be triggered often.

For example, when [Alarm Value] = 100

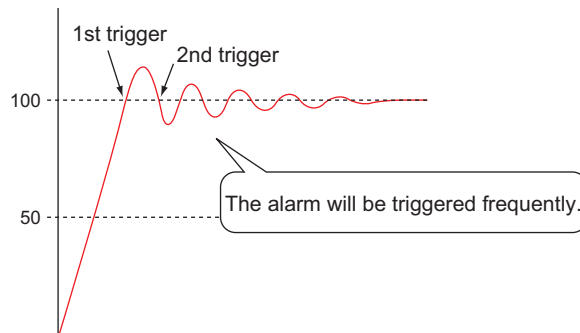


## 19.5 Working with Alarm History

### 19.5.1 Introduction

Select an operation switch to display an Alarm Message.


Several operations are available such as scrolling, sorting the displayed messages, and acknowledging and erasing the selected alarm message.

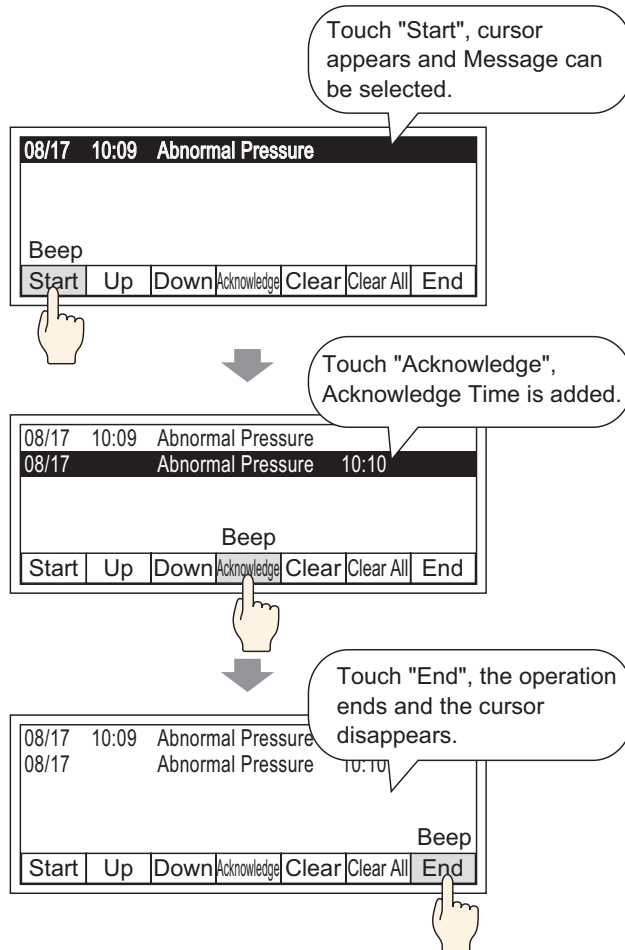


## 19.5.2 Setup Procedure

**NOTE**

- Please refer to the Settings Guide for details.
  - ☞ 19.10.2 Alarm Parts Settings Guide ■ Show History ◆ Switch 19-128
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)

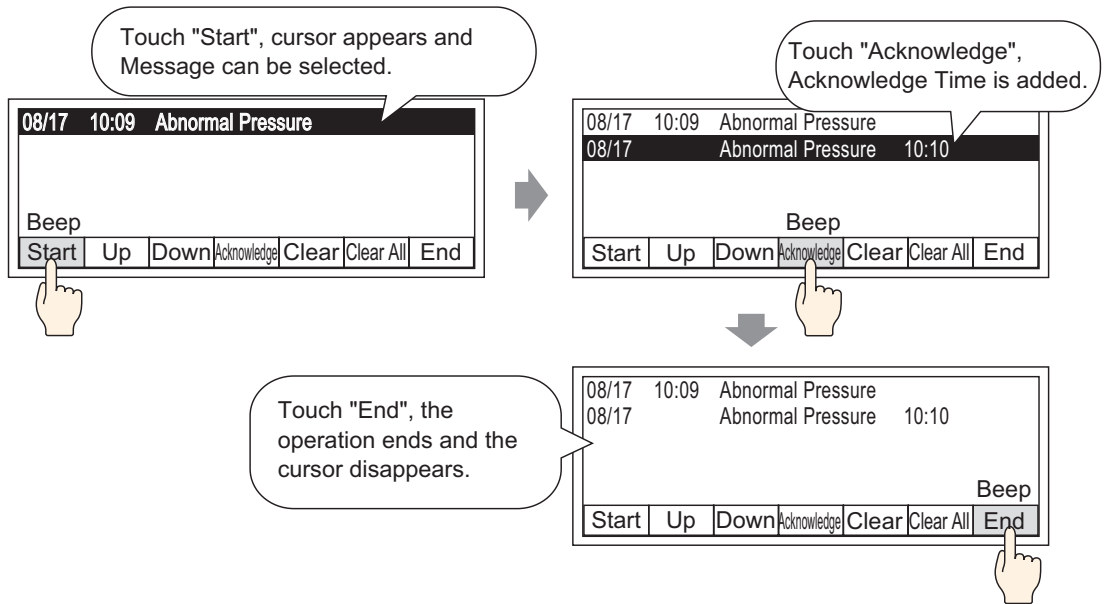

1 Double-click the new Alarm part. The Alarm dialog box appears. Open the [Switch] tab, and select the check box options you want.

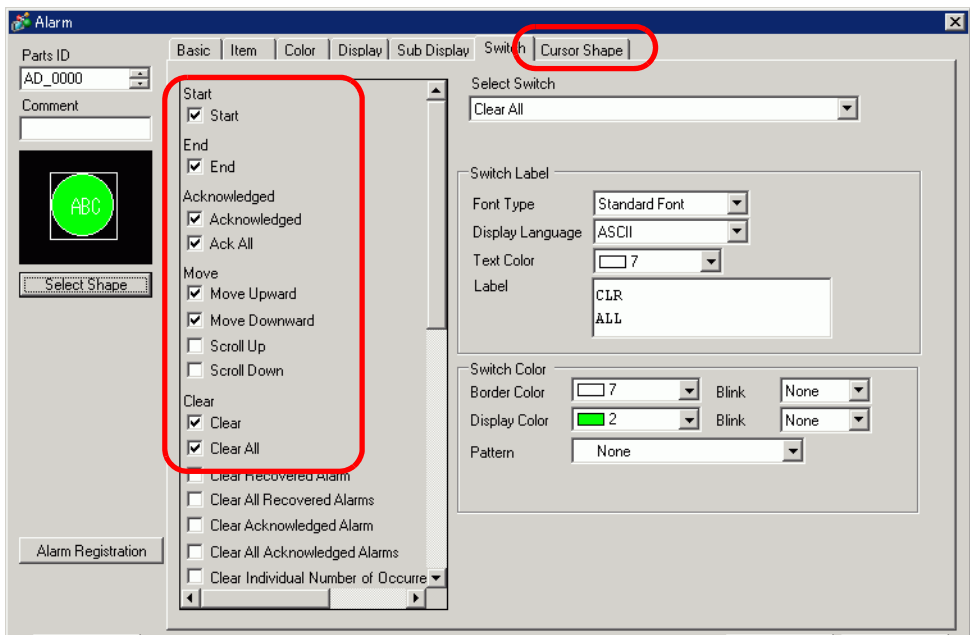




- 2 Select the Switch shape from [Select Shape].
- 3 Choose the switch with [Select Switch], and designate the switch label [Font Type], [Display Language], [Text Color] and [Label].
- 4 As necessary, set the Switch colors in [Switch Color].

**NOTE**

- Depending on the shape, you may not be able to change the color.
- Select the switch and press the [F2] key to directly edit the text of the label.
- The Switch Color and Shape settings are common to all Alarm parts, regardless of the switch type selected. To change the shape and color for each switch, use a Switch Lamp Part [Special Switch (Alarm History Switch)].


👉 10.15.4 Special Switch ◆ Alarm History Switch 10-73

- 5 Click the [Cursor Shape] tab, select [Cursor Shape] as [Mirror], and click [OK].

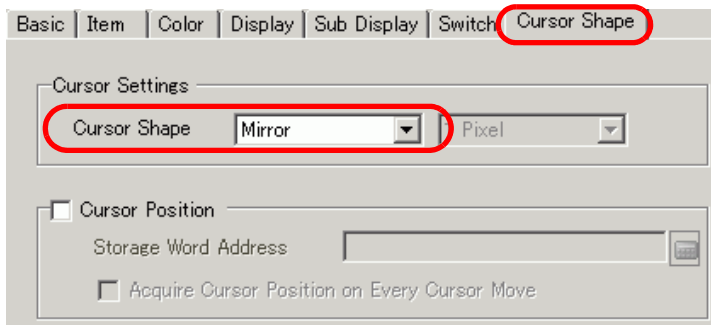


**NOTE**

- In order to use an Alarm Part (History) Switch, only one Alarm Part should be used per screen.

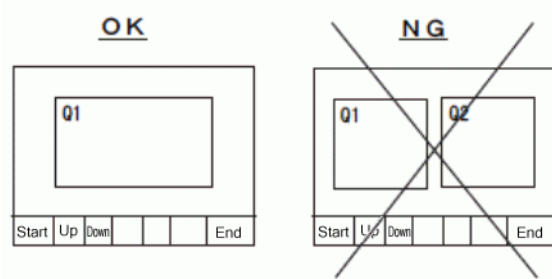

- Set the switches to the same screen that the Alarm Part is set to. They cannot be used if they are set to another screen.

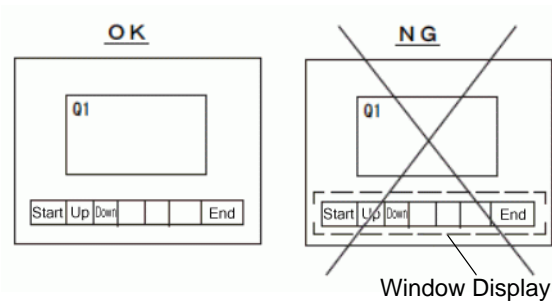


- When using the [Clear All Number of Occurrences], [Clear All Accumulated Time], and [Clear Individual Accumulated Time] switches, please be aware that data stored in the backup SRAM of the GP is also erased (cleared to "0"), not just the displayed values.
- When sort switches are placed on the screen and any of the switches (other than the [In Reverse Order of Trigger Date] switch) is pressed, it may take longer than usual to update the screen at a screen change.
- When sorting is performed on two blocks simultaneously such as [Level & In Reverse Order of Trigger Date], it may take longer than usual to display the result.

## 19.6 Displaying Help (Sub Display)

### 19.6.1 Introduction


#### ■ Change Base Screen

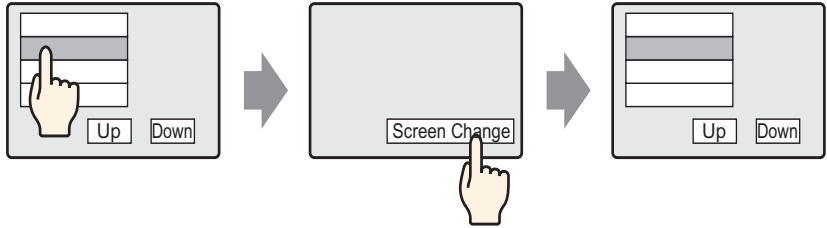

Touch the alarm message, and the screen changes to another screen according to the alarm.

Return to alarm screen using Change Screen Switch

#### ■ Show Text Window

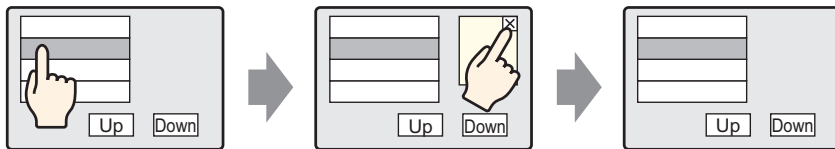

Touch the alarm message, and a Text Window is displayed according to the alarm.


Touch the Window Clearing Switch to close the Text Window.

## 19.6.2 Setup Procedure


### ■ Change Base Screen


**NOTE**

- Please refer to the Settings Guide for details.
  - ☞ "10.15.3 Change Screen Switch ■ Switch Feature" (page 10-69)
  - ☞ "19.10.1 Common (Alarm) Settings Guide ■ Alarm (Block 1) Settings Guide" (page 19-85)
  - ☞ "19.10.2 Alarm Parts Settings Guide ■ Show History" (page 19-103)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)

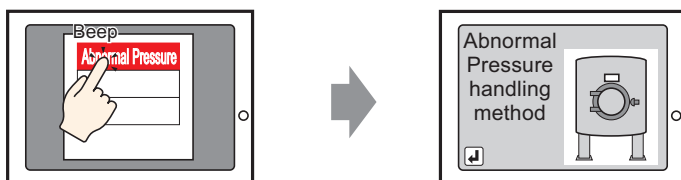



Touch the alarm, and the screen changes to another screen.


- 1 Create the Base screen you want to show in the Sub-Display. In the [Screen (S)] menu, select [New Screen (N)], or click . The [New Screen] dialog box appears.
- 2 In Screen, set the Base Screen Number (For example, 10) used for the Sub Display, and click [OK].

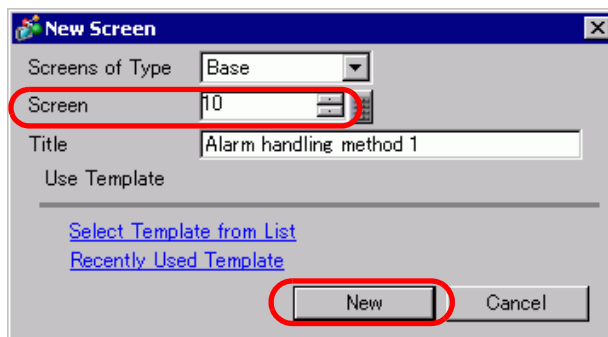


3 When Base Screen "10" appears, create the Base Screen for the Sub Display.

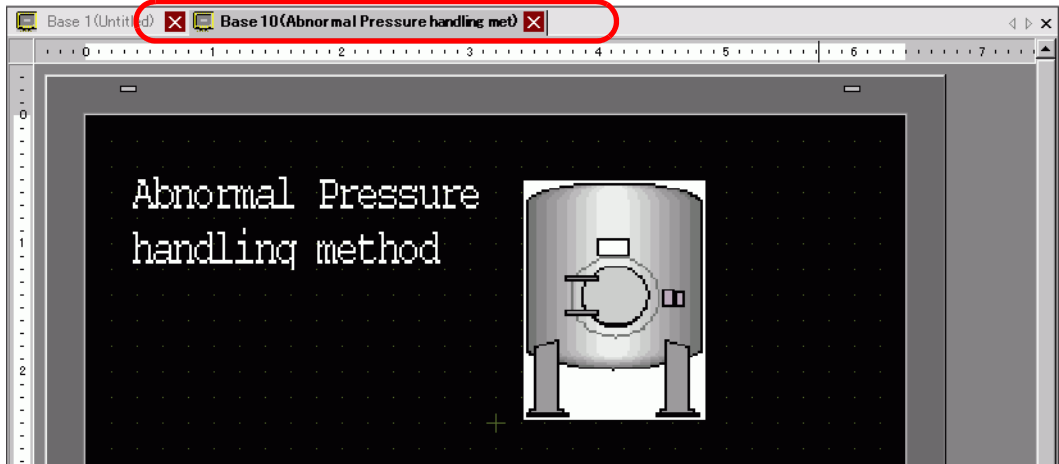

4 Set the Switch to change from the Sub Display screen to the Alarm Part placement screen. From the [Parts (P)] menu, point to [Switch/Lamp (C)] and select [Change Screen Switch (C)] or click , and place the Switch on the screen.

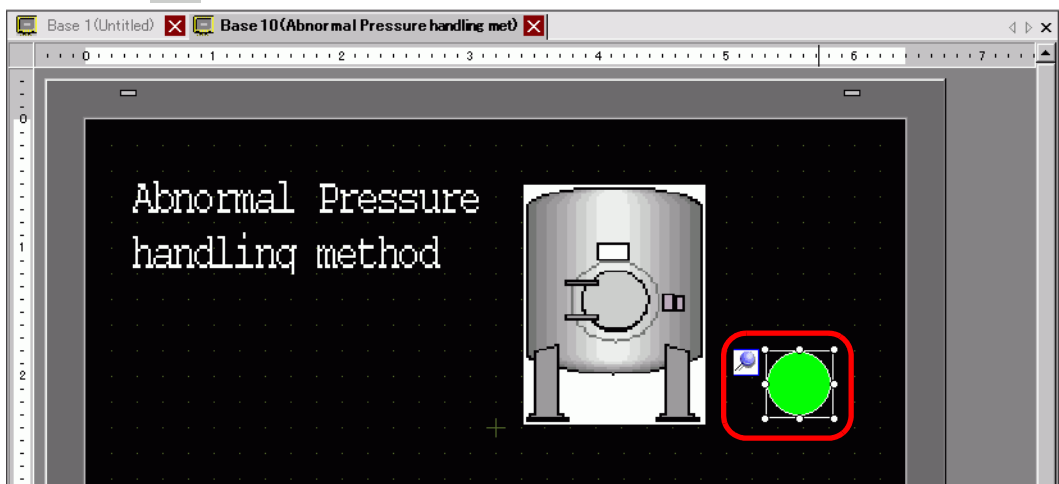


5 Double-click the placed Switch part. The following dialog box appears.

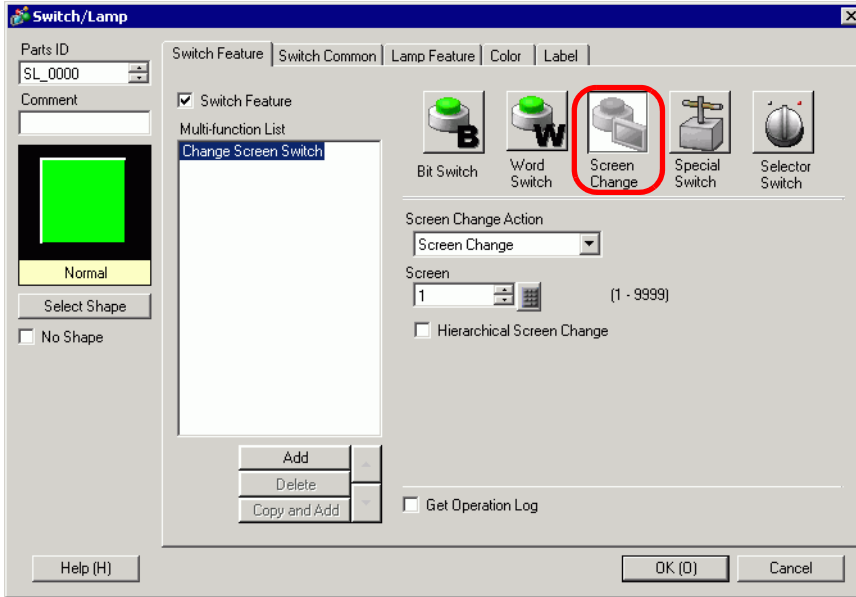

6 In [Select Shape], select the Switch shape.


7 In [Screen Change Action], select the action for changing screens, and set the screen number of the destination screen (For example, 1).


8 As needed, set the color and display text on the [Color] tab and [Label] tab, and click [OK]. The creation of the Sub Display screen is complete.

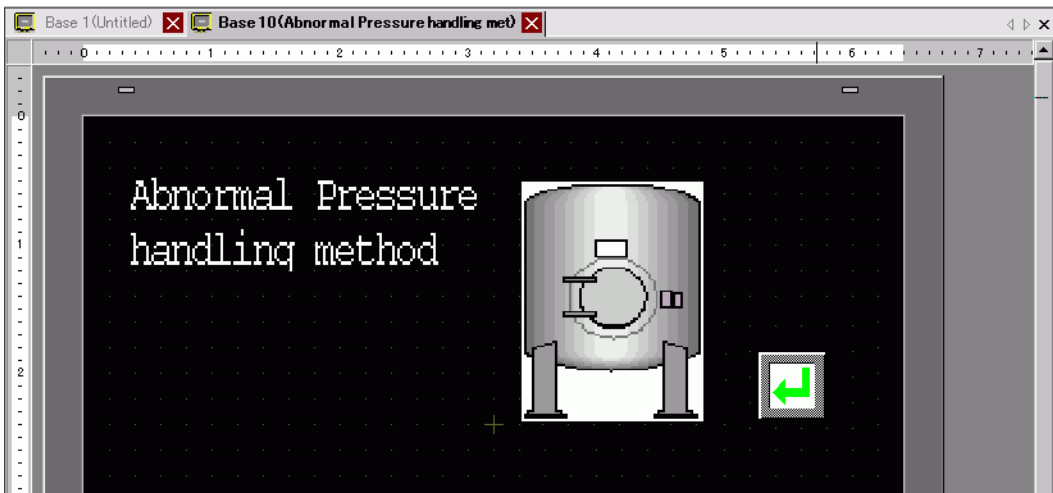

**NOTE**

- Depending on the shape, you may not be able to change the color.
- Select the switch and press the [F2] key to directly edit the text of the label.

- 9 Next, register the Message to display when the Alarm is triggered. From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

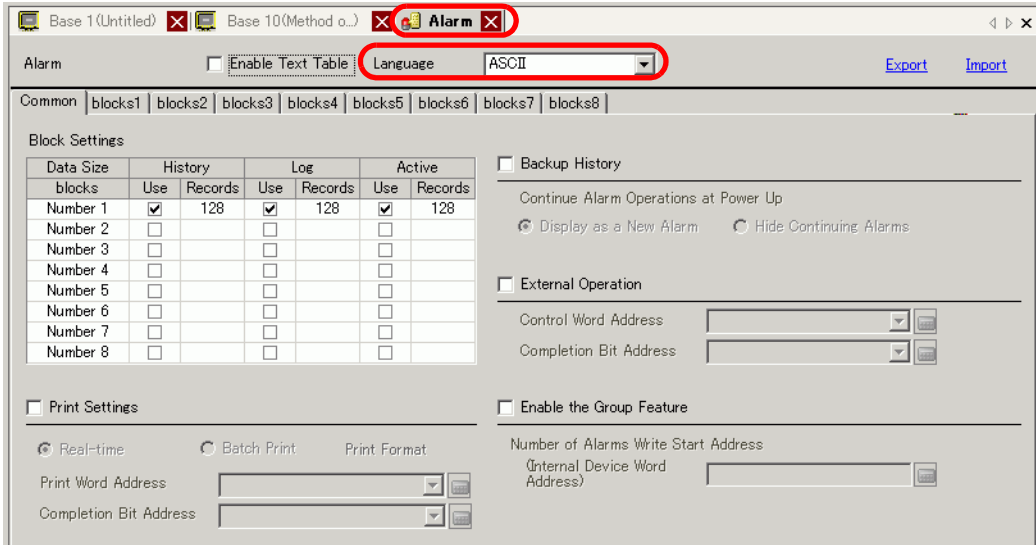


- 10 In the Block Settings, select the check box for the desired display mode (History/Log/Active) for the block to which the message is registered, and set the number of messages stored as history for each mode.
- 11 Select [Backup History] and define [Hide Continuing Alarms].

**IMPORTANT**

- When the [Backup History] check box is not selected, the alarm history data will be erased when the GP unit is turned OFF or reset.


- 12 From the [Block1] tab, select [Bit Monitoring].

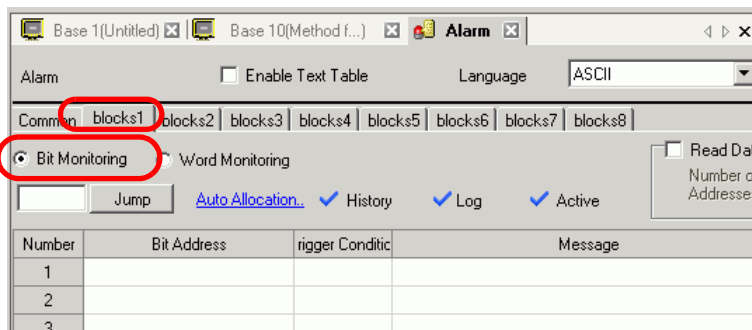


13 In [Bit Address], set the bit address to monitor the alarm trigger. (For example, M1000)

Click the icon to display an address input keypad.

Select device "M", input "1000" as the address, and press the "Ent" key.

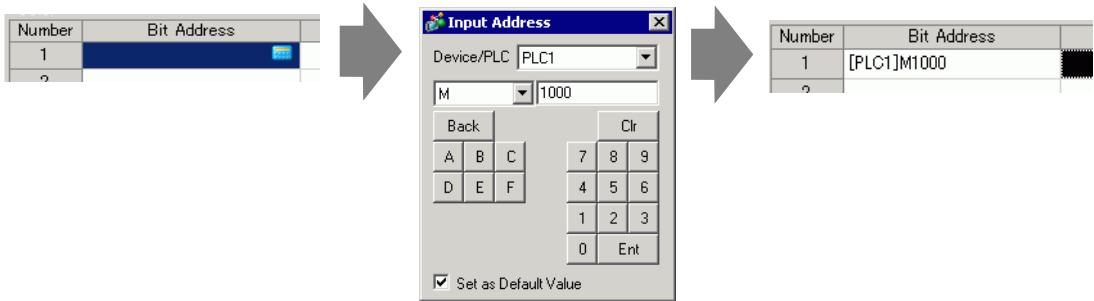

14 Click the [Trigger Condition] cell and select whether the alarm is triggered when the Monitoring Bit Address turns ON or turns OFF.

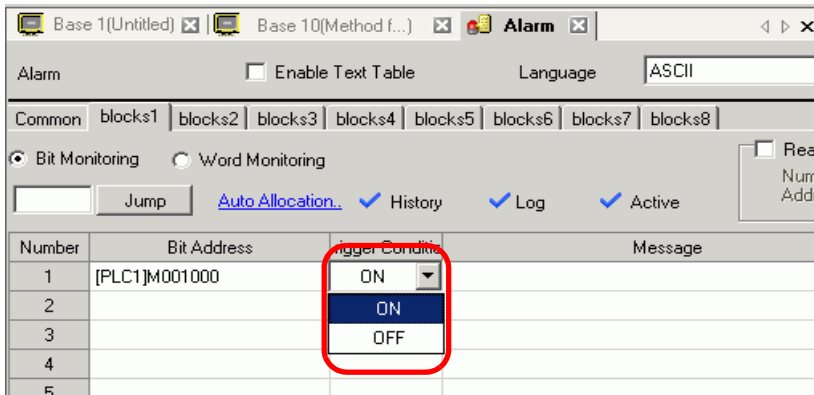


15 In the [Message] cell, input the alarm message that will display when the alarm is triggered.

**NOTE**


- Up to 160 single-byte characters can be registered in a single Alarm Message.
- When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.
  - ☞ "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)
- Alarm settings can be exported or imported in CSV format.


16 Set the Sub Display Screen Number. (For example, 10)

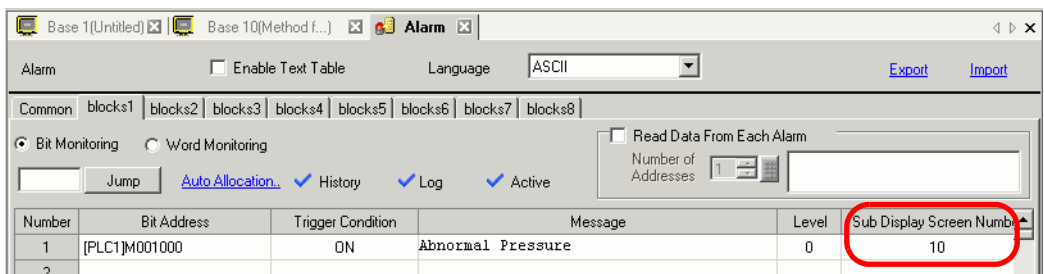




17 Set up the alarm part to display alarms.

Open the screen to display the Alarm (for example, Base 1), and in the [Parts (P)] menu, select [Alarm (A)], or click , and place the Part on the screen.

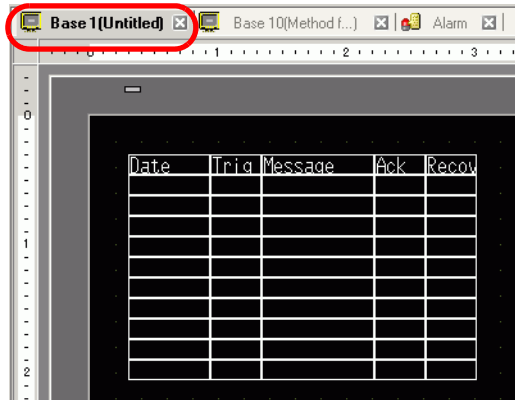


18 Double-click the placed Alarm. The Alarm dialog box appears.

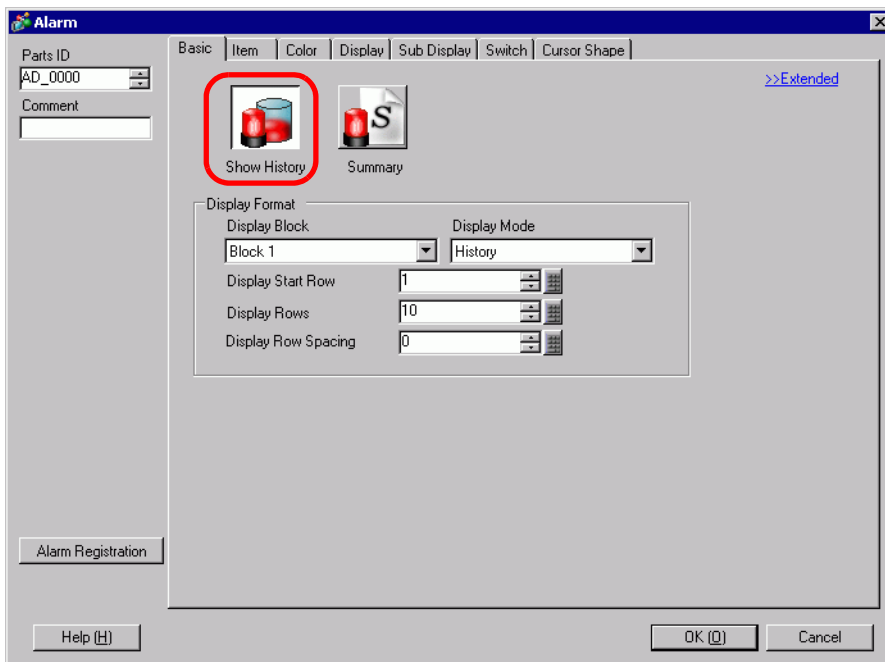

19 Set the block and mode to be displayed for the Alarm.

20 Set the [Display Start Row], [Display Rows] and [Display Row Spacing].

21 Open the [Sub Display] tab and select the [Enable the Sub Display] check box.

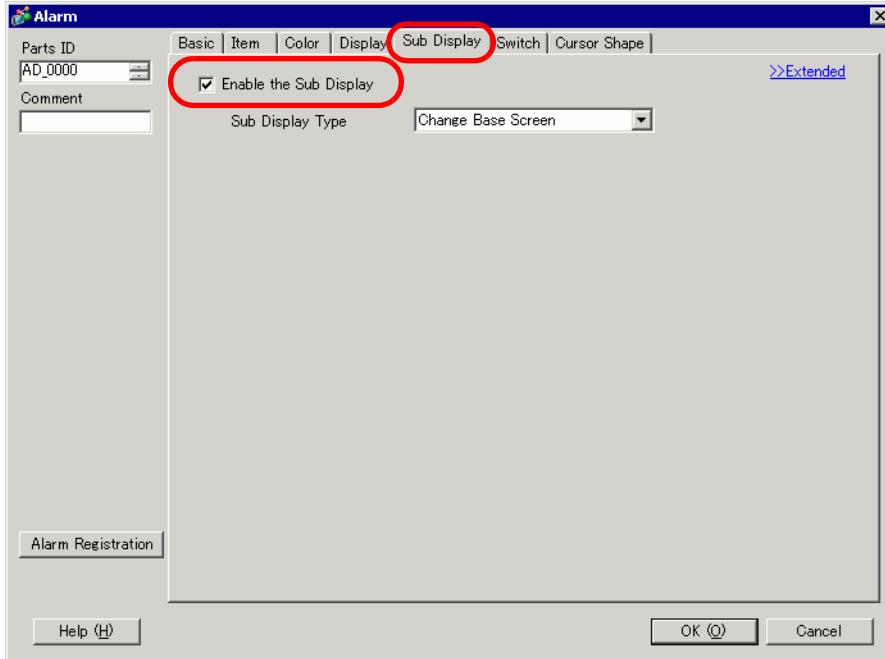


22 In the [Sub Display Type] list, select [Change Base Screen].

23 As needed, use the [Item] tab, [Color] tab, and [Display] tab options to change alarm message's number of display characters, text color, background color, font, and size. Click [OK].


## ■ Show Text Window


**NOTE**

- Please refer to the Settings Guide for details.
  - ☞ "17.9.2 Common (Text Registration) Settings Guide" (page 17-61)
  - ☞ "19.10.1 Common (Alarm) Settings Guide ■ Alarm (Block 1) Settings Guide" (page 19-85)
  - ☞ "19.10.2 Alarm Parts Settings Guide ■ Show History" (page 19-103)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)

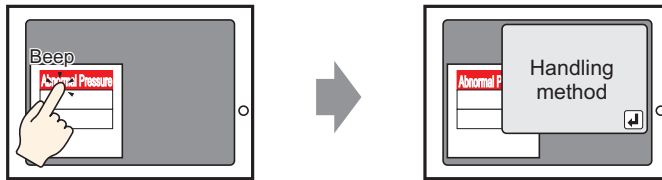


When the alarm message is touched, a Text Window is displayed.


- 1 Create a text window to call a Sub Display. From the [Common Settings (R)] menu, select [Text Registration (T)], or click . The following screen appears.
- 2 Set the Text File Number and Comment (For example, Text File Number "1", Comment "Abnormal Pressure"), and then click [Create].

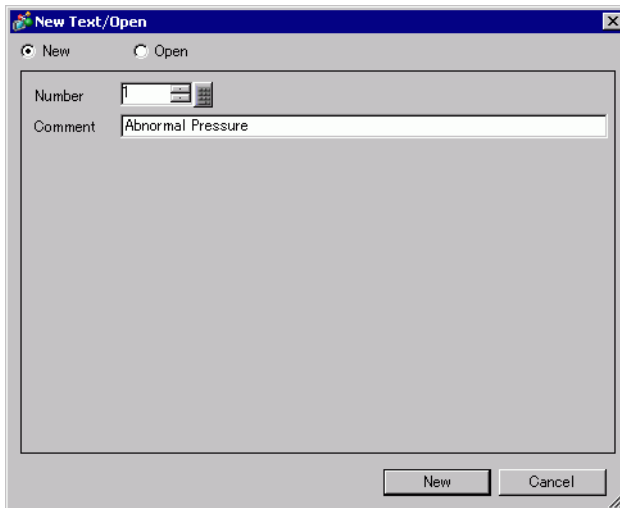


3 Specify [Language], and input the text to be displayed as a Sub Display.

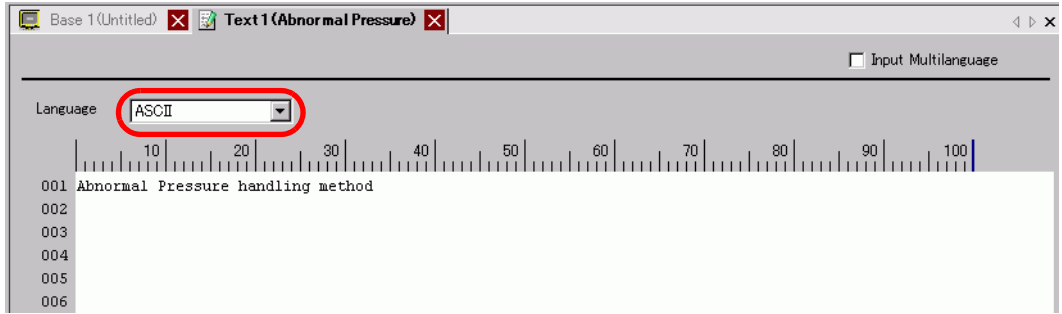


4 Next, register the Message to display when the Alarm is triggered.

From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

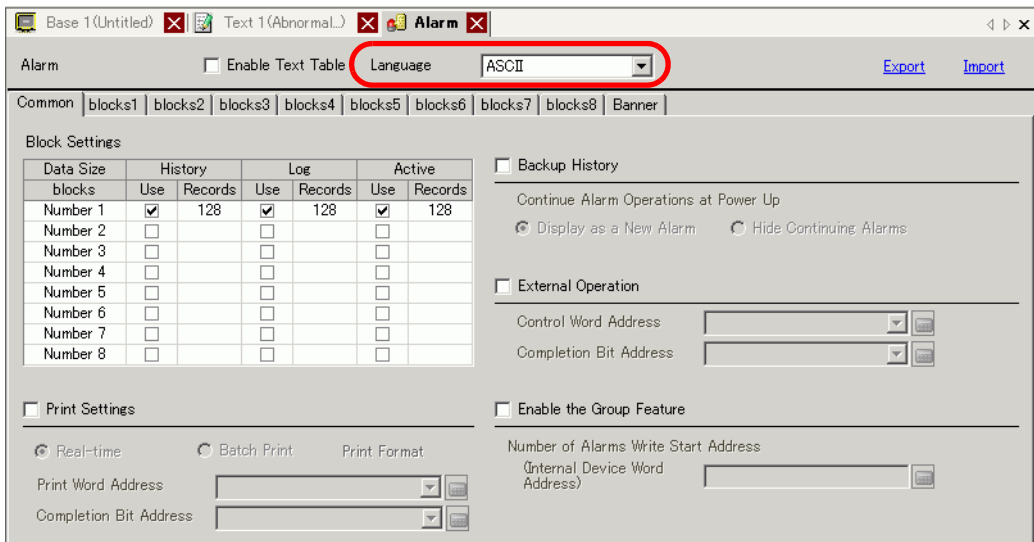

5 In the Block Settings, select the check box for the desired display mode (History/Log/Active) for the block to which the message is registered, and set the number of messages stored as history for each mode.

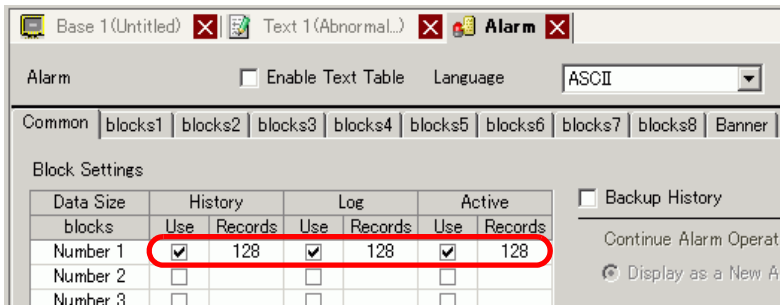


6 Select [Backup History] and define [Hide Continuing Alarms].

**IMPORTANT**

- When the [Backup History] check box is not selected, the alarm history data will be erased when the GP unit is turned OFF or reset.


7 From the [Block1] tab, select [Bit Monitoring].

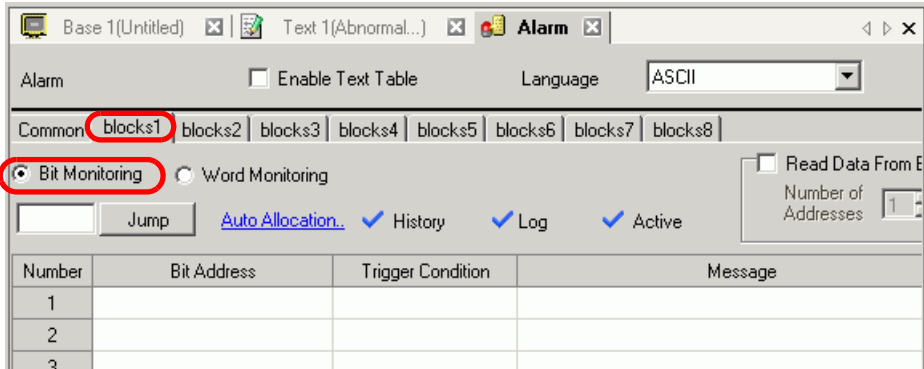


8 In [Bit Address], set the bit address to monitor the alarm trigger. (For example, M1000)

Click the icon to display an address input keypad.

Select device "M", input "1000" as the address, and press the "Ent" key.

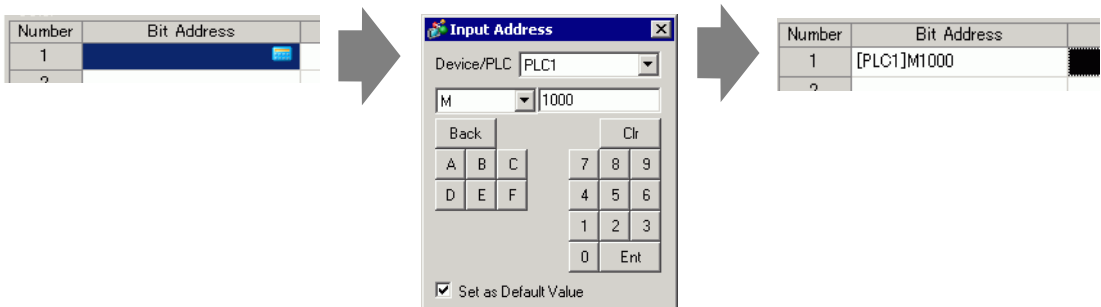


9 Click the [Trigger Condition] cell and select whether the alarm is triggered when the Monitoring Bit Address turns ON or turns OFF.

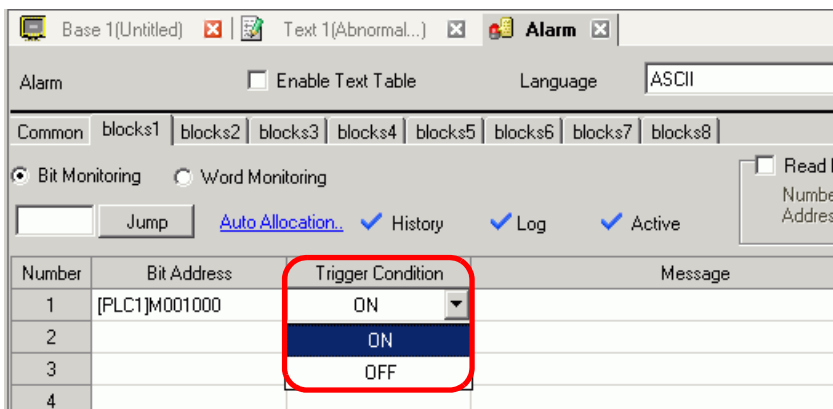


10 In the [Message] cell, input the alarm message that will display when the alarm is triggered.


- NOTE**
- Up to 160 single-byte characters can be registered in a single Alarm Message.
  - When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.
    - ☞ "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)
  - Alarm settings can be exported or imported in CSV format.

11 Set the Text File Number for the Sub Display to display (for example, 1).

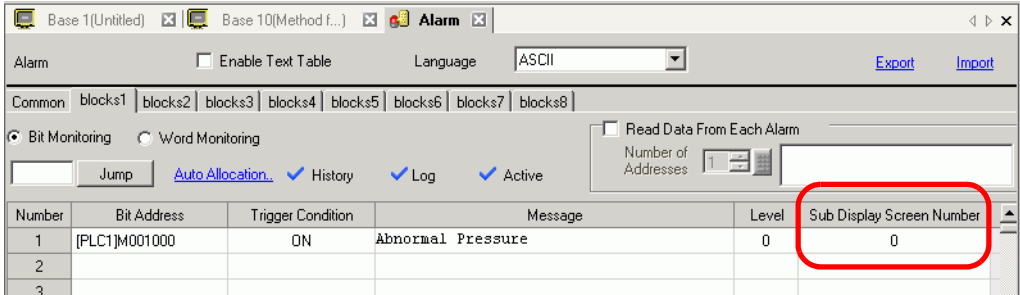


12 Set up the alarm part to display alarms.

Open the screen where you want to display alarms (For example, Base 1), and on the [Parts (P)] menu click [Alarm (A)], or click , then draw the alarm on the screen.

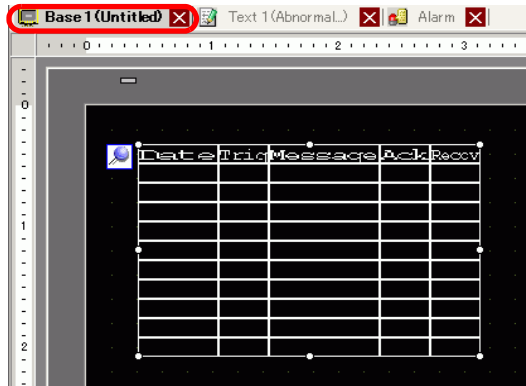


13 Double-click the placed Alarm. The Alarm dialog box appears.

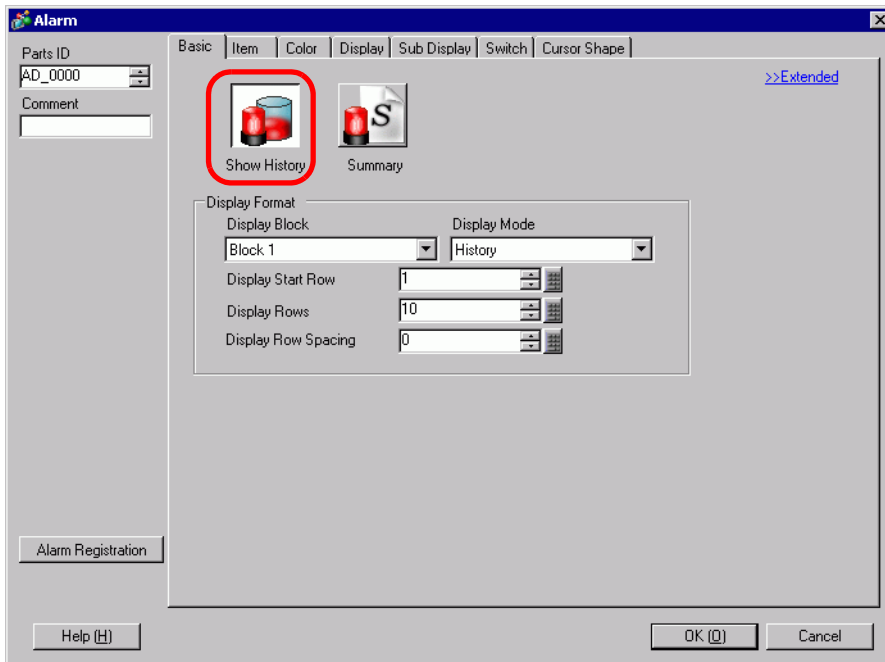


14 Set the block and mode to be displayed for the Alarm.

15 Set the [Display Start Row], [Display Rows] and [Display Row Spacing].

16 Click the [Sub Display] tab, and select the [Enable the Sub Display] box.

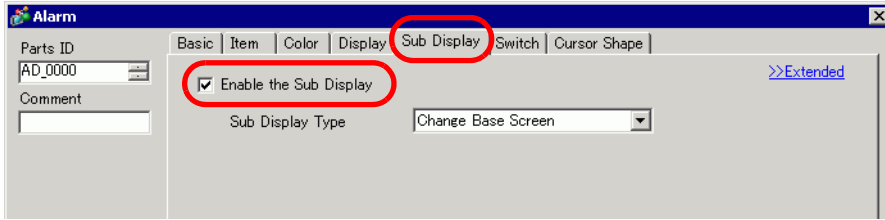

17 In the [Sub Display Type] list, select [Show Text Window].

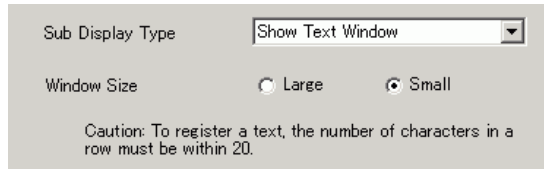

18 In [Window Size], select the size of the Window for the Sub Display.

---


**NOTE**


- For some models, the window may not be fully displayed on the GP when the window size is set to [Big].

☞ "19.11.2 Restrictions for Sub Display/Extended" (page 19-159)

---

19 As needed, use the [Item] tab, [Color] tab, and [Display] tab options to change alarm message's number of display characters, text color, background color, font, and size. Click [OK].

20 The position setting mark  is displayed on the upper left of the Alarm Part. Move the position setting mark to the position where you want to display the text window as a Sub Display. All settings are now complete.

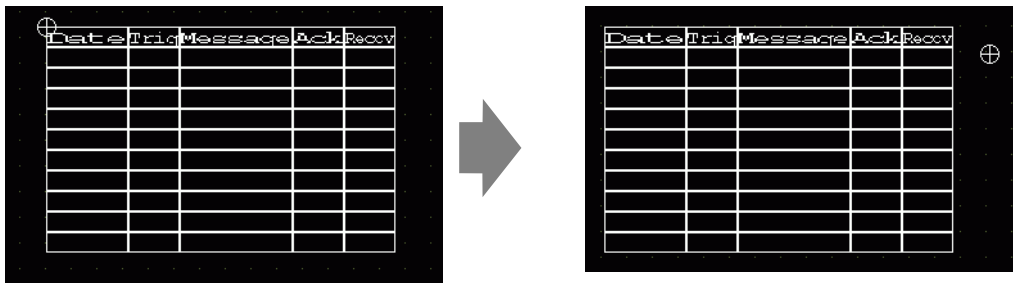


## 19.7 Viewing Alarms by Line


### 19.7.1 Introduction

You can change the Alarms displayed on each screen by registering different Alarm Messages with different production lines.

Display

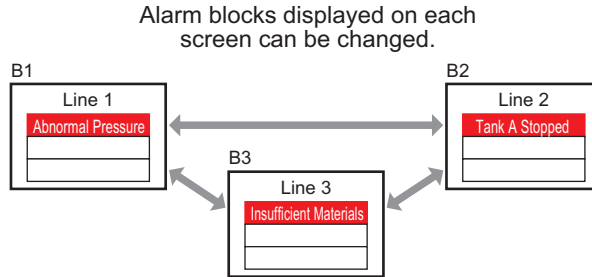

Register

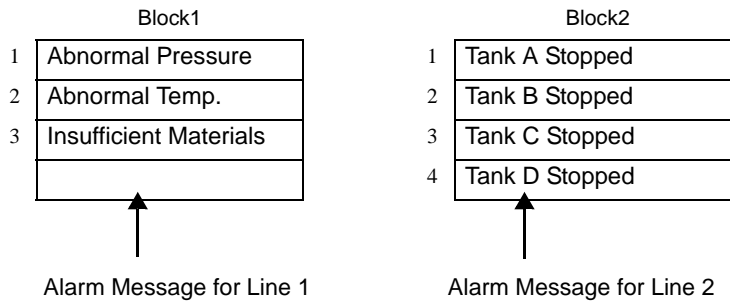




## 19.7.2 Setup Procedure


**NOTE**

- Please refer to the Settings Guide for details.
  - ☞ "19.10.1 Common (Alarm) Settings Guide ■ Alarm Guide" (page 19-70)
  - ☞ "19.10.2 Alarm Parts Settings Guide" (page 19-102)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)


Displays the different blocks' alarm messages on each screen.



- 1 From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

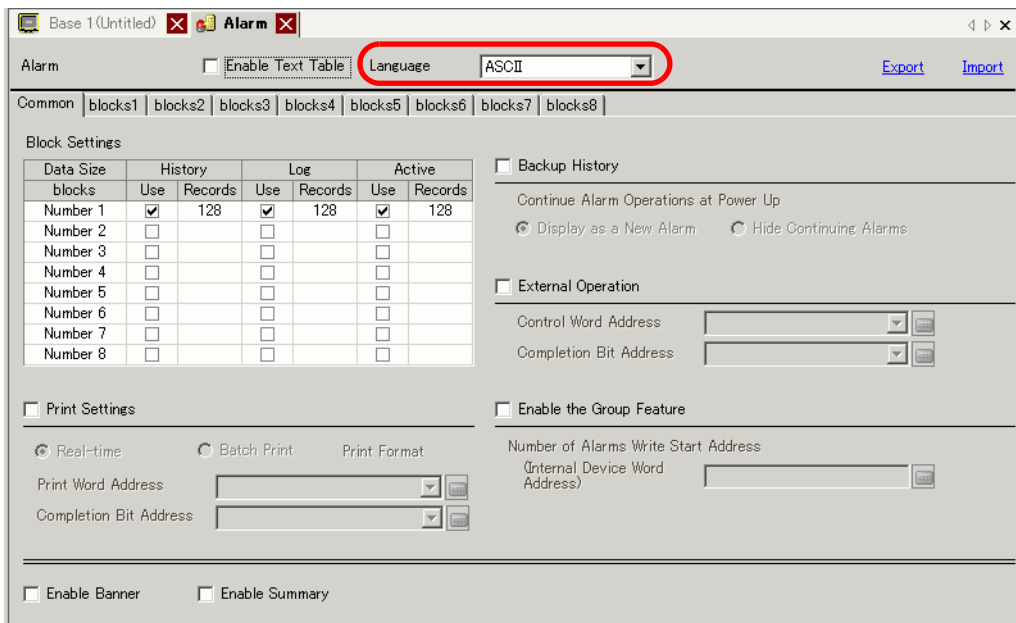

2 In the Block Settings, select the display mode (History/Log/Active) for each of the blocks to which the messages are registered, and set the number of messages stored as history.

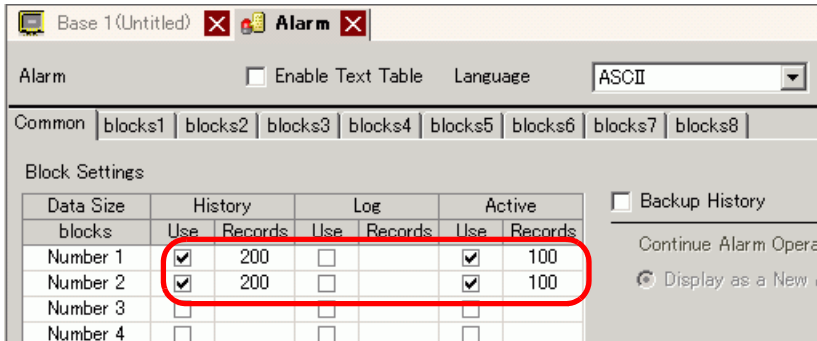


3 Select [Backup History] and define [Hide Continuing Alarms].



**IMPORTANT**

- When the [Backup History] check box is not selected, the alarm history data will be erased when the GP unit is turned OFF or reset.


4 From the [Block1] tab, select [Bit Monitoring].

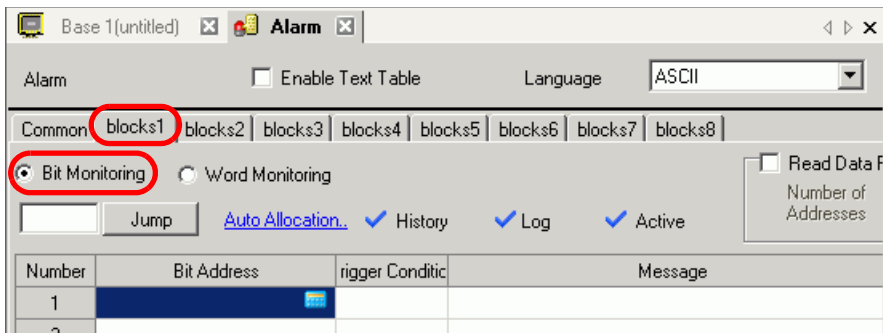


5 In [Bit Address], set the bit address to monitor the alarm trigger. (For example, M1000)

Click to display an address input keypad.


Select device "M", input "1000" as the address, and press the "Ent" key.

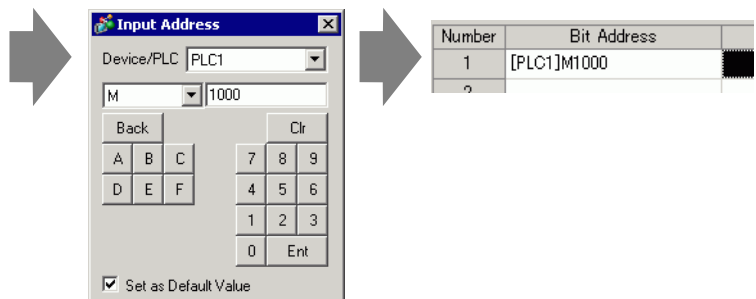

- 6 Click the [Trigger Condition] cell and select whether the alarm is triggered when the Monitoring Bit Address turns ON or turns OFF.

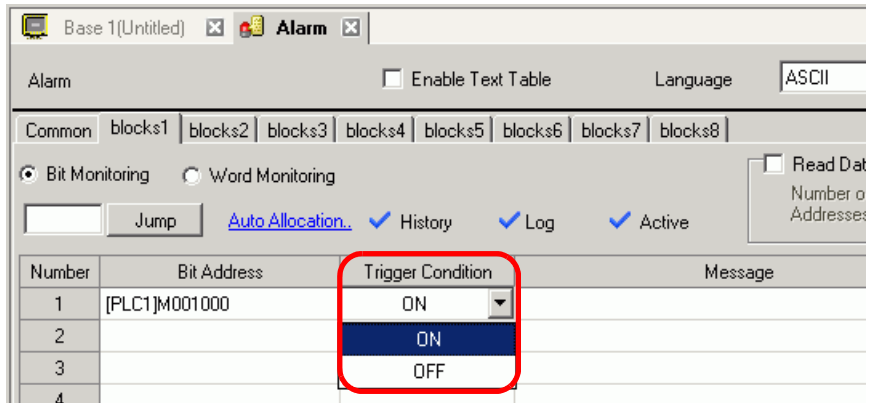


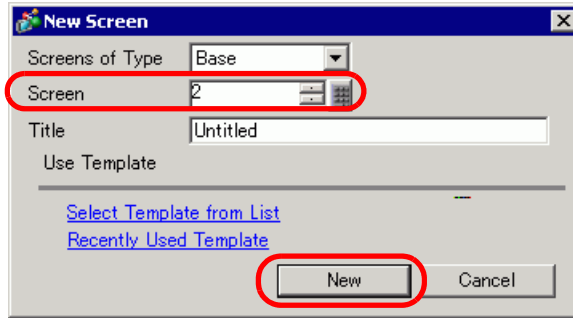
- 7 In [Message], enter the alarm message for the alarm that occurs in production line 1.  
 8 In the same manner, open the [blocks 2] tab and register the Monitoring Bit Addresses and Alarm Messages for Line 2.

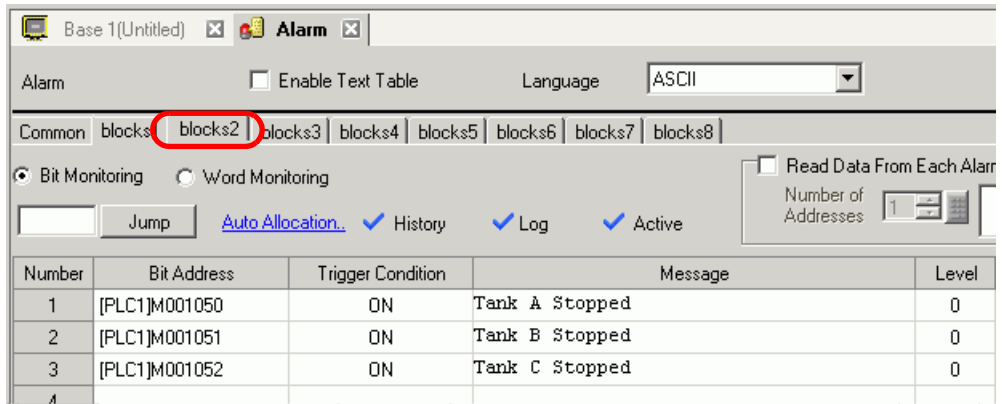
**NOTE**


- Alarm settings can be exported or imported in CSV format.




- 14 In the [Screen (S)] menu, select [New Screen (N)], or click . The [New Screen] dialog box appears. In Screen, set the Base Screen Number (for example, 2), and click [OK].



- 15 In the [Parts (P)] menu, select [Alarm (A)], in the [Base 2] screen or click , and place the Part on the screen.

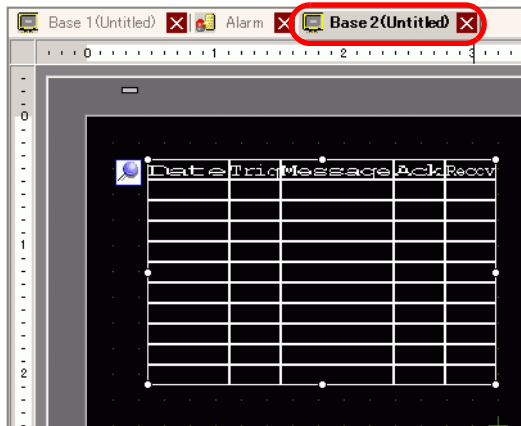

- 16 Double-click the placed Alarm. The Alarm dialog box appears. In [Display Block], specify [Block 2].

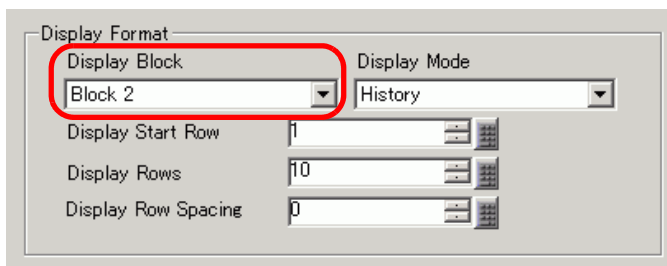

- 17 As needed, use the [Item] tab, [Color] tab, and [Display] tab options to change alarm message's number of display characters, text color, background color, font, and size. Click [OK].


The creation of the screen to display the Alarm Messages of Block 2 is now complete.

## 19.8 Storing Alarm Messages in the CF Card or USB Storage Device

### 19.8.1 Introduction

Saves the alarm history data from the display unit backup SRAM to the CF Card or USB storage.

Saved in CSV format, you can edit the alarm data with any spreadsheet application such as Microsoft Excel.

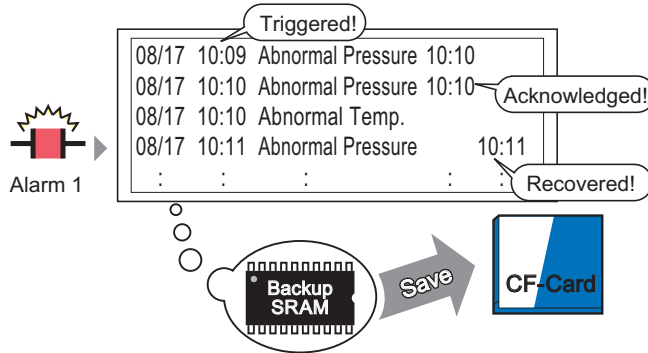

The Alarm History data stored in the backup SRAM is saved to the CF-card.

#### NOTE


- If there is not enough free space on the CF Card, allocate more disk space by moving non-urgent data to USB memory.  
 ☞ "A.5 Transferring Data Between a CF Card and a USB Memory Device" (page A-83)

## 19.8.2 Setup Procedure

**NOTE**


- Please refer to the Settings Guide for details.
  - ☞ "19.10.1 Common (Alarm) Settings Guide ■ Alarm Guide" (page 19-70)
  - ☞ 5.17.6 [System Settings] Setting Guide ■ [Display Unit] Settings Guide ◆ Mode 5-152

The following procedure saves the alarm history data from the display unit backup SRAM to a CF Card as a CSV file. You can also save the data to a USB storage device.

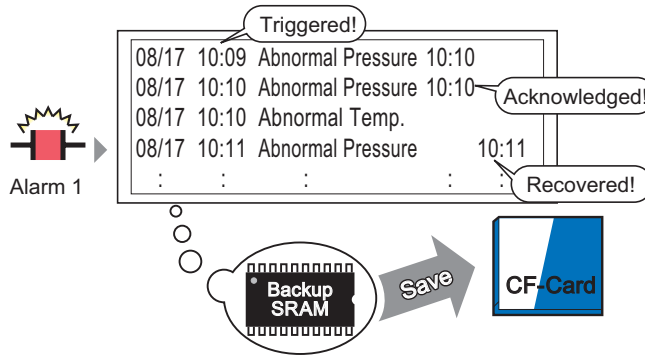

The Alarm History data stored in the backup SRAM is saved to the CF-card.


1 From [System Settings], point to [Display Unit] and open the [Mode] tab.

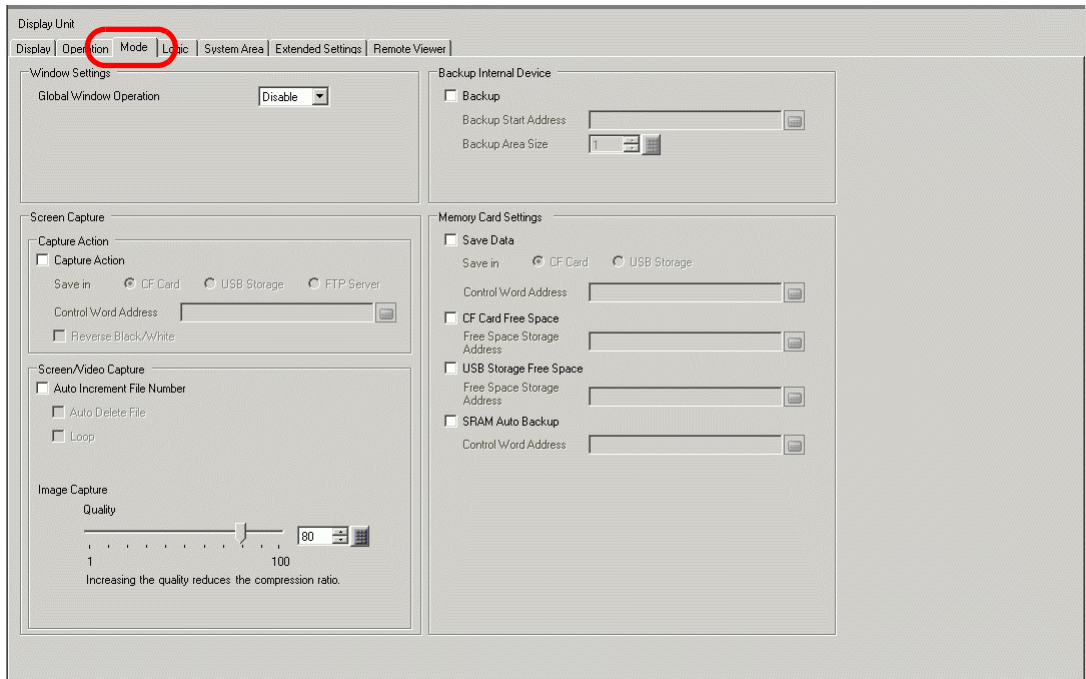


2 In [Memory Card Settings], select [Save Data]. Then select [CF Card].



3 [Control Word Address] controls the writing of data to a CF Card.  
For example, set up D100.

Click  to display an address input keypad.

For the device select "D", and for the address enter "100".

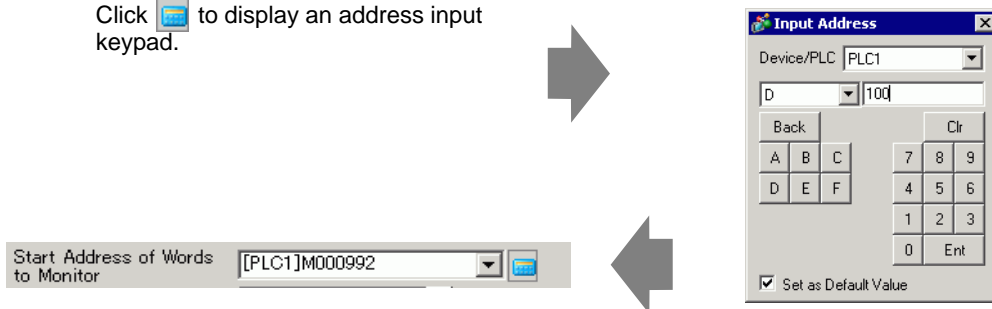

4 The settings for writing Alarm History data to the CF Card are now complete.

**NOTE**

- The CSV storage format is determined by the [Display Mode] setting. The settings are checked in the order of [History], [Log], [Active], and data is output in the format of the first [Display Mode] set [On]. For example, when the data of Block 1 is saved to the CF Card

Data Size		History		Log		Active	
blocks	Use	Records	Use	Records	Use	Records	
Number 1	<input checked="" type="checkbox"/>	100	<input checked="" type="checkbox"/>	100	<input type="checkbox"/>		
Number 2	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>		

In this case, the data is saved in [History] format. If [History] were not set, the data would be saved using [Log] format.

- The latest information is output on the foreground when saved in any Display Mode. The items such as [Trigger Date], [Trigger Time], and [Message] have fixed outputs. If the Language is set to other languages such as ASCII, Korea, Chinese (Simplified), Chinese (Traditional), Cyrillic, Thai, it is shown in English.




### 19.8.3 Structure

This section reviews the structure to write the Alarm History data to a CF Card or USB storage device.

#### ■ Saving to a CF Card or USB Storage

To save data to the CF card, manage the designated control word address as follows:

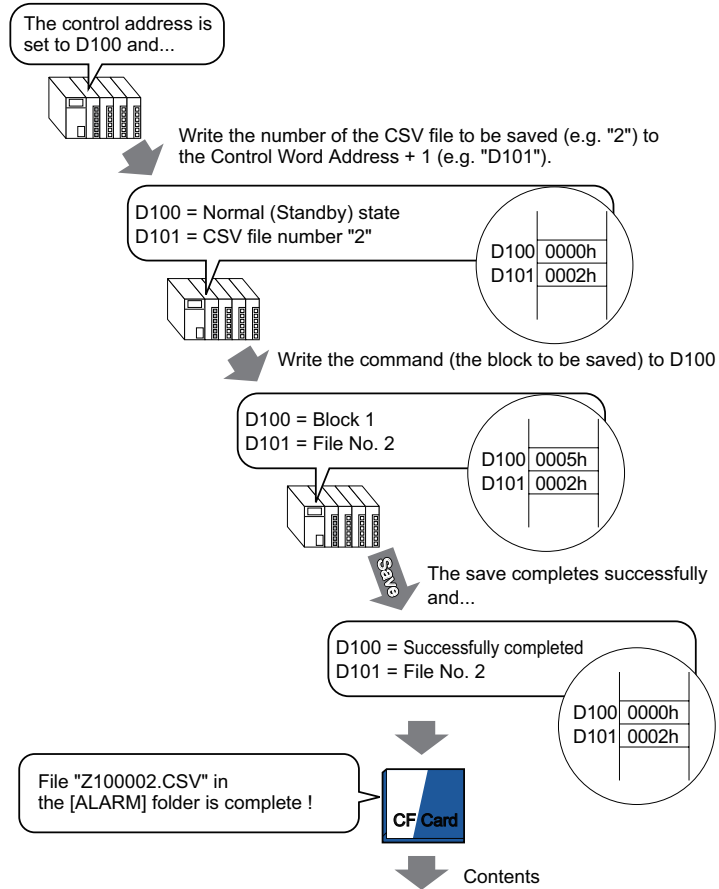

```
"Number of Message(s)","3"," "," "," "," "," "," "
```

```
"Trigger Date","Trigger Time","Message","Acknowledge Time","Recovery Time","Number of occ.,"Acc. Time","Level"
```

```
"05/11/14","10:05:35","B Tank- Abnormal Pressure","10:20:35","11:00:15","1","1:00:00","1"
```

```
"05/11/13","12:15:00","A Tank - Low Water Level","13:20:00","16:15:00","2","3:00:00","0"
```

```
"05/11/13","12:00:10","Pump 1 Closed","14:00:20","16:50:30","1","4:50:20",""
```

When this data is opened in Microsoft Excel

No. of Message(s)	Trigger Date	Trigger Time	Message(s)	Acknowledge Time	Recovery Time	No. of occ.	Acc. Time	Level
3	2005/11/14	10:05:35	B Tank- Abnormal Pressure	10:20:35	11:00:15	1	1:00:00	1
	2005/11/13	12:15:00	A Tank - Low Water Level	13:20:00	16:15:00	2	3:00:00	0
	2005/11/13	12:00:10	Pump No. 1 Closed	14:00:20	16:50:30	1	4:50:20	2

## ■ Control Word Address for Data Save

This address controls writing data. Specify the file number and write the command to the address. The data is saved to the CF Card or USB storage device.

Control Word Address	Command/Status
+1	File Number

## ◆ Command and Status


The data are written to the CF Card or USB Storage device. The processing results (status) are reflected in the address.

Mode	Word Data	Description
Command	0001h	Filing Data
	0002h	GP-PRO/PB III for Windows Logging data (compatible)
	0003h	GP-PRO/PB III for Windows Line Chart data (compatible)
	0004h	GP-PRO/PB III for Windows Sampling data (compatible)
	0005h	Block 1's Alarm History data
	0006h	Block2's Alarm History data
	0007h	Block3's Alarm History data
	0008h	Block4's Alarm History data
	0009h	Block5's Alarm History data
	000ah	Block6's Alarm History data
	000bh	Block7's Alarm History data
	000ch	Block8's Alarm History data
	0020h	GP-PRO/PB III for Windows Logging loop auto-save start (compatible)
	0021h	GP-PRO/PB III for Windows Logging loop auto-save completion (compatible)
Status	0000h	Completed Successfully
	0100h	Write Error
	0200h	The CF Card/USB storage device is not inserted, or the CF Card cover is not closed.
	0300h	No data to be loaded (when no data is specified)
	0400h	File Number Error (File number is outside of range)
	2000h	GP-PRO/PB III for Windows Logging loop auto-save responding correctly (compatible) Control Address becomes this value during the auto-save mode. When the value is changed, the auto-save mode finishes.


◆ **File Name and Location**

Designate a File from 0 to 65,535 in the address following the control word address prior to writing a command.

For example, after writing a command, Alarm History data is saved to the CF Card/USB storage [ALARM] folder with the following file name:

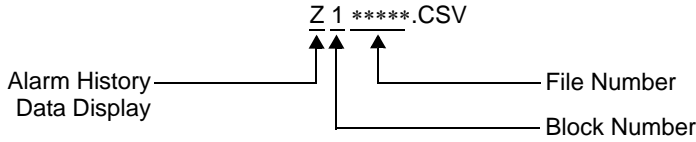

e.g.)



**NOTE** • When the CF Card is reset by the GP unit, a folder is created to save data.

Folder	Data to be saved	File Name
\FILE	Filing Data	F*****.BIN
	Transfer CSV Data	ZR*****.CSV
\LOG	GP-PRO/PB III for Windows Logging data (compatible)	ZL*****.CSV
\DATA	Image Screen	I*****.BIN
	Sound Data	O*****.BIN
\CAPTURE	Screen Capture Video Capture	CP*****.JPG
\MOVIE	Movie File	*.SDX
\TREND	GP-PRO/PB III for Windows Line Chart data (compatible)	ZT*****.CSV
	GP-PRO/PB III for Windows Sampling data (compatible)	ZS*****.CSV
\ALARM	Block 1's Alarm History data	Z1*****.CSV
	Block2's Alarm History data	Z2*****.CSV
	Block3's Alarm History data	Z3*****.CSV
	Block4's Alarm History data	Z4*****.CSV
	Block5's Alarm History data	Z5*****.CSV
	Block6's Alarm History data	Z6*****.CSV
	Block7's Alarm History data	Z7*****.CSV
	Block8's Alarm History data	Z8*****.CSV
\SRAM	Backup SRAM data	ZD*****.BIN
\SAMP01	Sampling Group 1's data	SA*****.CSV
.	.	.
.	.	.
.	.	.
\SAMP64	Sampling Group 64's data	SA*****.CSV

### ■ Caution When Saving to a CF Card or a USB Storage Device

- While data is being written to the CF Card/USB storage, changes to parts and screens may be slower.
- It may take several seconds to write data, depending on the amount.
- After the Status data is read out from the GP, be sure to allow time equal to at least one communication cycle<sup>\*1</sup> or one Display Scan Time<sup>\*2</sup> period, whichever is longer, before the next command can be written.
- Do not call up screens that use the CF Card/USB storage when the CF Card/USB storage is not installed on the GP. It may not work properly.
- If a write error occurs, any file that has not finished loading may remain on the CF Card.
- To overwrite and save the CF Card/USB storage data existing, the CF Card/USB storage must have enough free space to allow the data. If the data is larger than the available space, a write error will occur.
- When data is saved to a CF Card/USB storage device and the target folder does not exist, the [\ALARM] folder is created for saving the data. However, if the CF Card cannot be initialized or the folder cannot be created, a read error will occur.
- The number of times that data can be written on a CF Card is limited. (Approximately 100,000 times for rewriting 500 KB.)
- To format the CF Card/USB storage on your PC, select FAT or FAT32. If you use NTFS for formatting, GP does not recognize the CF Card/USB storage.
- Do not connect more than one USB storage device. If you do so, the USB devices may not be recognized properly.

### ■ Cautions for the Handling of a CF Card

- When ejecting a CF Card, make sure that the CF Card access LED lamp turns OFF. Otherwise, the data on the CF Card may be damaged.
- When accessing a CF Card, be sure not to power OFF or reset the GP, or eject the CF Card. Create an application screen on which the CF Card cannot be accessed, and on that application screen, you may power OFF or reset the GP, open and close the CF Card cover, and eject the CF Card.
- When inserting a CF Card, check the front and back sides and the connector position of the card. If the CF Card is inserted the wrong way, the data, the CF Card, or the GP may be damaged.
- Use a CF Card manufactured by Digital Electronics Corporation. If a CF Card manufactured by another company is used, the contents of the CF Card may be damaged.
- Please make sure to back up all CF Card data.

\*1 The Communication Cycle Time is the time from when the display unit requests data from the device/PLC, until the display unit receives the data. It is stored in the internal device LS2037 as binary data. The unit is 10 milliseconds (ms).

\*2 Display Scan Time is the time required to process one screen. It is stored in the internal device LS2036 as binary data. The unit is in milliseconds (ms).

- Please refrain from doing the following, as it can result in damage to data and equipment:
  - Bending the CF Card
  - Dropping the CF Card
  - Spilling water on the card
  - Touching the CF Card's connectors directly
  - Disassembling or modifying the CF Card


### ■ Cautions for Handling of USB Storage

- While accessing data on a USB storage device, do not reset, insert, or detach the device. The data in the USB storage device may become corrupted. To remove the USB storage device safely, design the system to remove the device only after turning ON system variable #H\_Control\_USBDetachTrigger and after confirming #H\_Status\_USBUsing is OFF.
  - ☞ "A.6.2 HMI system variables (#H system variables) ■ Bit type" (page A-108)
- Please make sure to back up all data on the USB storage device.

## 19.9 Read Data When Alarms Occur


### 19.9.1 Introduction

When the Bit Address to be monitored is turned ON(/OFF), or Alarms are written in the Word Addresses to be monitored, each data value is read in accordance with the Trigger, Acknowledged, and Recovery state of Alarms. By analyzing the data values, you can quickly identify the cause of the Alarm.

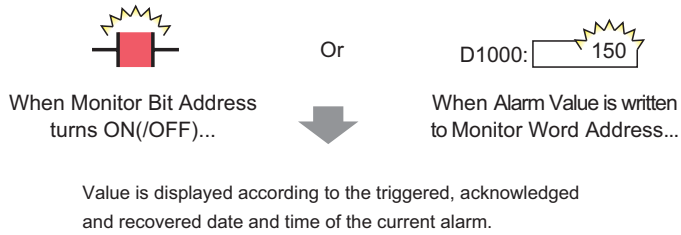


Lists all active Alarms.

[Active]

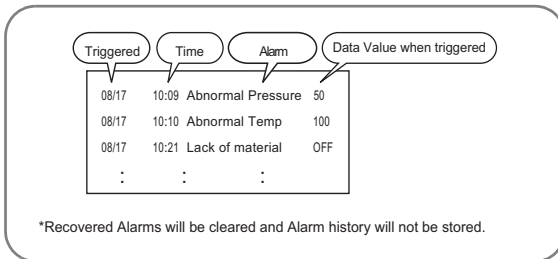


Display Alarms by status: Trigger, Acknowledged, or Recovery.

[Log]

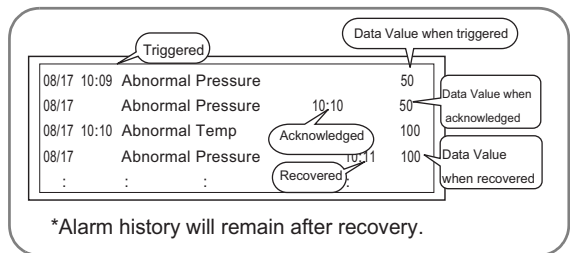

Display Alarms by Trigger, Acknowledged, or Recovery status, on the same row.

[History]

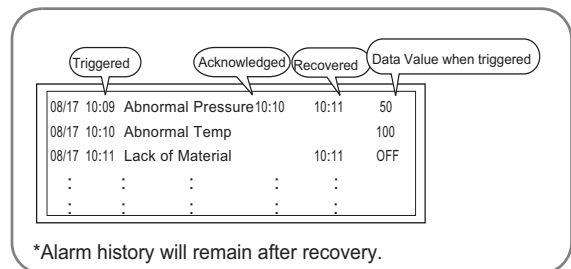


## 19.9.2 Setup Procedure

This section explains the setting procedure, using a Bit Monitoring example.


**NOTE**


- Please refer to the Settings Guide for details.
  - ☞ 19.10.1 Common (Alarm) Settings Guide ■ Alarm (Block 1) Settings Guide ◆ Bit Monitoring 19-85
  - ☞ "19.10.2 Alarm Parts Settings Guide ■ Show History" (page 19-103)
- Refer to Editing Parts for details about placing parts or setting addresses, shapes, colors, and labels.
  - ☞ "8.6.1 Editing Parts" (page 8-44)

When the Monitoring Bit Address turns ON, the Alarms are displayed together with their trigger date/time. When the Monitoring Bit Address turns OFF, the recovery time is added to the same row.

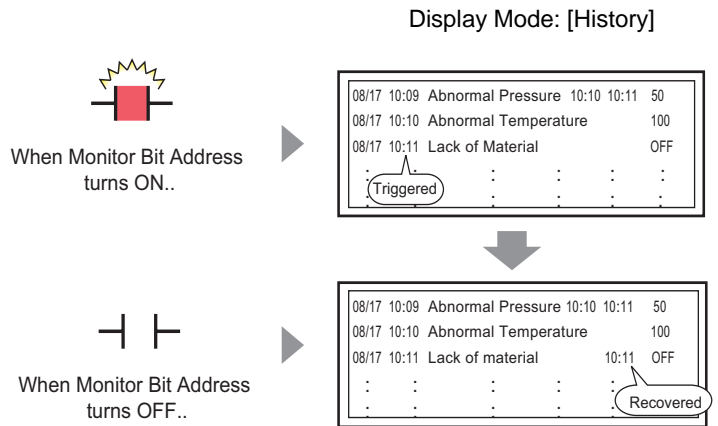

\*Alarm history will be stored after recovery.

1 From the [Common Settings (R)] menu, select [Alarm (A)], or click . The following screen appears. In [Language], select the alarm message display language.

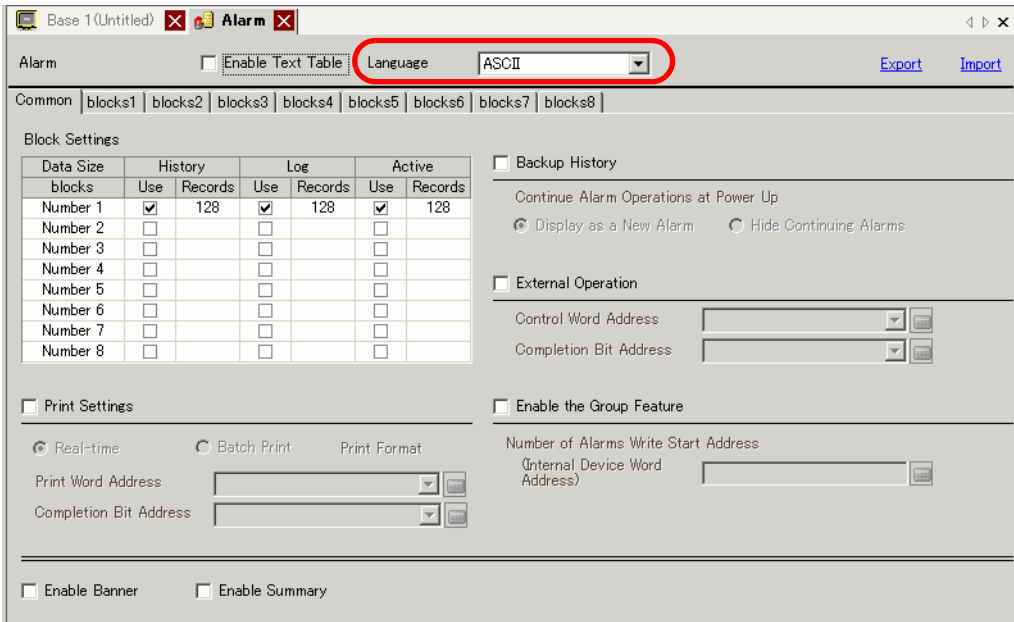


2 In the Block Settings, select the check box for the desired display mode (History/Log/Active) for the block to which the message is registered, and set the number of messages stored as history for each mode.

3 Select [Backup History] and define [Hide Continuing Alarms].

**IMPORTANT**

- When the [Backup History] check box is not selected, the alarm history data will be erased when the GP unit is turned OFF or reset.


4 From the [Block1] tab, select [Bit Monitoring].

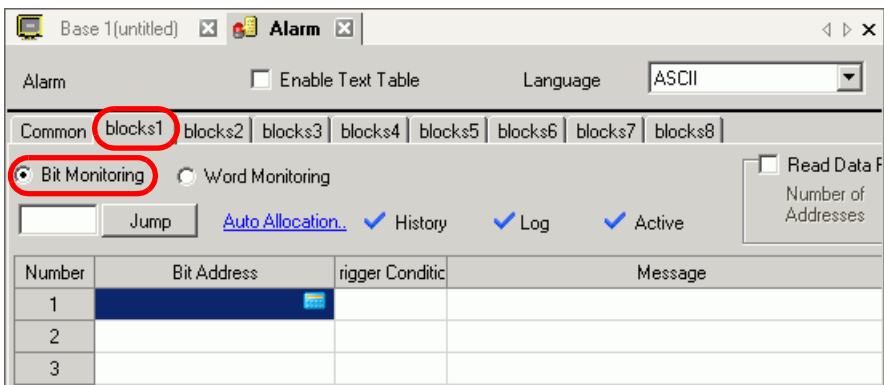





5 In [Bit Address], set the bit address to monitor the alarm trigger (For example, M1000).

Select device "M", input "1000" as the address, and press the "Ent" key.

Click  to display an address input keypad.

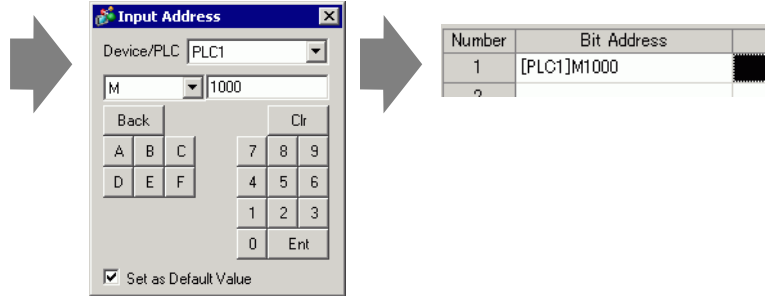

6 In the [Trigger Condition] cell, select whether the alarm is triggered when the Monitoring Bit Address turns ON or turns OFF.

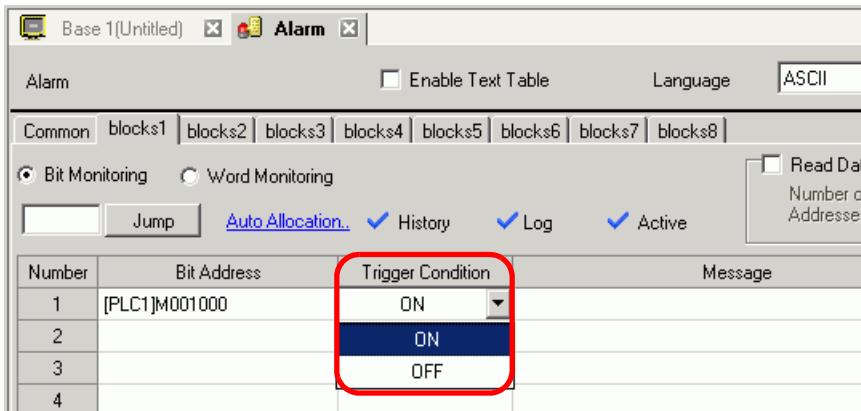

7 In the [Message] cell, input the alarm message that will display when the alarm is triggered.

**NOTE**


- Up to 160 single-byte characters can be registered in a single Alarm Message.
- When the [Enable Text Table] check box is selected, the message language can be switched and displayed even while the system is running.  
☞ "17.4 Changing a Text's Language (Multilanguage)" (page 17-15)


8 Select the [Read Data From Each Alarm] check box, and specify [Number of Addresses] (For example, 3) to read the data values.



**NOTE**


- When the same address is used in triggered alarms, regardless of the message content select the [Use Same Address] check box.  
 The set up address is used for all the messages.


9 Click [Address1] then click . The [Address] dialog box appears.

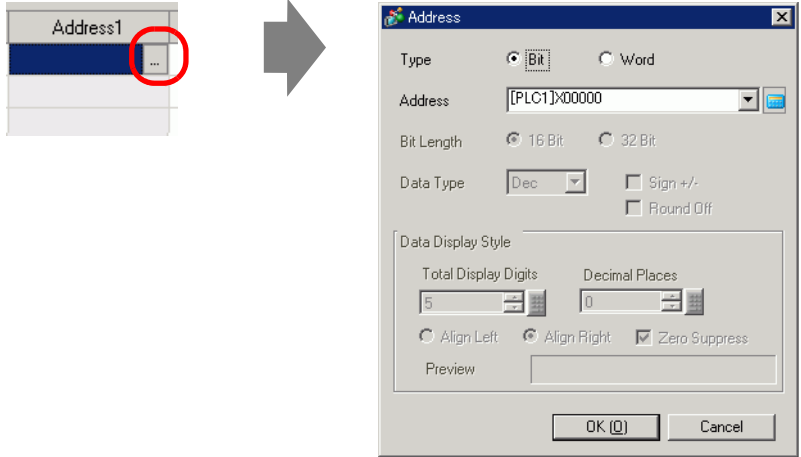

10 Set the addresses to read the data values when Alarms triggered. (For example, Word Address "D1000")

Select the address to device "D", input "1000" and press the "Ent" key.


Click  to display an address input keypad.

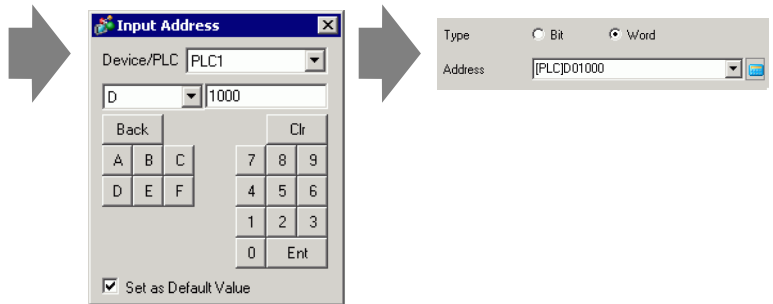


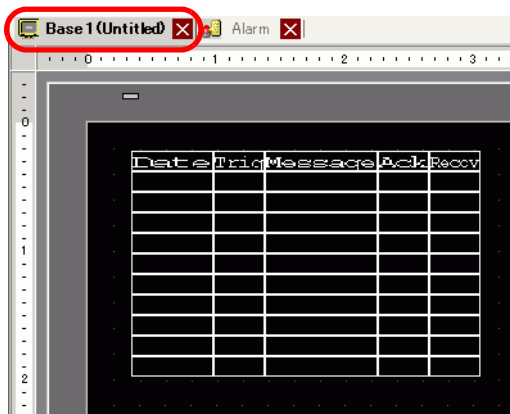
11 Set the value in [Data Display Style], and click [OK].

12 Specify [Bit Length] and [Data Type].  
Alarm settings have been completed.


**NOTE**

- For further information about data read timing, see the following:  
 "19.10.1 Common (Alarm) Settings Guide ◆ Timing for reading data" (page 19-96)
- Alarm settings can be exported or imported in CSV format.

- 13 Open the screen editor and set the Alarm part which will display the Alarm. In the [Parts (P)] menu, select [Alarm (A)], or click  and place the Part on the screen.




- 14 Double-click the placed Alarm. The Alarm dialog box appears.

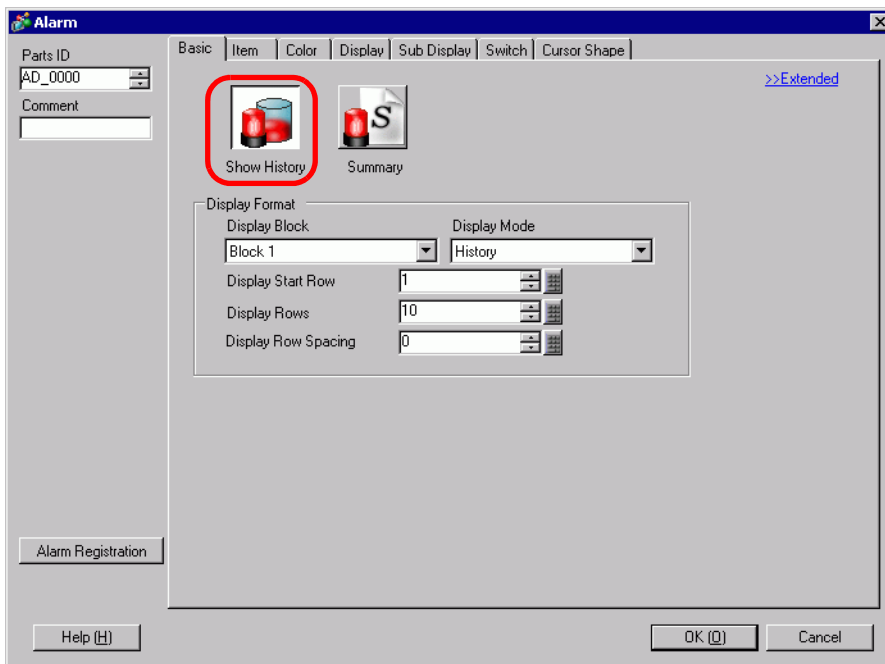

- 15 For the alarm, select the Block and the Mode to display. (For example, Block 1, History)  
 16 Set the [Display Start Row], [Display Rows] and [Display Row Spacing].


17 On the [Item] tab, select the [Address] check box to set [Display Characters]. Select the [Address1], [Address2], and [Address3] check boxes.

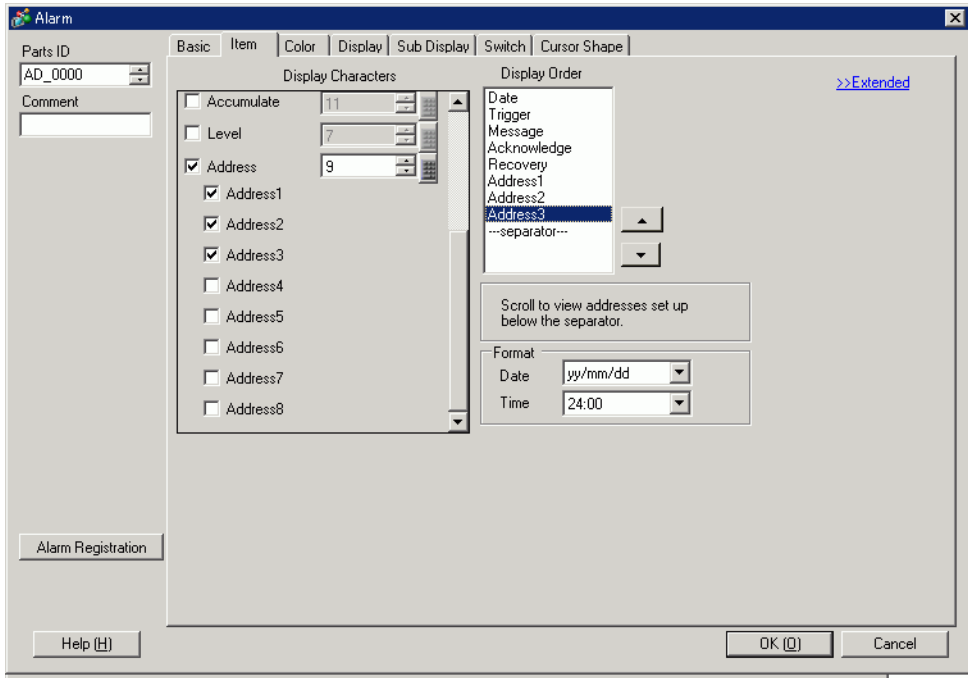

18 As needed, use the [Color] tab, and [Display] tab options to change alarm message's number of display characters, text color, background color, font, and size. Click [OK].

## 19.10 Settings Guide

### 19.10.1 Common (Alarm) Settings Guide

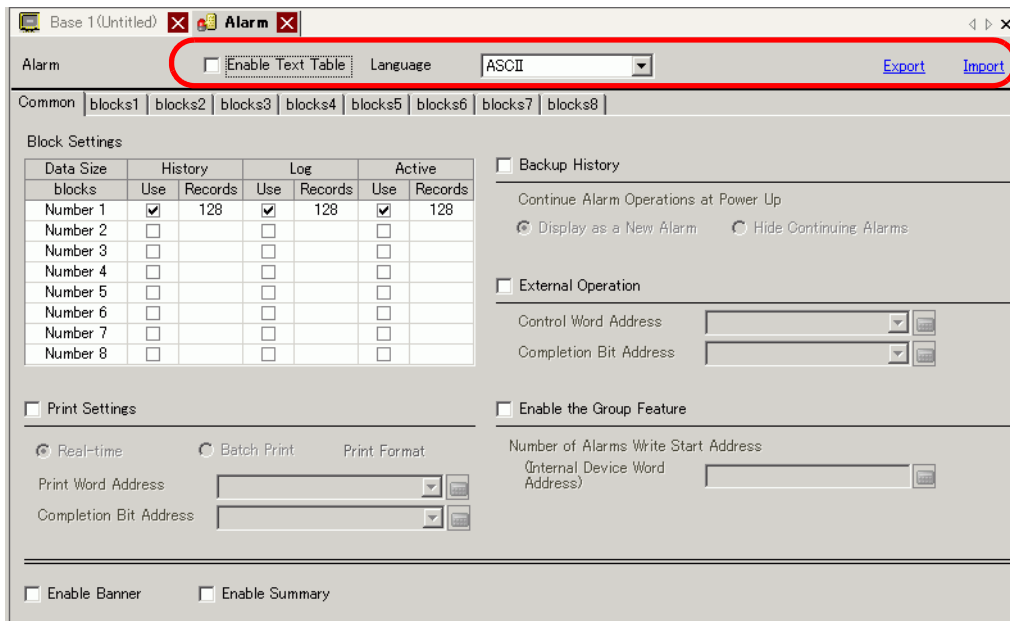


Setting	Description
Enable Text Table	Select this check box to use the text registered in Text Tables as an Alarm Message. The language of alarm messages can be changed while the system is running. 🖱️ "17.9.7 Alarm (Enable Text Table) Settings Guide" (page 17-73)
Language	When entering messages without using the Text Table, select the language of the alarm message as [Japanese], [ASCII], [Chinese (Simplified)], [Chinese (Traditional)], [Korean], [Cyrillic], or [Thai].
Export	Outputs the settings in CSV format.
Import	Load the settings created in CSV format.

**NOTE**

- The setting of the text table or language is common to all alarm settings (History, Banner, Summary). When the selection of [Language Setting] is changed to [Enable Text Table] and vice versa, the messages which have been set are deleted.
- When [Enable Text Table] is selected, the Import and Export features cannot be used.
- The alarm message can be updated on startup or at any timing by reading it from the external memory without transferring the project data.  
 For details on the settings, refer to the following.  
 🖱️ "17.7 Changing Text Table without Data Transmission" (page 17-38)

## ■ Alarm Guide

You can set the block, display mode, and the number of Alarm Histories stored for Alarm Message (History).

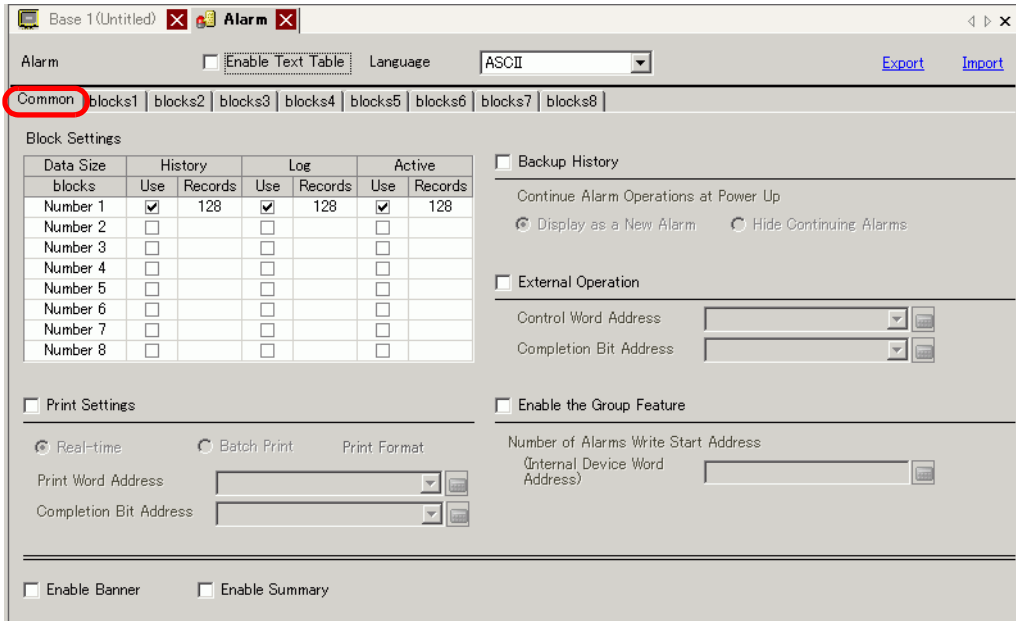


Setting	Description
Block Settings	<p>Set the display mode and the number of Alarm History records (the number of Alarm Histories stored in the display unit) in each mode for each block. A maximum of 768 Alarm Histories can be set.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When IPC Series is selected, the alarm data size sets the Alarm History maximum at 10,000.</li> </ul>
Block	<p>A group of Alarm Messages to be registered. A maximum of 8 blocks can be used.</p>

Continued



Setting		Description																																								
Block Settings	Display Mode	<p>Choose the Alarm Message display method from [History], [Log], or [Active]. Choose [Active] to display only alarms which are currently triggered. To save old alarms choose [History] or [Log].</p>																																								
		<p>[History]</p> <p>Displays Alarm Messages, data, trigger date, and time, in the order they are triggered. The time when the Alarm is acknowledged or recovered will be added to the same row. The change in the state of each Alarm can be viewed on a single row.</p> <table border="1"> <thead> <tr> <th>Date</th> <th>Trigger Time</th> <th>Message</th> <th>Ack Time</th> <th>Recovery Time</th> <th>Address 1</th> </tr> </thead> <tbody> <tr> <td>2003/12/13</td> <td>20:14</td> <td>Conveyor Stopped</td> <td></td> <td></td> <td>OFF</td> </tr> <tr> <td>2003/12/13</td> <td>20:02</td> <td>Hopper Capacity Reduced</td> <td>20:08</td> <td></td> <td>30</td> </tr> <tr> <td>2003/12/13</td> <td>19:30</td> <td>Abnormal Voltage</td> <td>19:40</td> <td>20:00</td> <td>150</td> </tr> </tbody> </table>	Date	Trigger Time	Message	Ack Time	Recovery Time	Address 1	2003/12/13	20:14	Conveyor Stopped			OFF	2003/12/13	20:02	Hopper Capacity Reduced	20:08		30	2003/12/13	19:30	Abnormal Voltage	19:40	20:00	150																
		Date	Trigger Time	Message	Ack Time	Recovery Time	Address 1																																			
		2003/12/13	20:14	Conveyor Stopped			OFF																																			
2003/12/13	20:02	Hopper Capacity Reduced	20:08		30																																					
2003/12/13	19:30	Abnormal Voltage	19:40	20:00	150																																					
<p>[Log]</p> <p>The messages, date/time, and read data are displayed in separate rows every time the state changes from [Trigger], [Acknowledged], to [Recovery]. The date can be viewed in every state.</p> <table border="1"> <thead> <tr> <th>Date</th> <th>Trigger Time</th> <th>Message</th> <th>Ack Time</th> <th>Recovery time</th> <th>Address 1</th> </tr> </thead> <tbody> <tr> <td>2003/12/13</td> <td>20:14</td> <td>Conveyor Stopped</td> <td></td> <td></td> <td>OFF</td> </tr> <tr> <td>2003/12/13</td> <td></td> <td>Hopper Capacity Reduced</td> <td>20:08</td> <td></td> <td>30</td> </tr> <tr> <td>2003/12/13</td> <td>20:02</td> <td>Hopper Capacity Reduced</td> <td></td> <td></td> <td>30</td> </tr> <tr> <td>2003/12/13</td> <td></td> <td>Abnormal Voltage</td> <td></td> <td>20:00</td> <td>100</td> </tr> <tr> <td>2003/12/13</td> <td></td> <td>Abnormal Voltage</td> <td>19:40</td> <td></td> <td>150</td> </tr> <tr> <td>2003/12/13</td> <td>19:30</td> <td>Abnormal Voltage</td> <td></td> <td></td> <td>150</td> </tr> </tbody> </table>	Date	Trigger Time	Message	Ack Time	Recovery time	Address 1	2003/12/13	20:14	Conveyor Stopped			OFF	2003/12/13		Hopper Capacity Reduced	20:08		30	2003/12/13	20:02	Hopper Capacity Reduced			30	2003/12/13		Abnormal Voltage		20:00	100	2003/12/13		Abnormal Voltage	19:40		150	2003/12/13	19:30	Abnormal Voltage			150
Date	Trigger Time	Message	Ack Time	Recovery time	Address 1																																					
2003/12/13	20:14	Conveyor Stopped			OFF																																					
2003/12/13		Hopper Capacity Reduced	20:08		30																																					
2003/12/13	20:02	Hopper Capacity Reduced			30																																					
2003/12/13		Abnormal Voltage		20:00	100																																					
2003/12/13		Abnormal Voltage	19:40		150																																					
2003/12/13	19:30	Abnormal Voltage			150																																					
<p>[Active]</p> <p>Only [Trigger] alarms are displayed. When an alarm recovers, it is automatically erased.</p> <table border="1"> <thead> <tr> <th>Date</th> <th>Trigger Time</th> <th>Message</th> <th>Acknowledge Time</th> </tr> </thead> <tbody> <tr> <td>2003/12/13</td> <td>20:14</td> <td>Conveyor Stopped</td> <td></td> </tr> <tr> <td>2003/12/13</td> <td>20:02</td> <td>Hopper Capacity Reduced</td> <td></td> </tr> <tr> <td>2003/12/13</td> <td>19:30</td> <td>Abnormal Voltage</td> <td>19:40</td> </tr> </tbody> </table>	Date	Trigger Time	Message	Acknowledge Time	2003/12/13	20:14	Conveyor Stopped		2003/12/13	20:02	Hopper Capacity Reduced		2003/12/13	19:30	Abnormal Voltage	19:40																										
Date	Trigger Time	Message	Acknowledge Time																																							
2003/12/13	20:14	Conveyor Stopped																																								
2003/12/13	20:02	Hopper Capacity Reduced																																								
2003/12/13	19:30	Abnormal Voltage	19:40																																							
Use	Select the [Display Mode] to be used. A total of 8 display modes at maximum can be set for the whole Alarm History.																																									
Records	<p>Set the number of Alarm Histories stored for each display mode. Up to 768 Alarm Histories can be set in total. When triggered alarms exceed the specified number, the oldest alarm is deleted.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When IPC Series is selected, the alarm data size sets the Alarm History maximum at 10,000.</li> </ul>																																									

Continued

Setting	Description																																																																																										
<p>Print Format</p> <p>Real-time Print/ Batch Print</p>	<p>Select whether or not to print the Alarm History.   "19.11.1 Restrictions for Printing Alarm History" (page 19-157)</p> <p>Choose the printing timing from [Real-time Print] or [Batch Print].</p> <ul style="list-style-type: none"> <li>• Real-Time Print                      Alarm history is printed every time an alarm is [Triggered], [Acknowledged], and [Recovery].                      The print format is the same as the display format of [Log].                      Even when two or more blocks are used, printing is performed as occasion arises regardless of the block.</li> <li>• Batch Print                      When the bit 0 in [Print Word Address] is turned ON, the whole Alarm Histories stored in the designated block are printed.                      The print format is determined by the [Display Mode] settings.                      The settings are checked in the order of [History], [Log], [Active], and data is printed in the format of the first [Display Mode] set [On].                      For example, when printing block 1</li> </ul> <div data-bbox="522 741 1136 935" style="border: 1px solid gray; padding: 5px; margin: 10px 0;"> <p>Common   blocks1   blocks2   blocks3   blocks4   blocks5   blocks6  </p> <p>Block Settings</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">Data Size</th> <th colspan="2">History</th> <th colspan="2">Log</th> <th colspan="2">Active</th> </tr> <tr> <th>Use</th> <th>Records</th> <th>Use</th> <th>Records</th> <th>Use</th> <th>Records</th> </tr> </thead> <tbody> <tr> <td>Number 1</td> <td style="text-align: center;"><input checked="" type="checkbox"/></td> <td style="text-align: center;">100</td> <td style="text-align: center;"><input checked="" type="checkbox"/></td> <td style="text-align: center;">100</td> <td style="text-align: center;"><input type="checkbox"/></td> <td style="text-align: center;"><input type="checkbox"/></td> </tr> <tr> <td>Number 2</td> <td style="text-align: center;"><input type="checkbox"/></td> <td></td> <td style="text-align: center;"><input type="checkbox"/></td> <td></td> <td style="text-align: center;"><input type="checkbox"/></td> <td style="text-align: center;"><input type="checkbox"/></td> </tr> </tbody> </table> </div> <p>In this case, the block is printed using [History] format. If [History] were not set, the block would be printed using [Log] format.                      A page feed occurs after printing.</p>	Data Size	History		Log		Active		Use	Records	Use	Records	Use	Records	Number 1	<input checked="" type="checkbox"/>	100	<input checked="" type="checkbox"/>	100	<input type="checkbox"/>	<input type="checkbox"/>	Number 2	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>																																																															
Data Size	History		Log		Active																																																																																						
	Use	Records	Use	Records	Use	Records																																																																																					
Number 1	<input checked="" type="checkbox"/>	100	<input checked="" type="checkbox"/>	100	<input type="checkbox"/>	<input type="checkbox"/>																																																																																					
Number 2	<input type="checkbox"/>		<input type="checkbox"/>		<input type="checkbox"/>	<input type="checkbox"/>																																																																																					
<p>Print Word Address</p>	<p>This address controls the printing of the Alarm History. After setting the type of alarm, turn ON the trigger bit (bit 0) to start printing.</p> <div data-bbox="583 1147 1086 1391" style="border: 1px solid black; padding: 10px; margin: 10px 0;"> <table style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 10%;"></td> <td style="width: 10%; text-align: center;">15</td> <td style="width: 10%;"></td> <td style="width: 10%; text-align: center;">0</td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> <td style="width: 10%;"></td> </tr> <tr> <td style="text-align: right;">+0</td> <td colspan="2" style="border: 1px solid black; text-align: center;">Reserved (0)</td> <td style="border: 1px solid black; text-align: center;">Trigger bit</td> <td colspan="6"></td> </tr> <tr> <td style="text-align: right;">+1</td> <td colspan="2" style="border: 1px solid black; text-align: center;">Alarm type</td> <td style="border: 1px solid black; text-align: center;">0: Do not print</td> <td colspan="6"></td> </tr> <tr> <td></td> <td colspan="2"></td> <td style="border: 1px solid black; text-align: center;">1: Print</td> <td colspan="6"></td> </tr> <tr> <td></td> <td colspan="2"></td> <td style="border: 1px solid black; text-align: center;">0: Block 1 data</td> <td colspan="6"></td> </tr> <tr> <td></td> <td colspan="2"></td> <td style="border: 1px solid black; text-align: center;">1: Block 2 data</td> <td colspan="6"></td> </tr> <tr> <td></td> <td colspan="2"></td> <td style="border: 1px solid black; text-align: center;">:</td> <td colspan="6"></td> </tr> <tr> <td></td> <td colspan="2"></td> <td style="border: 1px solid black; text-align: center;">:</td> <td colspan="6"></td> </tr> <tr> <td></td> <td colspan="2"></td> <td style="border: 1px solid black; text-align: center;">7: Block 8 data</td> <td colspan="6"></td> </tr> </table> </div>		15		0							+0	Reserved (0)		Trigger bit							+1	Alarm type		0: Do not print										1: Print										0: Block 1 data										1: Block 2 data										:										:										7: Block 8 data						
	15		0																																																																																								
+0	Reserved (0)		Trigger bit																																																																																								
+1	Alarm type		0: Do not print																																																																																								
			1: Print																																																																																								
			0: Block 1 data																																																																																								
			1: Block 2 data																																																																																								
			:																																																																																								
			:																																																																																								
			7: Block 8 data																																																																																								
<p>Completion Bit Address</p>	<p>Set the bit address that will tell you when printing has completed. This bit will turn ON when printing finishes.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• After the [Completion Bit] has been confirmed as ON, please turn it OFF again. It is recommended to turn OFF the bit 0 of [Print Word Address] also at this timing.</li> </ul>																																																																																										

Continued

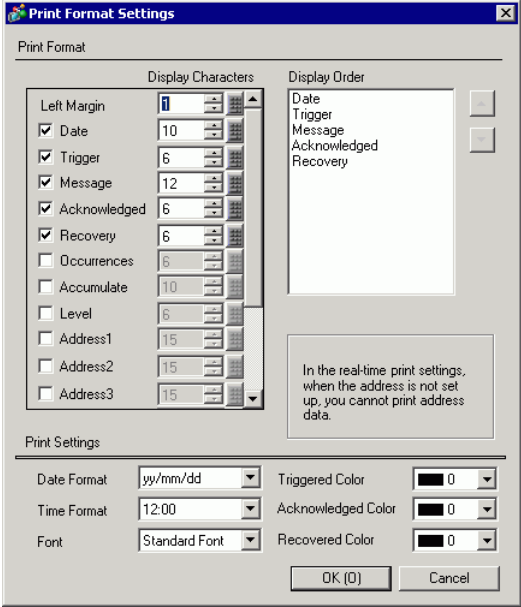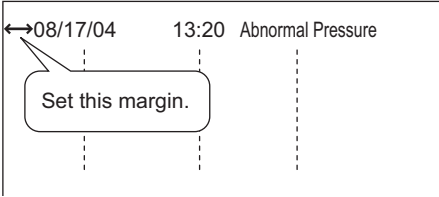

Setting	Description
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">Print Format</p> <p>Print Format Settings</p>	<p>Displays the [Print Format Settings] dialog box.</p> 
<p>Left Margin</p>	<p>Select the spacing between the character of the left-most item and the border from 0 to 100 characters.</p> 

Continued

Setting		Description									
Print Format	Print Format Settings	<p>From [Date], [Trigger], [Message], [Acknowledged], [Recovery], [Occurrence], [Accumulate Time], [Level], and [Address1] to [Address8], specify items to print.</p> <ul style="list-style-type: none"> <li>• <b>Date</b> Prints the date when the alarm was triggered.</li> <li>• <b>Trigger</b> Prints the time when the alarm was triggered.</li> <li>• <b>Message</b> Prints Alarm Message.</li> <li>• <b>Acknowledge</b> Prints the time when the alarm message was confirmed.</li> <li>• <b>Recovery</b> Prints alarm's recovery time.</li> <li>• <b>Occurrences</b> Prints the number of times the alarm was triggered. The maximum count is 65,535.</li> <li>• <b>Elapsed Time</b> Prints the total duration of time when the alarm was in the triggered state. The maximum duration is 9999 hours 59 minutes 59 seconds.</li> <li>• <b>Level</b> Prints the alarm's importance level.</li> <li>• <b>Address1 - Address8</b> Prints data that is retrieved when the alarm is triggered, acknowledged, or recovered.</li> </ul>									
	Display Characters	<p>Set the number of characters displayed for each item. Each item's setting range is as follows.</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="text-align: center;">Date</td> <td style="text-align: center;">5 to 100 or 8 to 100 single-byte characters (The setting range differs depending on the selected date format)</td> </tr> <tr> <td style="text-align: center;">Trigger, Acknowledged, Recovery</td> <td style="text-align: center;">5 to 100 or 8 to 100 single-byte characters (The setting range differs depending on the selected time format)</td> </tr> <tr> <td style="text-align: center;">Message</td> <td style="text-align: center;">1 to 160 single-byte characters</td> </tr> <tr> <td style="text-align: center;">Occurrences, Accumulate Time, Level</td> <td style="text-align: center;">2 to 100 single-byte characters</td> </tr> <tr> <td style="text-align: center;">Addresses 1 to 8</td> <td style="text-align: center;">0 to 100 single-byte characters</td> </tr> </table> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• When you want to provide spaces between the items, set [Total Display Digits] larger than the number of characters that will actually be displayed.</li> </ul>	Date	5 to 100 or 8 to 100 single-byte characters (The setting range differs depending on the selected date format)	Trigger, Acknowledged, Recovery	5 to 100 or 8 to 100 single-byte characters (The setting range differs depending on the selected time format)	Message	1 to 160 single-byte characters	Occurrences, Accumulate Time, Level	2 to 100 single-byte characters	Addresses 1 to 8
Date	5 to 100 or 8 to 100 single-byte characters (The setting range differs depending on the selected date format)										
Trigger, Acknowledged, Recovery	5 to 100 or 8 to 100 single-byte characters (The setting range differs depending on the selected time format)										
Message	1 to 160 single-byte characters										
Occurrences, Accumulate Time, Level	2 to 100 single-byte characters										
Addresses 1 to 8	0 to 100 single-byte characters										

Continued

Setting		Description
Print Format	Display Order	<p>Set the display order of all items. Blocks starting from the top of this list will be printed from left to right.</p>
	Date Format	Choose a print format for the date from [yy/mm/dd], [mm/dd/yy], [dd/mm/yy], and [mm/dd].
	Time Format	Choose a print format for the time from [12:00], [24:00], [12:00:00] or [24:00:00].
	Font	Choose a font type for the Alarm Message from [Standard Font] or [Stroke Font].
	Trigger Color Acknowledged Color Recovery Color	<p>Choose from 8 colors for the Alarm Message's [Trigger], [Acknowledged], and [Recovery] colors. Messages are printed in the specified colors regardless of the GP type.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• When white is selected, messages are printed in black.</li> <li>• When the [Display Mode] is [History] and [Batch Print] is set, the trigger color will be used when printing a triggered alarm, the acknowledge color for an acknowledged alarm, and the recovery color for a recovered alarm. However, when acknowledging a previously recovered alarm, the recovery color will be used for printing.</li> </ul> <p>The color setting is effective for text only. The background color will not be printed.</p>
Backing up History	<p>Select whether or not to backup the Alarm History to the backup SRAM of the GP.</p> <p>☞ " ◆ About Backup SRAM" (page 19-79)</p> <p>When backup is not selected and the GP is turned OFF, all the Alarm Histories displayed before are erased. When the GP is turned ON again, only the alarms triggered at the time and afterward are displayed.</p> <p>■ Do not backup history</p>	

Continued

Setting	Description
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">Backing Up History</p> <p>Alarm Continuous Action at Power ON</p>	<p>Select the display method to use when power is turned ON.</p> <ul style="list-style-type: none"> <li>• <b>Display as a new Alarm</b> The information of the host (PLC) before the GP was turned OFF is not retained. The Alarm Messages that were displayed before the GP was turned OFF are displayed as recovered state after the power is turned ON again. Any continuing alarms are separately displayed as new alarms.</li> <li>• <b>Hide Continuing Alarms</b> The information of the host (PLC) before the GP was turned OFF is retained. The Alarm Messages that were displayed before the GP was turned OFF are continuously displayed when power is turned ON again. If the trigger/recovery state of alarms changes after the GP was turned ON again, the change is displayed.</li> </ul> <p><b>Backup Function Examples</b></p> <p>■ <b>Display as a New Alarm</b></p> <p>■ <b>Hide Continuing Alarms</b></p>
<p>External Operation</p>	<p>Select whether or not to perform [Ack All], [Clear All], [Clear All Number of Occurrences], and [Clear All Accumulated Time] from the host (PLC).</p> <p>☞ "19.11.3 Restrictions for Running External Operations from Multiple Display Units" (page 19-160)</p>

Continued

Setting		Description
External Operation	Control Word Address	<p>Set the address which will control the type of operation performed from the PLC (operation code), and the type of alarm.</p> <div style="display: flex; align-items: center; justify-content: center;"> <div style="margin-right: 20px;"> <p>+0</p> <p>+1</p> </div> <div style="border: 1px solid black; padding: 5px; text-align: center;"> <p>15</p> <hr/> <p>Operation code</p> <hr/> <p>Alarm type</p> <p>0</p> </div> <div style="margin-left: 20px;"> <p>0: No operation 1: Ack All 2: Clear All 3: Clear All No.s of Occurrences 4: Clear All Accumulated Time</p> <p>0: Block 1 data 1: Block 2 data : : 7: Block 8 data</p> </div> </div> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When an external operation is performed, it handles all Alarm Messages in the block (active, history, log). For example, if you perform a [Clear All] on block 1, all Alarm Messages in block 1 (active, history, log) are cleared. The Alarm Messages assigned to active, history, and log within the block are not treated individually. The operation's order is [History], [Log], [Active].</li> </ul>
	Completion Bit Address	Set the address which will monitor the completion of the operation. This bit will turn ON when the operation finishes.
Using Group Feature	Select whether or not to use the Group feature. Set this feature to count the number of times that alarms have been triggered by group number.	

Continued


Setting	Description																						
Using Group Feature  Number of Alarms Write Start Address (Internal Word Address)	<p>(A) Set the start address in the GP internal device to write the number of alarm occurrences.</p> <p>(B) Among the addresses set up in (A), only those with the registered group number are used as the area for the writing frequency of internal device addresses.</p> <p>(C) Each time an alarm occurs, data in the corresponding group number's address (internal device) will be increased by 1.</p> <table border="1" data-bbox="412 537 754 807"> <thead> <tr> <th>Triggered alarm</th> <th>Group No.</th> </tr> </thead> <tbody> <tr><td>Message 1</td><td>0</td></tr> <tr><td>Message 2</td><td>1</td></tr> <tr><td>Message 3</td><td>2</td></tr> <tr><td>Message 4</td><td>0</td></tr> <tr><td>Message 5</td><td>3</td></tr> <tr><td>Message 6</td><td>2</td></tr> <tr><td>Message 7</td><td>1</td></tr> </tbody> </table> <div style="display: flex; align-items: center; margin-top: 10px;"> <div style="border: 1px solid black; padding: 5px; margin-right: 10px;"> <b>A</b>  <table border="1" style="border-collapse: collapse; text-align: center;"> <tr><td style="width: 30px; height: 20px;">2</td></tr> <tr><td style="width: 30px; height: 20px;">2</td></tr> <tr><td style="width: 30px; height: 20px;">1</td></tr> </table> </div> <div style="margin-right: 10px;"> <b>B</b>  <table border="1" style="border-collapse: collapse; text-align: center;"> <tr><td style="width: 30px; height: 20px;">+0 No. of occurrences in Group No. 1</td></tr> <tr><td style="width: 30px; height: 20px;">+1 No. of occurrences in Group No. 2</td></tr> <tr><td style="width: 30px; height: 20px;">+2 No. of occurrences in Group No. 3</td></tr> </table> </div> </div> <p style="margin-top: 10px;"><b>C</b> Group No. 0 will not be counted.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• The largest group number available is 6096. Hence, you can specify a different group number for every alarm message.</li> <li>• Please ensure that the number of groups is within the internal device's area (USR area or LS area). For the LS area, refer to the following.  <span style="font-size: 0.8em;">☞ "A.1.4 LS Area (Direct Access Method)" (page A-8)</span></li> <li>• The alarm frequency gets erased when the GP unit is turned OFF. When backing up the data, please use the internal device's backup feature.  <span style="font-size: 0.8em;">☞ 5.17.6 [System Settings] Setting Guide ■ [Display Unit] Settings Guide ◆ Operation 5-151</span></li> <li>• The alarm occurrence counts from 0 to 65,535. The occurrence count cannot count past 65,535.</li> <li>• When data is written to an internal device which stores alarm frequency or the display unit's power turns OFF, data are clear and not counted properly.</li> <li>• The data format of the alarm frequency is fixed as Bin.</li> <li>• Alarms with group number 0 are not counted.</li> </ul>	Triggered alarm	Group No.	Message 1	0	Message 2	1	Message 3	2	Message 4	0	Message 5	3	Message 6	2	Message 7	1	2	2	1	+0 No. of occurrences in Group No. 1	+1 No. of occurrences in Group No. 2	+2 No. of occurrences in Group No. 3
Triggered alarm	Group No.																						
Message 1	0																						
Message 2	1																						
Message 3	2																						
Message 4	0																						
Message 5	3																						
Message 6	2																						
Message 7	1																						
2																							
2																							
1																							
+0 No. of occurrences in Group No. 1																							
+1 No. of occurrences in Group No. 2																							
+2 No. of occurrences in Group No. 3																							
Enable Banner	Configure Alarm Messages to display as scroll banners. <span style="font-size: 0.8em;">☞ " ■ Alarm (Banner) Settings Guide" (page 19-97)</span>																						
Enable Summary	This setting displays currently active alarms in a list. <span style="font-size: 0.8em;">☞ " ■ Alarm (Summary) Settings Guide" (page 19-100)</span>																						

## ◆ About Backup SRAM

The backup SRAM saves data even when the GP unit's power is OFF.

The backup SRAM's user area is used to save not only the Alarm History data but also the sampling data, internal device backup data, and filing data.

The capacity of the backup SRAM that can be used for Alarm History data depends on the type of GP and the space used by other data.

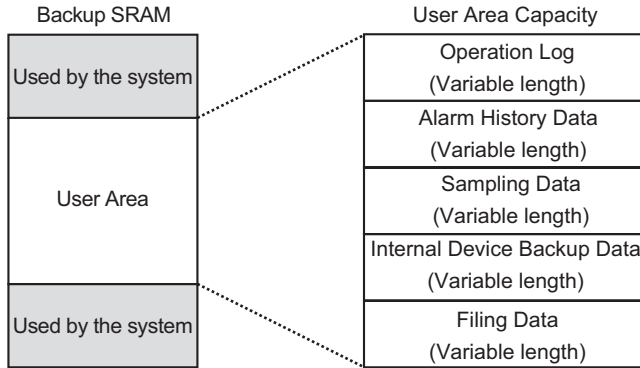

Backup SRAM has the following usage priorities:

- (1) Operation Log
- (2) Alarm History data
- (3) Sampling Data
- (4) Internal device backup data
- (5) Filing data

### IMPORTANT

- The Alarm History data stored in the backup SRAM is erased when:
  - On Screen Transfer
  - Memory is reset (Offline)
  - Backup SRAM is initialized (Offline)

## Space Requirements for Alarm History Data

The space on the backup SRAM required for saving the Alarm History data depends on the number of [Records] of all blocks and the number of registered messages (addresses).

When no message is registered, the data size is 0 bytes, regardless of the [Backup History] setting.

### Calculation

- Size of the Alarm History data (all blocks) (Unit: byte)

$$\begin{aligned}
 &576 \\
 &+ [\text{Number of records of Block 1} * (28 + 4 + (\text{Number of addresses} + 15)/16 * 4 + \\
 &\text{Number of addresses} * 4)] \\
 &\dots (\text{Apply the same calculation as Block 1 for Blocks 2 to 7}) \\
 &+ [\text{Number of records of Block 8} * (28 + 4 + (\text{Number of addresses} + 15)/16 * 4 + \\
 &\text{Number of addresses} * 4)] \\
 &+ (16 * \text{Number of registered messages}) + (4 * \text{Number of registered messages}) + (4 \\
 &* \text{Number of registered messages})]
 \end{aligned}$$

Calculation Example:

Setting	Description
Setting for Block 1	-
Data Size of Alarms for Block 1	768
Number of Addresses for Block 1	0
Settings for Blocks 2 - 8	None
Number of registered messages	2048
Backup setting	-
Backup History	Enable

Calculation result  $(576) + (768 * (28 / 0)) + (16 * 2048) / (4 * 2048) + (4 * 2048) = 71232$  bytes (approximately 69 KB)

◆ Alarm History Import/Export

Alarm data can be imported/exported using a CSV file.

It can be created and edited in spreadsheet software such as Microsoft Excel.

CSV File Format

In the [Alarm] Window, select [Export]. Alarm information is output in a CSV file. The following screen shows how the data appears when opened in Microsoft Excel:

**NOTE**

- When you create a new Alarm in CSV file format, input the items in the following format.  
Input the item name even if you do not use it. Do not edit or delete the exported item name of the CSV File. An error will occur and you will not be able to import.
- You can import a CSV file exported from GP-Pro/PBIII.

- Header Information

	A	B	C
1	GP-Pro EX		
2	File Type	Alarm Data	
3	File Version	1	0
4			
5	Common Setting		
6			
7	Language	Color Code	
8	ja-JP	2	
9			

- Common Setting: Common Settings

Language Settings: Set the alarm message language with the following text.

ja-JP: Japanese, en-US: ASCII, zh-CN: Chinese(Simplified), zh-

TW: Chinese(Traditional), ko-KR: Korean, ru-ru: Cyrillic, th-TH: Thai

Color Code: Set the alarm message color with the following text:

0: 65536 Colors No blink

6: 256 Colors No blink

1: 32768 Colors 1-speed blink (Reserved)

7: 64 Colors 3-speed blink

2: 16384 Colors 3-speed blink

8: 16 Colors 1-speed blink

4: 4096 Colors 3-speed blink

9: Monochrome 8 Levels 1-speed blink

5: Monochrome 16 Levels 3-speed blink

10: Monochrome 8 Levels No blink



- Block Setting

	A	B	C	D	E	F	G
10	Block Setting						
11	Block No.	History(0:Not Use, 1:Use)	History Records	Log(0:Not Use, 1:Use)	Log Records	Active(0:Not Use, 1:Use)	Active Records
12	Block1	1	128	1	128	1	128
13	Block2	1	76	1	76	1	76
14	Block3	0	0	0	0	0	0
15	Block4	0	0	0	0	0	0
16	Block5	0	0	0	0	0	0
17	Block6	0	0	0	0	0	0
18	Block7	0	0	0	0	0	0
19	Block8	0	0	0	0	0	0
20							

Block No.: Block Number  
 History: History "0: Disable, 1: Enable"  
 History Records: History [Records]  
 Log: Log "0: Disable, 1: Enable"  
 Log Records: Log History [Records]  
 Active: Active "0: Disable, 1: Enable"  
 Active Records: Active History [Records]

	A	B
21	Print Setting(0:Disable, 1:Enable)	1
22	Print Mode(0:Real Time, 1:Batch)	1
23	Print Word Address	[PLC1]D00000
24	Completion Bit Address	[PLC1]X00000
25		
26	Backup History(0:Disable, 1:Enable)	1
27	Continues Action(0:Display as a new Alarm, 1:Hide continuing Alarms)	0
28		
29	External Operation(0:Disable, 1:Enable)	1
30	Control Word Address	[PLC1]D00000
31	Completion Bit Address	[PLC1]X00000
32		
33	Group Feature(0:Disable, 1:Enable)	1
34	No. of Alarms Write Start Address	[#INTERNAL]LS0000
35		
36	Enable Banner(0:Disable, 1:Enable)	1
37	Enable Summary(0:Disable, 1:Enable)	1
38		
39		
40	Blocks Setting	
41	Data Type(0:DEC, 1:HEX, 2:BCD)	0
42	Sign +/- (0: No Sign, 1: Sign)	
43		

Print Setting (0: Disable, 1: Enable) : Print Settings "0: Disable, 1: Enable"  
 Print Mode (0: Real Time, 1: Batch) : Print Mode "0: Real-time, 1: Batch Print"  
 Print Word Address: Print Word Address (Input example, [PLC1] D00100)  
 Completion Bit Address : Completion Bit Address  
 Backup History (0: Disable, 1: Enable):Backup History "0: Disable, 1: Enable"  
 Continues Action (0: Display as a new Alarm, 1: Hide Continuing Alarms)  
 : Continue Alarm Operations at Power Up "0: Display as a New Alarm, 1: Hide Continuing Alarms"  
 External Operation (0: Disable, 1: Enable): External Operation  
 Control Word Address : Control Word Address  
 Completion Bit Address : Completion Bit Address  
 Group Feature (0: Disable, 1: Enable) : Enable the Group Feature "0: Disable, 1: Enable"  
 No. of Alarms Write Start Address : Write start address to indicate the number of alarms  
 Enable Banner (0: Disable, 1: Enable): Enable Banner "0: Disable, 1: Enable"  
 Enable Summary (0: Disable, 1: Enable): Enable Summary "0: Disable, 1: Enable"

• Blocks Setting

	A	B	C	D	E	F	G	H	I	J	K
40	Blocks Setting										
41	Data Type(0:DEC, 1:HEX, 2:BCD)	0									
42	Sign +/- (0: No Sign, 1: Sign)	0									
43											
44	Block1										
45	No. of Address	3									
46	Common Address1(0:Disable, 1:Enable)	1									
47	Common Address2(0:Disable, 1:Enable)	1									
48	Common Address3(0:Disable, 1:Enable)	1									
49	Common Address4(0:Disable, 1:Enable)	0									
50	Common Address5(0:Disable, 1:Enable)	0									
51	Common Address6(0:Disable, 1:Enable)	0									
52	Common Address7(0:Disable, 1:Enable)	0									
53	Common Address8(0:Disable, 1:Enable)	0									
54	Bit Log										
55	No.	Bit Address	Trigger Condition(0:OFF, 1:ON)	Message	Level	Group No.	Sub Display Screen No.	Address1	Bit Count	Data Type	Sign
56		1 [PLC1]D00000		1 Abnormal Temp.		0	0	0			
57	Word Log										
58	No.	Word Address	Trigger Condition(0: Word Address Value)	Bit Count(0:16, 1:32)	Message	Level	Group No.	Sub Display Screen No.			
59		1 [PLC1]D00000	X=0	0	0 Abnormal Pressure		0	0	[PLC1]D00000	0	0
60											
61	Block2										
62											
63	Block3										
64											
65	Block4										
66											
67	Block5										
68											
69	Block6										
70											
71	Block7										
72											
73	Block8										
74											
75											

- Data Type (0: DEC, 1: HEX, 2: BCD) : Data Type (When [Bit Monitoring] is set, the Data Type is "0".) DEC, 1:HEX, 2:BCD"
- Sign +/- (0: No Sign, 1: Sign) : Sign (When [Bit Monitoring] is set, the Sign is "0".) 0:No Sign, 1: Sign"
- Block1~8 : Block Number 1~8 (Input the item name only for the disable block. Input the settings under the block number.
- Number of Address : Number of Address
- Common Address1 to 8 : Common Address "0: Disable, 1: Enable" (Input only when reading data
- Bit Log : Bit Monitoring
- No. : Rung Number (The number is not required to be sequential.
- Bit Address : Bit Address
- Trigger Condition : Trigger Condition
- Message : Message
- Level : Level
- Group No. : Group number
- Sub Display Screen Number : Sub Display Screen Number
- Addresses 1 to 8 : Addresses 1 to 8 (Input the Address value only. Input the following items when setting Word Address.)
- Bit Count : Settings for Bit Length of Address "0:16 Bit, 1:32 Bit"
- Data Type : Data Type "0: DEC, 1:HEX, 2:BCD, 3:FLOAT (You can set [FLOAT] of "3" only when Bit Count (Bit Length) is "1: 32 Bit".)
- Sign: Sign "0: No Sign, 1: Sign"
- Total Display Digits : Total Display Digits "1 to 11: DEC/HEX/ BCD, 1 to 17: FLOAT"

Decimal Places	: Decimal Places (Maximum input range is "Total Display Digits - 1")
Display Position	: Display Position "0: Align Left, 1: Align Right"
Zero Suppress	: Zero Suppress (Set whether "0" is displayed or not when the displayed value has less than the Total Display Digits.) "0:Enable 0, 1: Disable 0"
Round Off	: Round Off (Set only when Data Type is "3: Float".) Disable, 1: Enable"
Word Log	:Word Monitoring
No.	:Rung Number (The number is not required to be sequential.
Word Address	: Word Address
Trigger Condition (X: Word Address Value)	:Trigger Condition Settings (Set X=[Alarm Value]
Bit Count	:Settings for Bit Length of Alarm Value "0:16 Bit, 1:32 Bit"
Message	:Message
Level	:Level
Group No.	:Group number
Sub Display Screen Number	: Sub Display Screen Number
Addresses 1 to 8	: Addresses 1 to 8 (Input the Address value only. Refer to Addresses 1 to 8 of "Bit Log" when setting Word Addresses.

- **Banner Setting: Banner Display**

	A	B	C	D	E	F	G	H	I
67	Banner Setting								
68	Font Type(0:Standard Font; 1:Stroke Font)		Font Size						
69		0:W8,H16							
70	No.	Bit Address	Message	Text Color	Blink	Background Color	Blink	Print At Trigger Time(0:OFF, 1:ON)	Print At Recovery Time(0:OFF, 1:ON)
71		1 [PLC1]X00000	Anknowledge	7		0		1	1
72									
73									
74	Summary Setting								
75	No.	Bit Address	Message	Text Color	Blink	Background Color	Blink		
76		1 [PLC1]X00000	Recovery	7		0			

**Font Type (0:Standard Font, 1:Stroke Font)**

:Font "0:Standard Font, 1:Stroke Font"

**Font Size**

:Font Size (Example of Standard Font:8x16->W:8,H:16, set Stroke Font at 8, 16 or 32.

**No.**

:Rung Number (The number is not required to be sequential.

**Bit Address**

:Bit Address

**Message**

:Message

**Text Color**

:Text Color

**Blink**

:Blink

**Background Color**

:Background Color

**Blink**

:Blink

**Print At Trigger Time (0:OFF, 1:ON):**Print at Trigger Time "0:OFF, 1:ON"

**Print At Recovery Time(0:OFF; 1:ON):**Print at Recovery Time "0:OFF, 1:ON"


- **Summary Setting: Summary Display** (See "Banner Setting" for setting items.


## ■ Alarm (Block 1) Settings Guide

There are two types of Trigger Methods for the Alarm History: [Bit Monitoring] and [Word Monitoring].



### ◆ Bit Monitoring

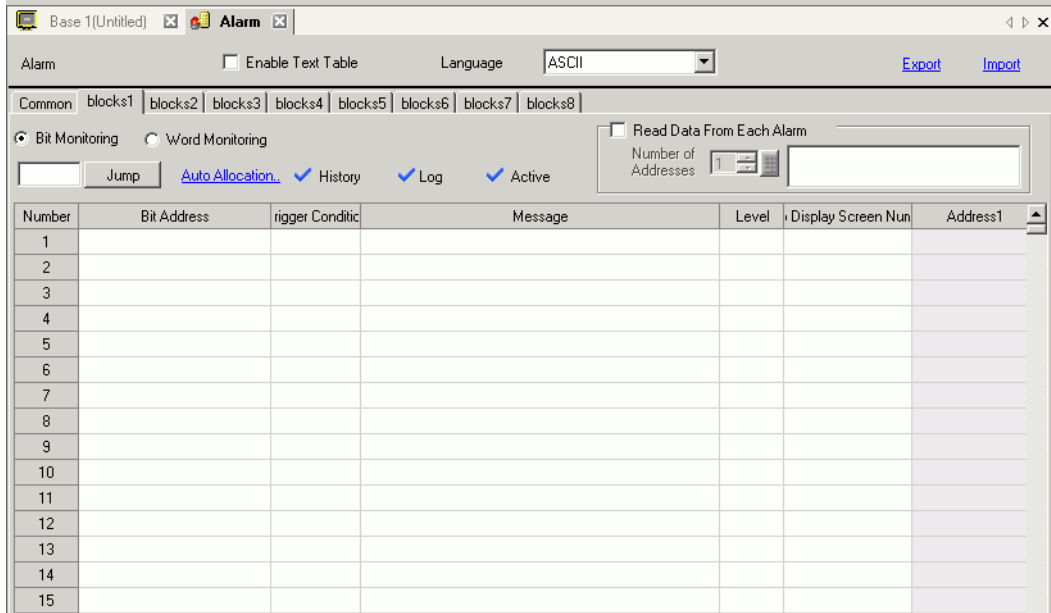Configure settings to trigger the Alarm by monitoring a bit's ON/OFF state.

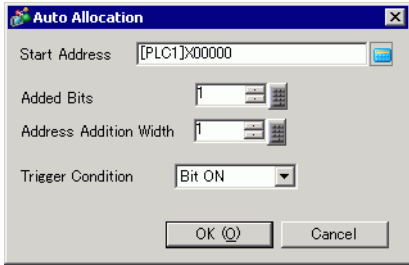





Setting	Description
Bit Monitoring	The alarm is triggered when the monitoring bit address turns ON (OFF).
Jump	Go to a specific row number.
Auto Allocation	<p>The [Address Auto Allocation] dialog box appears. Configure settings to allocate addresses from the [Start Address] by specified increments.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When a previous address exists, it will be overwritten.</li> </ul>
Start Address	Set the Bit Address that will start the Auto Allocation.
Added Bits	Set the number of Bit Addresses (from 1 to Alarm limit - Current row position + 1) for Auto Allocation.
Increase Address By	Set the number of bits to add during an Auto Allocation, from 0 to 4,096.

Continued

Setting	Description
Trigger Condition	Sets up if the alarm is triggered when the monitoring bit address turns ON or when the monitoring bit address turns OFF.
History/Log/Active	Displays current display mode set in the [Common] tab.  " ■ Alarm Guide" (page 19-70)
Read Data From Each Alarm	Specifies whether or not Alarm message data is read. 
Number of Addresses	Read data values from 1 to 8. Adds the [Common Address] setting rows to the set number of addresses. The address setting column will be available for input in the Alarm List.
Use Same Address	Sets whether or not address data values are read in all the messages in the block regardless of the Alarm Message. In the address setting column, you cannot set anything from the second row onward.
Number	Displays the Alarm Message registration number (Row Number) from 1 to 2048. <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-bottom: 5px;"><b>NOTE</b></div> <ul style="list-style-type: none"> <li>For Alarm Messages, up to 2,048 Monitor Bits and Monitor Words can be registered but the maximum number of Alarms that can be stored by the GP for the whole Alarm History is 768.</li> <li>When IPC Series is selected, a maximum of 10,000 alarm messages can be registered in the alarm history.</li> </ul>
Bit Address	Set the Bit Address to monitor the alarm trigger. <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-bottom: 5px;"><b>IMPORTANT</b></div> <ul style="list-style-type: none"> <li>Please ensure that the total of [Monitoring Bit Address] and [Monitoring Word Address] for the whole Alarm History (Block 1 to Block 8) are within 256 words.</li> </ul>
Trigger Condition	Sets up if the alarm is triggered when the monitoring bit address turns ON or when the monitoring bit address turns OFF.
Message	Set an alarm message within 160 single-byte characters. <div style="border: 1px solid black; padding: 2px; width: fit-content; margin-bottom: 5px;"><b>NOTE</b></div> <ul style="list-style-type: none"> <li>When [Enable Text Table] is selected, this displays with the text table's number of index characters.</li> </ul>

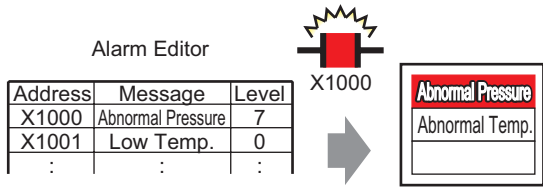Continued

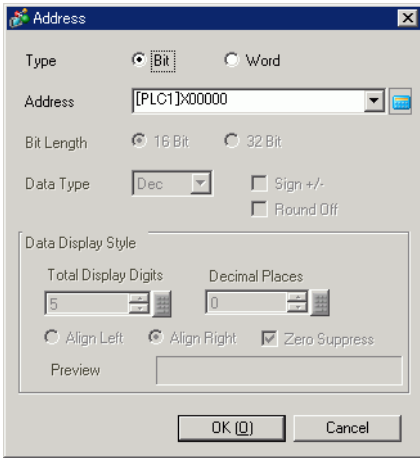Setting	Description												
<p>Level</p>	<p>Each Alarm Message is ranked by importance from 0 (least important) to 7 (most important). The initial setting is "0". The Trigger, Acknowledged, and Recovery colors for each level can be set with the Alarm Part.</p> <div style="text-align: center;">  <p>Alarm Editor</p> <table border="1" data-bbox="422 357 713 454"> <thead> <tr> <th>Address</th> <th>Message</th> <th>Level</th> </tr> </thead> <tbody> <tr> <td>X1000</td> <td>Abnormal Pressure</td> <td>7</td> </tr> <tr> <td>X1001</td> <td>Low Temp.</td> <td>0</td> </tr> <tr> <td>:</td> <td>:</td> <td>:</td> </tr> </tbody> </table> <p>X1000</p> <p>Choose the color and attributes for 8 levels according to each Alarm's content.</p> </div> <p> 19.10.2 Alarm Parts Settings Guide ■ Show History ◆ Color 19-110</p>	Address	Message	Level	X1000	Abnormal Pressure	7	X1001	Low Temp.	0	:	:	:
Address	Message	Level											
X1000	Abnormal Pressure	7											
X1001	Low Temp.	0											
:	:	:											
<p>Group</p>	<p>This item is displayed only when [Enable the Group feature] is selected in the [Common] tab. Set a group number to each alarm message within the range between 0 and 6,096.</p> <p> " ■ Alarm Guide" (page 19-70)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• When the [Group Number] is "0", it will not count.</li> </ul>												
<p>Sub Display Screen Number</p>	<p>When using an Alarm part for a Sub Display, select the desired Base Screen Number from 0 to 9999, or the Text File Number from 0 to 8999. Specify the Index numbers of the play list file for playing movies.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• If no Sub Display is required, enter "0". The initial setting is "0".</li> </ul>												
<p>Addresses 1 to 8</p>	<p>Sets Addresses to read Alarm Message data. The input rows become available for the addresses specified in [Number of Addresses].</p> <div style="text-align: center;">  </div>												
<p>Type</p>	<p>Selects the Address type from [Bit] or [Word].</p>												


Continued









◆ **Word Monitoring**

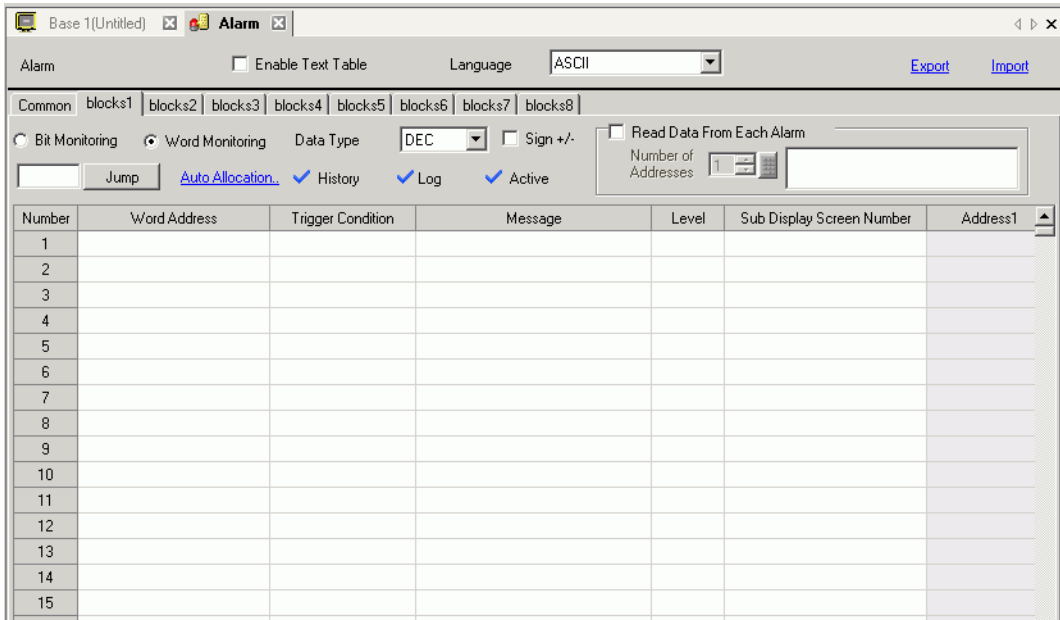Configure settings to trigger the Alarm by monitoring a word data's value.


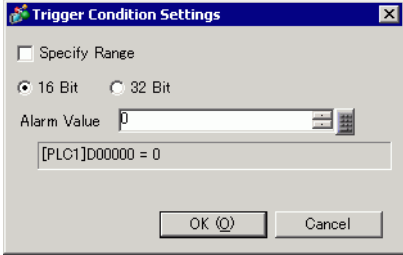


Setting	Description
Word Monitoring	An alarm is triggered when the value of the monitoring word address matches with the specified alarm value, or is within the specified alarm range.
Data Type	Choose the data format of the value stored in [Word Address] from [Dec], [Hex], or [BCD]. <b>NOTE</b> <ul style="list-style-type: none"> <li>When the [Data Type] is changed during editing, the data (alarm value) which cannot be converted into the new [Data Type] will become "0". For example: Dec 10--&gt;Hex 000A Dec 10--&gt;BCD 0 (Cannot be converted, therefore displays zero.)</li> </ul>
Sign +/-	Select this if you will be using negative data for the alarm value. This can only be set when the [Data Type] is [Dec].
Jump	Go to a specific row number.

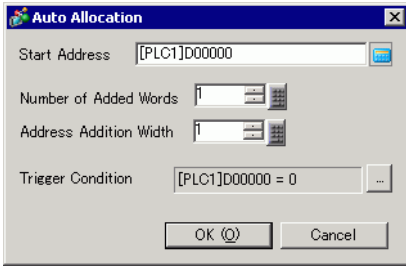
Continued

Setting	Description	
Auto Allocation	<p>The [Address Auto Allocation] dialog box appears. Configure settings to allocate addresses from the [Start Address] by specified increments.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When a previous address exists, it will be overwritten.</li> </ul>	
Auto Allocation	Start Address	Set the Word Address that will start the Auto Allocation.
	Number of Added Words	Set the number of Word Addresses (from 1 to Alarm limit - Current row position + 1) for Auto Allocation.
	Increase Address By	Set the number of Words to add during an Auto Allocation, from 0 to 4,096.
	Trigger Condition	Set the condition that triggers the alarm.  Click the icon to display the [Trigger Condition Settings] dialog box.
History/Log/Active	<p>Displays current display mode set in the [Common] tab.</p> <p> " ■ Alarm Guide" (page 19-70)</p>	
Read Data From Each Alarm	<p>Specifies whether or not Alarm message data is read.</p> 	
Number of Addresses	Read data values from 1 to 8.	Adds the [Common Address] setting rows to the set number of addresses. The address setting column will be available for input in the Alarm List.
Use Same Address	Sets whether or not address data values are read in all the messages in the block regardless of the Alarm Message. In the address setting column, you cannot set anything from the second row onward.	




Continued

Setting	Description																														
Number	<p>Displays the Alarm Message registration number (Row Number) from 1 to 768.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>For Alarm Messages, up to 2,048 Monitor Bits and Monitor Words can be registered but the maximum number of Alarms that can be stored by the GP for the whole Alarm History is 768.</li> <li>When IPC Series is selected, a maximum of 10,000 alarm messages can be registered in the alarm history.</li> </ul>																														
Word Address	<p>Set the Word Address to monitor the alarm's trigger.</p> <p><b>IMPORTANT</b></p> <ul style="list-style-type: none"> <li>Please ensure that the total of [Monitoring Bit Address] and [Monitoring Word Address] for the whole Alarm History (Block 1 to Block 8) are within 256 words.</li> </ul>																														
Trigger Condition	<p>Set the alarm value that will trigger the alarm. In the cell, click  and the [Trigger Condition] dialog box appears.</p> 																														
16 Bit/32 Bit	<p>Choose the alarm value bit length from [16 Bit] or [32 Bit].</p>																														
Alarm Value	<p>Select which range of values stored in the monitoring Word Address will trigger the alarm. The set range varies depending on the [Data Type] and [Sign +/-].</p> <table border="1" data-bbox="401 1199 1254 1508"> <thead> <tr> <th>Bit Length</th> <th>Data Type</th> <th>Sign +/-</th> <th>Setting Range</th> </tr> </thead> <tbody> <tr> <td rowspan="3">16 bit</td> <td rowspan="2">Dec</td> <td>Enable</td> <td>-32768 to 32767</td> </tr> <tr> <td>Disable</td> <td>0 to 65535</td> </tr> <tr> <td>Hex</td> <td></td> <td>0 to FFFF</td> </tr> <tr> <td></td> <td>BCD</td> <td></td> <td>0 to 9999</td> </tr> <tr> <td rowspan="3">32 bit</td> <td rowspan="2">Dec</td> <td>Enable</td> <td>-2147483648 to 2147483647</td> </tr> <tr> <td>Disable</td> <td>0 to 4294967295</td> </tr> <tr> <td>Hex</td> <td></td> <td>0 to FFFFFFFF</td> </tr> <tr> <td></td> <td>BCD</td> <td></td> <td>0 to 99999999</td> </tr> </tbody> </table>	Bit Length	Data Type	Sign +/-	Setting Range	16 bit	Dec	Enable	-32768 to 32767	Disable	0 to 65535	Hex		0 to FFFF		BCD		0 to 9999	32 bit	Dec	Enable	-2147483648 to 2147483647	Disable	0 to 4294967295	Hex		0 to FFFFFFFF		BCD		0 to 99999999
Bit Length	Data Type	Sign +/-	Setting Range																												
16 bit	Dec	Enable	-32768 to 32767																												
		Disable	0 to 65535																												
	Hex		0 to FFFF																												
	BCD		0 to 9999																												
32 bit	Dec	Enable	-2147483648 to 2147483647																												
		Disable	0 to 4294967295																												
	Hex		0 to FFFFFFFF																												
	BCD		0 to 99999999																												


Continued

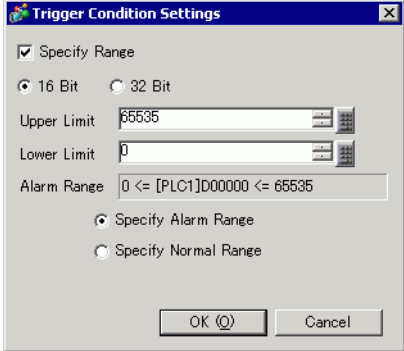Setting		Description																									
Trigger Condition	Area Specification	<p>Select whether or not to set a range for the alarm value. The display will change as follows.</p> 																									
	Upper Limit/ Lower Limit	<p>Select which range of values stored in the monitoring Word Address will trigger the alarm. The set range varies depending on the [Data Type] and [Sign +/-].</p> <table border="1" data-bbox="412 739 1249 1049"> <thead> <tr> <th>Bit Length</th> <th>Data Type</th> <th>Sign +/-</th> <th>Setting Range</th> </tr> </thead> <tbody> <tr> <td rowspan="3">16 bit</td> <td rowspan="2">Dec</td> <td>Enable</td> <td>-32768 to 32767</td> </tr> <tr> <td>Disable</td> <td>0 to 65535</td> </tr> <tr> <td>Hex</td> <td></td> <td>0 to FFFF</td> </tr> <tr> <td rowspan="3">32 bit</td> <td rowspan="2">Dec</td> <td>Enable</td> <td>-2147483648 to 2147483647</td> </tr> <tr> <td>Disable</td> <td>0 to 4294967295</td> </tr> <tr> <td>Hex</td> <td></td> <td>0 to FFFFFFFF</td> </tr> <tr> <td>BCD</td> <td></td> <td>0 to 99999999</td> </tr> </tbody> </table>	Bit Length	Data Type	Sign +/-	Setting Range	16 bit	Dec	Enable	-32768 to 32767	Disable	0 to 65535	Hex		0 to FFFF	32 bit	Dec	Enable	-2147483648 to 2147483647	Disable	0 to 4294967295	Hex		0 to FFFFFFFF	BCD		0 to 99999999
	Bit Length	Data Type	Sign +/-	Setting Range																							
16 bit	Dec	Enable	-32768 to 32767																								
		Disable	0 to 65535																								
	Hex		0 to FFFF																								
32 bit	Dec	Enable	-2147483648 to 2147483647																								
		Disable	0 to 4294967295																								
	Hex		0 to FFFFFFFF																								
BCD		0 to 99999999																									
Alarm Range	The specified alarm range is displayed.																										

Continued

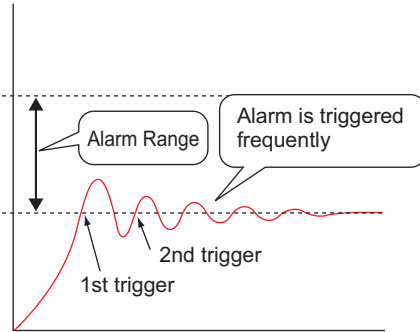Setting		Description															
Trigger Condition	Area Specification	<ul style="list-style-type: none"> <li>Specify Alarm Range Set the alarm range as "Lower Limit &lt;= Address Value &lt;= Upper Limit".</li> <li>Specify Normal Range Set the alarm range as "Lower Limit &gt;= Address Value" or "Address value &gt;= Upper Limit".</li> </ul> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>If the alarm value stored in the [Word Address] fluctuates frequently, the alarm will be triggered often.</li> </ul> <p>E.g.) When <math>50 \leq \text{Alarm Range} \leq 100</math></p> 															
	Specify Alarm Range Specify Normal Range																
Message		<p>Set an alarm message within 160 single-byte characters.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When [Enable Text Table] is selected, this displays with the text table's number of index characters.</li> </ul>															
Level		<p>Each Alarm Message is ranked by importance from 0 (least important) to 7 (most important). The initial setting is "0". The Trigger, Acknowledged, and Recovery colors for each level can be set with the Alarm Part.</p> <div style="text-align: center;"> <p>Alarm Editor</p> <table border="1" style="display: inline-table; margin-right: 20px;"> <thead> <tr> <th>Address</th> <th>Message</th> <th>Level</th> </tr> </thead> <tbody> <tr> <td>X1000</td> <td>Abnormal Pressure</td> <td>7</td> </tr> <tr> <td>X1001</td> <td>Low Temp.</td> <td>0</td> </tr> <tr> <td style="text-align: center;">⋮</td> <td style="text-align: center;">⋮</td> <td style="text-align: center;">⋮</td> </tr> </tbody> </table> <div style="display: inline-block; text-align: center; vertical-align: middle;">  </div> <div style="display: inline-block; text-align: center; vertical-align: middle;">  </div> <table border="1" style="display: inline-table; border-color: red;"> <tr> <td style="background-color: red; color: white; text-align: center;">Abnormal Pressure</td> </tr> <tr> <td style="background-color: white; text-align: center;">Abnormal Temp.</td> </tr> <tr> <td style="background-color: white; height: 20px;"></td> </tr> </table> </div> <p>Choose the color and attributes for 8 levels according to each Alarm's content.</p> <p>👉 19.10.2 Alarm Parts Settings Guide ■ Show History ◆ Color 19-110</p>	Address	Message	Level	X1000	Abnormal Pressure	7	X1001	Low Temp.	0	⋮	⋮	⋮	Abnormal Pressure	Abnormal Temp.	
Address	Message	Level															
X1000	Abnormal Pressure	7															
X1001	Low Temp.	0															
⋮	⋮	⋮															
Abnormal Pressure																	
Abnormal Temp.																	
Group		<p>This item is displayed only when [Enable the Group feature] is selected in the [Common] tab. Set a group number to each alarm message within the range between 0 and 6,096.</p> <p>👉 " ■ Alarm Guide" (page 19-70)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When the [Group Number] is "0", it will not count.</li> </ul>															

Continued

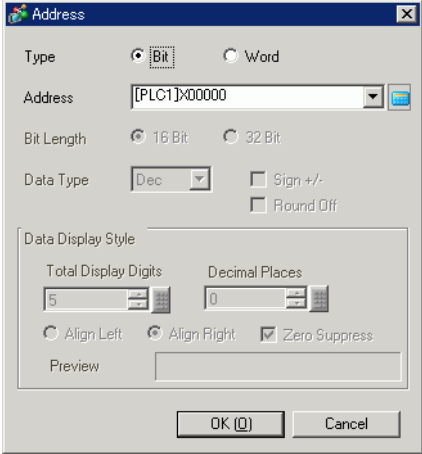
Setting	Description
Sub Display Screen Number	<p>When using an Alarm part for a Sub Display, select the desired Base Screen Number from 0 to 9999, or the Text File Number from 0 to 8999. Specify the Index numbers of the play list file for playing movies.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>If no Sub Display is required, enter "0". The initial setting is "0".</li> </ul>
Addresses 1 to 8	<p>Sets Addresses to read Alarm Message data. The input rows become available for the addresses specified in [Number of Addresses].</p> 
Type	Selects the Address type from [Bit] or [Word].
Address	<p>Sets read data addresses.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>You can set an external device/PLC address, an internal address, a symbol variable, and a system variable for a Bit Address.</li> </ul>
Bit Length	Select [16 Bit] or [32 Bit] for the bit length.
Data Type	<p>Select the data type of the value stored in [Word Address] from [Dec], [Hex], [BCD], and [Float].</p> <ul style="list-style-type: none"> <li>Sign +/- Use for negative numbers. [Data Type] = [Dec] is when this setting is available.</li> <li>Round Off Select whether or not fractional values will be rounded off when data is displayed. Fractional values will be discarded if rounding off is not selected. [Data Type] = [Float] is when this setting is available.</li> </ul>

Continued

Setting		Description																													
Addresses 1 to 8	Data Display Style	<ul style="list-style-type: none"> <li> <b>Total Display Digits, Decimal Places</b>                      Specify digits for display values from 1 to 11. When selecting [Float], the range of the digits is from 1 to 17. "Total Display Digits - 1" is the maximum range for the number of digits after the decimal point.                      The setting range differs depending on [Bit Length] and [Data Type].                 </li> </ul>																													
		<table border="1"> <thead> <tr> <th rowspan="2">Bit Length</th> <th rowspan="2">Data Type</th> <th>Total Display Digits</th> <th>Decimal Places</th> </tr> <tr> <th colspan="2">Setting Range</th> </tr> </thead> <tbody> <tr> <td rowspan="3">16 bit</td> <td>Dec</td> <td>1 to 11</td> <td>0 to 10</td> </tr> <tr> <td>Hex</td> <td>1 to 11</td> <td>-</td> </tr> <tr> <td>BCD</td> <td>1 to 11</td> <td>0 to 10</td> </tr> <tr> <td rowspan="4">32 bit</td> <td>Dec</td> <td>1 to 11</td> <td>0 to 10</td> </tr> <tr> <td>Hex</td> <td>1 to 11</td> <td>-</td> </tr> <tr> <td>BCD</td> <td>1 to 11</td> <td>0 to 10</td> </tr> <tr> <td>Float</td> <td>1 to 17</td> <td>0 to 16</td> </tr> </tbody> </table>	Bit Length	Data Type	Total Display Digits	Decimal Places	Setting Range		16 bit	Dec	1 to 11	0 to 10	Hex	1 to 11	-	BCD	1 to 11	0 to 10	32 bit	Dec	1 to 11	0 to 10	Hex	1 to 11	-	BCD	1 to 11	0 to 10	Float	1 to 17	0 to 16
		Bit Length			Data Type	Total Display Digits	Decimal Places																								
			Setting Range																												
		16 bit	Dec	1 to 11	0 to 10																										
			Hex	1 to 11	-																										
			BCD	1 to 11	0 to 10																										
		32 bit	Dec	1 to 11	0 to 10																										
			Hex	1 to 11	-																										
			BCD	1 to 11	0 to 10																										
Float	1 to 17		0 to 16																												
<ul style="list-style-type: none"> <li> <b>Align Left/Align Right</b>                      Select the display position of a value from [Align Left] or [Align Right].                 </li> </ul>																															
<ul style="list-style-type: none"> <li> <b>Zero Suppress</b>                      If this option is selected, leading zeros are not displayed.                      For example, Number of Display Digits = 4                 </li> </ul>																															
<div style="display: flex; justify-content: space-around; align-items: flex-start;"> <div style="text-align: center;"> <input checked="" type="checkbox"/> Zero Suppress    <input style="width: 40px;" type="text" value="25"/> <p>Unnecessary zeroes are not displayed</p> </div> <div style="text-align: center;"> <input type="checkbox"/> Zero Suppress    <input style="width: 40px;" type="text" value="0025"/> <p>Leading zeroes are added to correspond to the length of Display Digits</p> </div> </div>																															
<ul style="list-style-type: none"> <li> <b>Preview</b>                      Displays the data image according to the settings.                 </li> </ul>																															

◆ **Timing for reading data**

[Address] column data is entered whenever an alarm is triggered, acknowledged, or recovered.

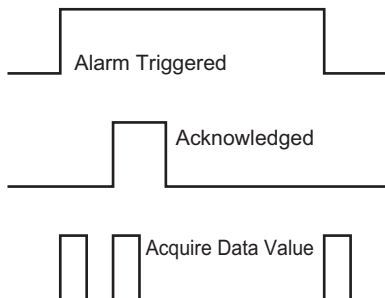

Alarm information is read according to Alarm Parts [Basic] tab [Display Mode] selections.

[History] : Displays data when triggered

Date	Time	Message	Acknowledge	Recovered	Address1
07/07/05	10:10	Abnormal Pressure	10:12	10:13	50
.	.	.	.	.	.
.	.	.	.	.	.
.	.	.	.	.	.

[Log] : Displays data when Triggered, Acknowledged, and Recovered

Date	Time	Message	Acknowledge	Recovered	Address1
07/07/05	10:10	Abnormal Pressure			50
07/07/05		Abnormal Pressure	10:12		50
07/07/05		Abnormal Pressure		10:13	100
.	.	.	.	.	.
.	.	.	.	.	.
.	.	.	.	.	.


[Active] : Displays data when triggered

Date	Time	Message	Address1
07/07/05	10:10	abnormal pressure	50
.	.	.	.
.	.	.	.
.	.	.	.




## ■ Alarm (Banner) Settings Guide

Configure Alarm Messages to display as scroll banners.

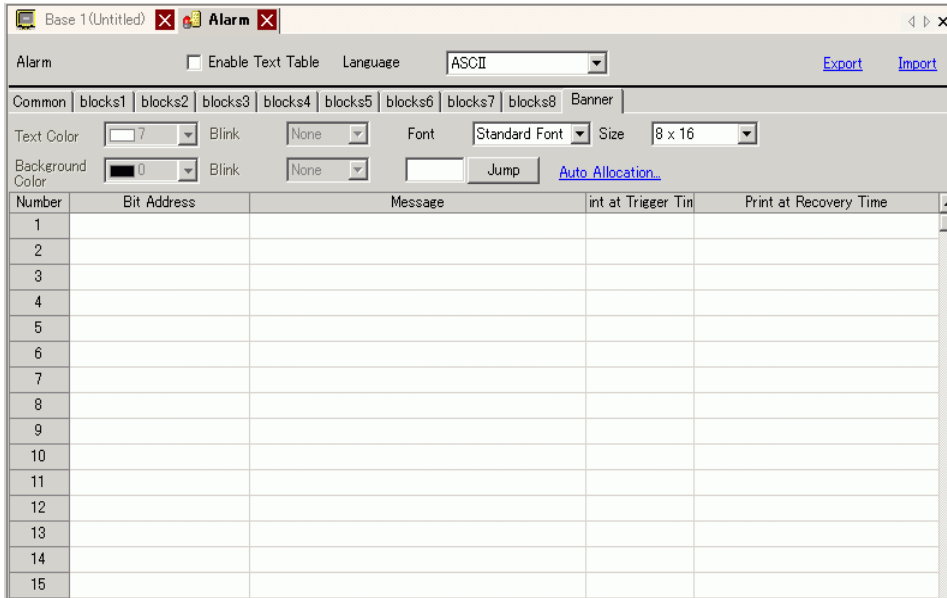

Setting	Description
Text Color	Select a color for the message text.
Background Color	Select a background color for the message text.
Blink	Select the blink and blink speed. You can choose different blink settings for [Text Color] and [Background Color]. <b>NOTE</b> <ul style="list-style-type: none"> <li>There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].                      ☞ "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</li> </ul>
Font	Choose a font type for the Alarm Message from [Standard Font] or [Stroke Font].
Size	Choose a text size for the Alarm Message. Each font type has a different range of styles. Standard Font: [8 x 16], [8 x 32], [8 x 64], [16 x 16], [16 x 32], [16 x 64], [32 x 16], [32 x 32], [32 x 64]. Stroke Font: Select from [8], [16] or [32].
Jump	Go to a specific row number.

Continued

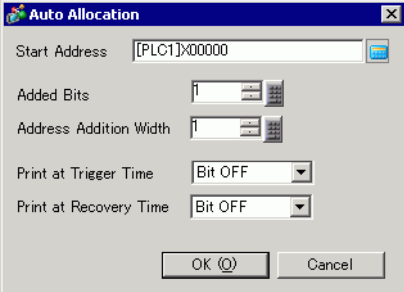
Setting	Description
Auto Allocation	<p>The [Address Auto Allocation] dialog box appears. Configure settings to allocate designated addresses from the starting address.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• When a previous address exists, it will be overwritten.</li> </ul>
Start Address	Set the Bit Address that will start the Auto Allocation.
Added Bits	Set the number of Bit Addresses (from 1 to Alarm limit - Current row position + 1) for Auto Allocation.
Increase Address By	Set the number of bits to add during an Auto Allocation, from 0 to 4,096.
Print Trigger Time	Select whether or not to print the trigger time or recovery time along with the Alarm Message when the alarm is triggered or recovered. Set this to [ON] to print.
Print at Recovery Time	
Number	Displays the Banner Alarm Message registration number (row number) from 1 to 512.
Bit Address	<p>Set the Bit Address to monitor the alarm trigger. When the Monitoring Bit Address turns ON (Trigger), the Alarm Message scrolls. When the Monitoring Bit Address turns OFF (Recovery), the Alarm Message display ends.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• Set the monitoring bits within 128 Words for the whole Alarm Message (Banner).</li> </ul>
Message	<p>Set an alarm message within 160 single-byte characters.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• When [Enable Text Table] is selected, this displays with the text table's number of index characters.</li> </ul>


Continued

Setting	Description																																								
<p>Print at Trigger Time Print at Recovery Time</p>	<p>Select whether or not to print the trigger time or recovery time along with the Alarm Message when the alarm is triggered or recovered. Set this to [ON] to print.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>The print color is limited to black.</li> <li>Printing will use the font designated in the [Banner] tab of [Alarm].</li> <li>When this is set to a language other than Japanese (ASCII, Chinese (Simplified), Korean, Chinese (Traditional), Cyrillic or Thai), it will be output in English.</li> </ul> <div style="display: flex; justify-content: space-around; align-items: flex-start;"> <div style="text-align: center;"> <p>When [Japanese] is set</p> <table border="1" style="border-collapse: collapse; font-family: monospace;"> <tr><td>発報</td><td>10/15</td><td>16:07</td><td>No.1 エラー</td></tr> <tr><td>復旧</td><td>10/15</td><td>16:30</td><td>No.1 エラー</td></tr> <tr><td>発報</td><td>10/21</td><td>11:25</td><td>No.1 エラー</td></tr> <tr><td>発報</td><td>10/21</td><td>11:28</td><td>No.3 エラー</td></tr> <tr><td>復旧</td><td>10/21</td><td>15:45</td><td>No.1 エラー</td></tr> </table> <p>Japanese</p> </div> <div style="text-align: center;"> <p>When [Chinese (Simplified)] is set</p> <table border="1" style="border-collapse: collapse; font-family: monospace;"> <tr><td>WARNING</td><td>10/15</td><td>16:07</td><td>No.1 错误</td></tr> <tr><td>RESTORED</td><td>10/15</td><td>16:30</td><td>No.1 错误</td></tr> <tr><td>WARNING</td><td>10/21</td><td>11:25</td><td>No.1 错误</td></tr> <tr><td>WARNING</td><td>10/21</td><td>11:28</td><td>No.3 错误</td></tr> <tr><td>RESTORED</td><td>10/21</td><td>15:45</td><td>No.1 错误</td></tr> </table> <p>English</p> </div> <div style="text-align: center;"> <p>Selected language</p> </div> </div> <ul style="list-style-type: none"> <li>The GP unit can store printing information for a maximum of 1,000 Alarm Messages (Banner) and Alarm Histories (Real-time Print). If no printer is connected to the GP, it can still store up to 1,000 messages, but any messages over 1,000 will be lost while the GP is waiting to print.</li> <li>If the printer goes offline during printing due to a paper jam or some other reason, fix the printer error without turning off the display unit. Print information stored in the GP will be sent to the printer when it comes back online.</li> <li>If the printer's power goes off during printing, the data sent from the GP during that time will not be printed.</li> </ul>	発報	10/15	16:07	No.1 エラー	復旧	10/15	16:30	No.1 エラー	発報	10/21	11:25	No.1 エラー	発報	10/21	11:28	No.3 エラー	復旧	10/21	15:45	No.1 エラー	WARNING	10/15	16:07	No.1 错误	RESTORED	10/15	16:30	No.1 错误	WARNING	10/21	11:25	No.1 错误	WARNING	10/21	11:28	No.3 错误	RESTORED	10/21	15:45	No.1 错误
発報	10/15	16:07	No.1 エラー																																						
復旧	10/15	16:30	No.1 エラー																																						
発報	10/21	11:25	No.1 エラー																																						
発報	10/21	11:28	No.3 エラー																																						
復旧	10/21	15:45	No.1 エラー																																						
WARNING	10/15	16:07	No.1 错误																																						
RESTORED	10/15	16:30	No.1 错误																																						
WARNING	10/21	11:25	No.1 错误																																						
WARNING	10/21	11:28	No.3 错误																																						
RESTORED	10/21	15:45	No.1 错误																																						

## ■ Alarm (Summary) Settings Guide

Display triggered alarms in a list.

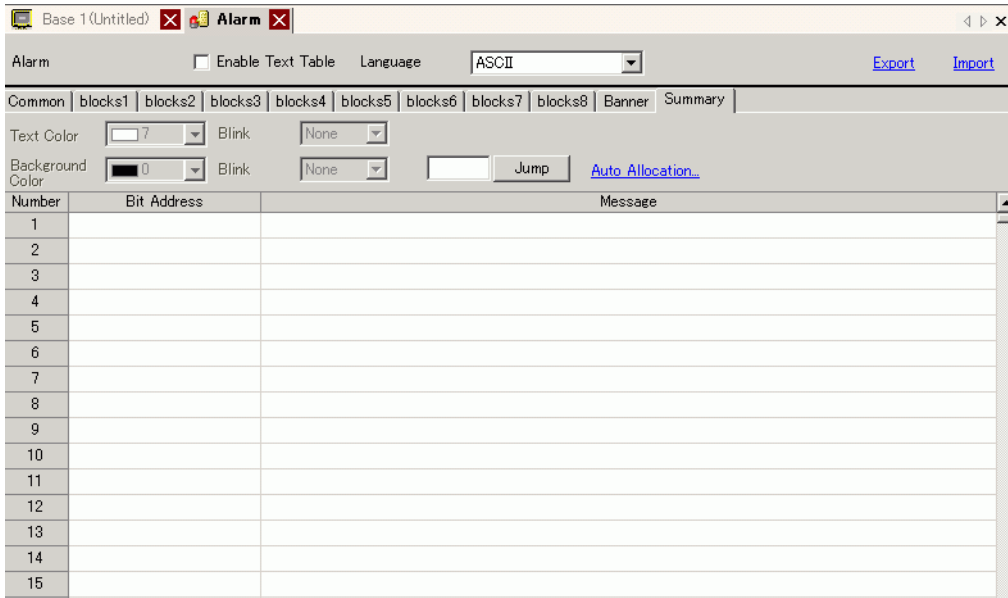

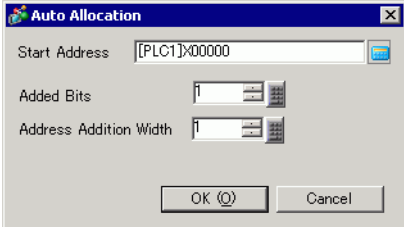
Setting	Description
Text Color	Select a color for the message text.
Background Color	Select a background color for the message text.
Blink	Select the blink and blink speed. You can choose different blink settings for [Text Color] and [Background Color]. <b>NOTE</b> <ul style="list-style-type: none"> <li>There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].                      ☞ "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</li> </ul>
Jump	Go to a specific row number.
Auto Allocation	The [Address Auto Allocation] dialog box appears. Configure settings to allocate addresses from the [Start Address] by specified increments.  <b>NOTE</b> <ul style="list-style-type: none"> <li>When a previous address exists, it will be overwritten.</li> </ul>

Continued

Setting		Description
Auto Allocation	Start Address	Set the Bit Address that will start the Auto Allocation.
	Added Bits	Set the number of Bit Addresses (from 1 to Alarm limit - Current row position + 1) for Auto Allocation.
	Increase Address By	Set the number of bits to add during an Auto Allocation, from 0 to 4,096.
Number		Displays the Alarm Message registration number (Row Number) from 1 to 8999.
Bit Address		<p>Set the Bit Address to monitor the alarm trigger. When the Monitoring Bit Address turns ON, the alarm triggers and the Alarm Message is displayed. When the Monitoring Bit Address turns OFF, the alarm recovers and the Alarm Message is erased.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>For the Monitoring Bit Address, please use a Word-designated Bit device, or a Bit-designated Word device. Please allocate the Monitoring Bit Addresses of the Alarm Messages displayed in a single Alarm Part (Summary) as continuous addresses inside the same device. It cannot be set over different types of devices.</li> </ul>
Message		<p>Set an alarm message within 160 single-byte characters.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When [Enable Text Table] is selected, this displays with the text table's number of index characters.</li> </ul>

## 19.10.2 Alarm Parts Settings Guide

Configure settings for the Part to display the Alarm Messages registered in [Alarm]. There are two types of display methods: [Show History] and [Summary].

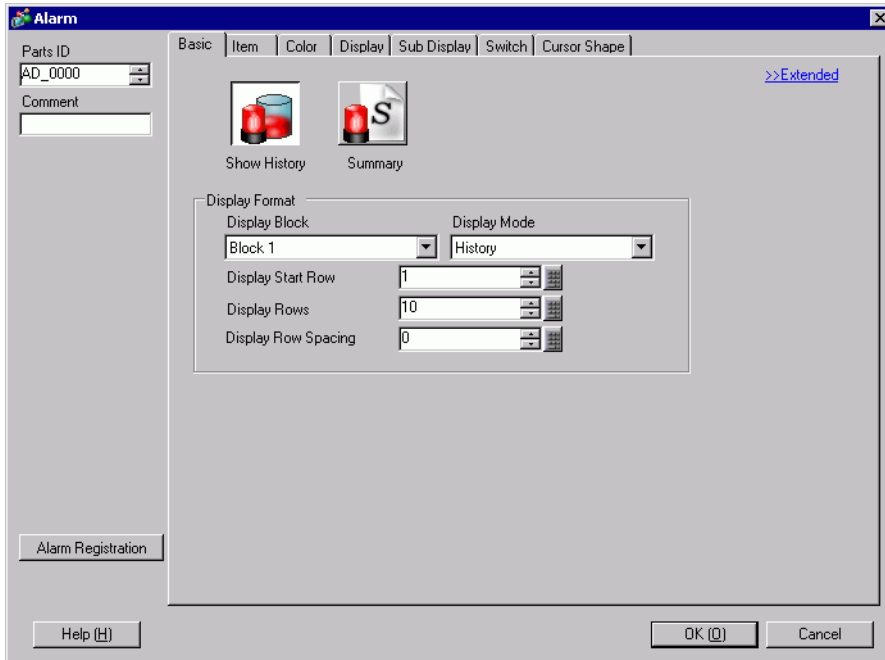


Setting	Description
Part ID	Parts are automatically assigned an ID number. Alarm Part ID: AD_**** (4 digits) The letter portion is fixed. You can change the number portion within the range of 0000-9999.
Comment	The comment for each Part can be up to 20 characters.
Alarm Registration	Changes to Common Settings, [Alarm].
Display Type	Select the Alarm part type. <ul style="list-style-type: none"> <li>• Show History Alarm Messages are displayed in a row in order of when they were triggered. ☞ " ■ Show History" (page 19-103)</li> <li>• Summary Alarm Messages that are currently active are displayed in a list. ☞ " ■ Summary" (page 19-137)</li> </ul>


■ **Show History**

Alarm Messages are displayed in a row in order of when they were triggered.

◆ **Basic Settings/Basic**


Set the display format of the Alarm Messages.

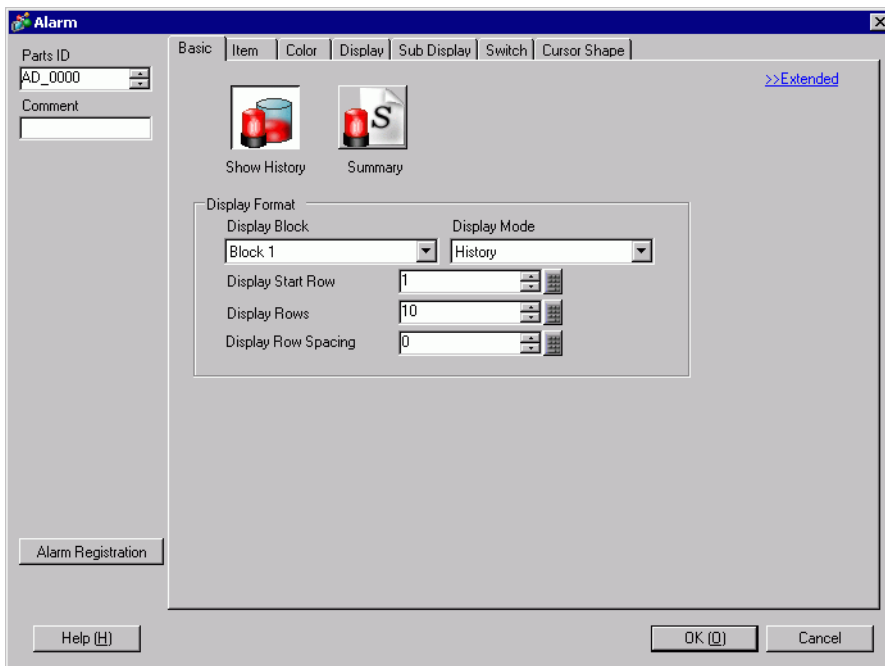

Setting	Description
Display Format	Set the format of the Alarm History display.
Display Block	Choose the block with in which the desired Alarm Messages are registered from [Block 1] to [Block 8].
Display Mode	Choose the Alarm Message display method from [History], [Log], or [Active]. ☞ "19.10.1 Common (Alarm) Settings Guide ■ Alarm Guide" (page 19-70)
Display Start Row	Set the row where the Alarm Message will start displaying from 1 to 768.
Display Rows	Set how many Alarm Message rows will display on one screen from 1 to 50.
Display Row Spacing	Set the space between Alarm Messages from 0 to 7 dots. <div style="text-align: center;">                         A                            B                          From 0 to 7 dots.                     </div>

◆ **Basic/Extended Settings**

You can change the Alarm Message Display Direction and Sort Order.

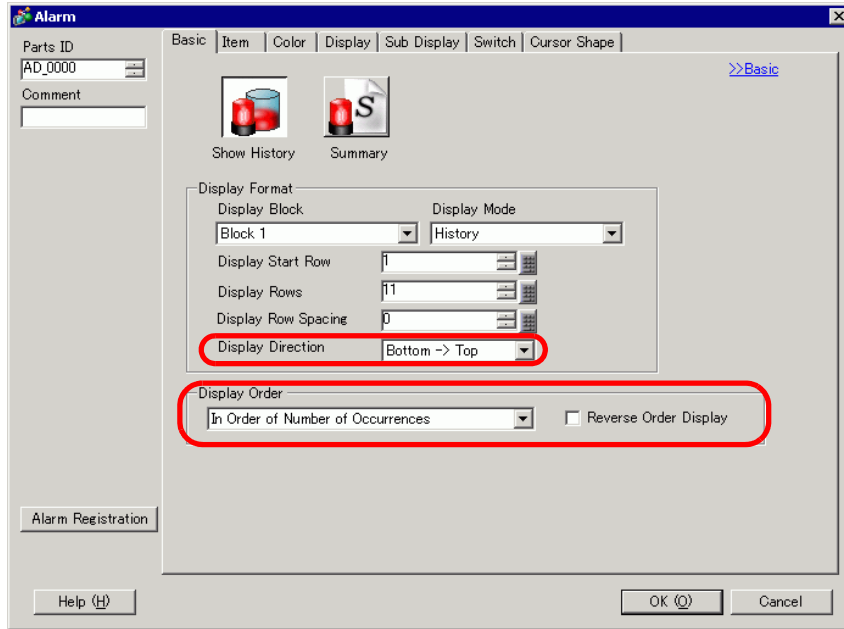

Setting	Description
<p>Display Direction</p>	<p>Choose the scroll direction for the Alarm Message from [Bottom Top] or [Top Bottom].</p> <p>Registered message</p> <div style="border: 1px solid black; padding: 5px; display: inline-block;"> <p>No. 1 Pump Closed                      Tank A Low Water                      Tank B Abnormal Pressure                      :                      :</p> </div> <p>Trigger order : Tank B Abnormal Pressure→Pump 1 Closed                      →Tank A Low Water                      Sort order : In Reverse Order of Trigger Date and Time</p> <p>· When scroll direction is [Bottom→Top]</p> <div style="display: flex; align-items: center;"> <div style="margin-right: 10px;"> <p>Scroll direction ↑</p> <p>Start position →</p> </div> <div style="border: 1px solid black; padding: 5px;"> <p>04/07/25 09:19 Tank B Abnormal Pressure                      04/07/25 14:20 No. 1 Pump Closed                      04/07/25 20:23 Tank A Low Water</p> </div> </div> <p>· When scroll direction is [Top→Bottom]</p> <div style="display: flex; align-items: center;"> <div style="margin-right: 10px;"> <p>Start position →</p> <p>Scroll direction ↓</p> </div> <div style="border: 1px solid black; padding: 5px;"> <p>04/07/25 20:23 Tank A Low Water                      04/07/25 14:20 No. 1 Pump Closed                      04/07/25 09:19 Tank B Abnormal Pressure</p> </div> </div>


Continued




Setting	Description
Display Order	Select the display order for Alarm Messages from [In Reverse Order of Trigger Date], [In Number of Occurrences Order], [In Descending Order of Accumulated Time], [Level & In Reverse Order of Trigger Date], [Level & In Descending Order of Number of Occurrences], or [Alarm Registration Order].
Reverse Order	Display items in reverse [Display Order].


◆ **Item/Basic**

Configure the items, the number of characters, and the date/time format displayed in the Alarm Part. The item names are not displayed on the GP screen. To display the item names, set them by selecting [Extended].



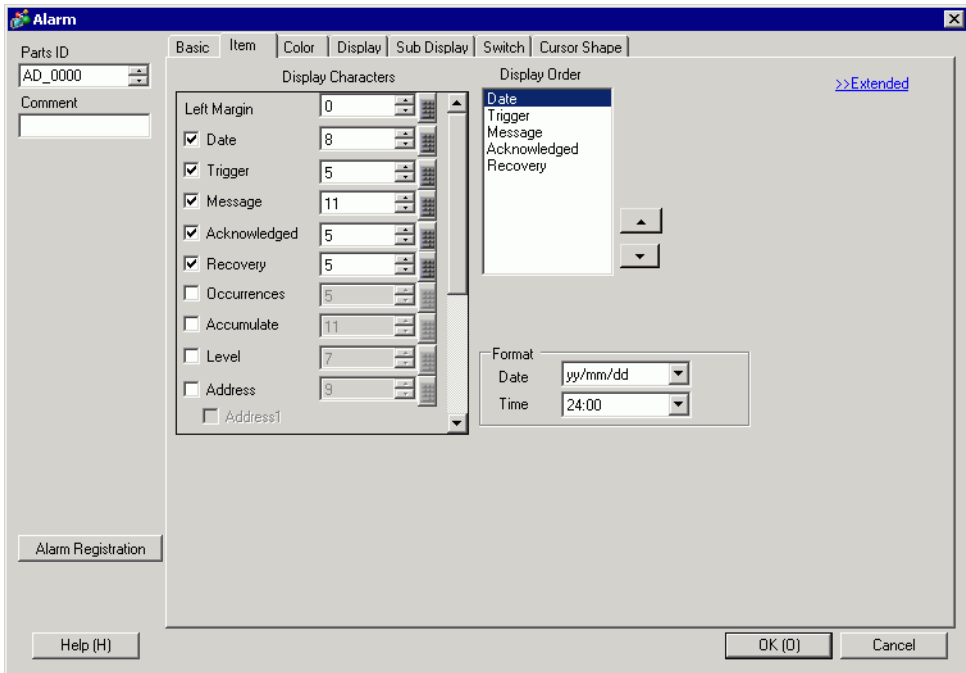


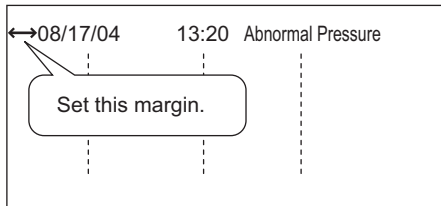Setting	Description
Left Margin	Select the spacing between the left-most item name and the border. Set a value so that the total of [Display Characters] and [Left Margin] is within 160 single-byte characters.  

Continued

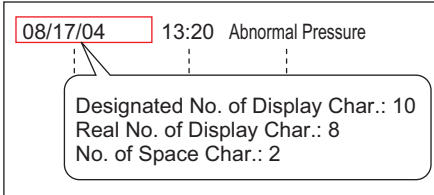Setting	Description
<p>Select Items to Display</p>	<p>From [Date], [Trigger], [Message], [Acknowledged], [Recovery], [Occurrence], [Elapsed Time], [Level], and [Address], select items to display in the alarm part.</p> <ul style="list-style-type: none"> <li>• <b>Date</b> Displays the date and time when the alarm was triggered.</li> <li>• <b>Trigger</b> Displays the time when alarm was triggered.</li> <li>• <b>Message</b> Displays Alarm Message.</li> <li>• <b>Acknowledge</b> Displays the time when alarm message was confirmed.</li> <li>• <b>Recovery</b> Displays alarm recovery time.</li> <li>• <b>Occurrences</b> Displays the number of times alarm was triggered. The maximum count is 65,535.</li> <li>• <b>Elapsed Time</b> Displays the total duration of time when the alarm was in the triggered state. The maximum duration is 9999 hours 59 minutes 59 seconds.</li> <li>• <b>Level</b> Displays the Alarm Message importance level.</li> <li>• <b>Address</b> Displays data when an Alarm is triggered.</li> </ul> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• Once the values of [Cycles] and [Duration] reach the maximum, they will remain there.</li> </ul>
<p>Display Characters</p>	<p>Set the number of characters displayed for each item. Set a value so that the total of [Display Characters] and [Left Margin] for the item is within 160 characters.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• When you want to provide spaces between the items, set a value larger than the number of characters that will actually be displayed.</li> </ul> 

Continued

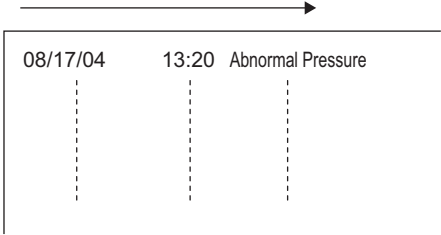Setting	Description
<p>Display Order</p>	<p>Set the display order of all items. Items starting from the top of this list are displayed on the Alarm part from left to right.</p> <div style="display: flex; justify-content: space-around; align-items: center;">   </div> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>When you select [Address], a scrolling position separator is displayed. On the Display, you can display the items above the separator without scrolling.</li> </ul> <div style="display: flex; justify-content: center; align-items: center; margin-top: 10px;">  </div> <ul style="list-style-type: none"> <li>The separator and Addresses 1 to 8 cannot be moved between Date and Level.</li> </ul>
<p>Format</p>	<p>Set the date and time format.</p>
<p>Date</p>	<p>Select the Date display format: [mm/dd/yy], [mm/dd], [yy/mm/dd], or [dd/mm/yy].</p>
<p>Time</p>	<p>Choose a format for the time from [12:00], [24:00], [12:00:00], or [24:00:00].</p>

◆ **Item/Extended**


Set the Item Names to display in the Alarm part.

No Item Names

08/17/04	15:10	Tank A ...
08/17/04	16:23	Tank B ...



Has Item Names

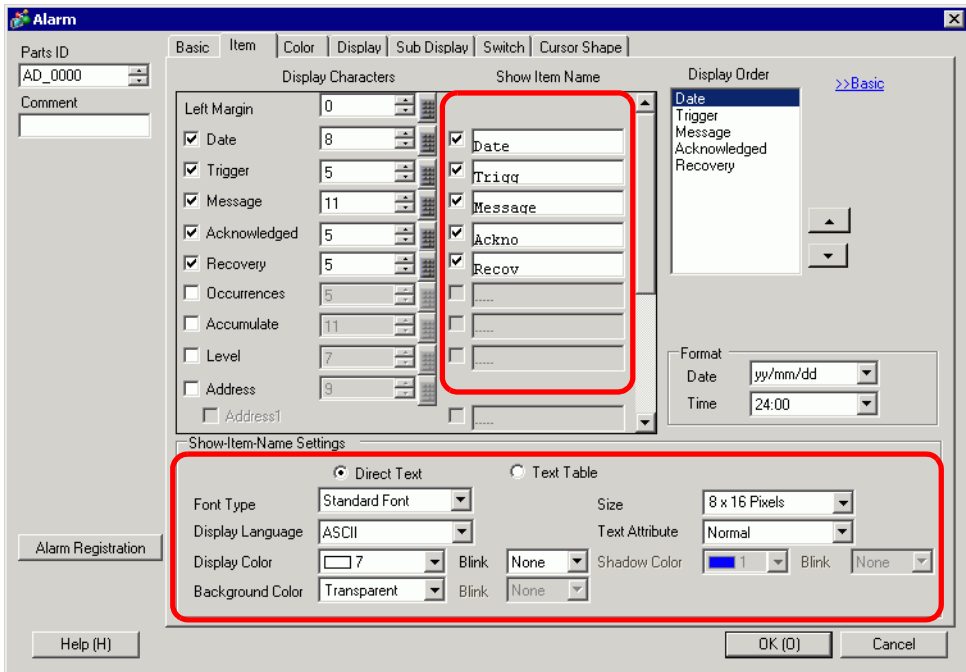Date	Trigger	Message
08/11/04	15:10	Tank A ...
08/11/04	16:23	Tank B ...



Setting	Description
Show Item Name	Select the check box for the item names to be displayed, and enter the item name text.
Show-Item-Name Settings	Configure settings for Item Name display.
Direct Text/Text Table	<p>Set whether to input directly for item names or to reference text registered in a Text Table.</p> <ul style="list-style-type: none"> <li>• <b>Direct Text</b> Directly input the item name to be displayed.</li> <li>• <b>Text Table</b> Use an Item Name registered in a Text Table. ☞ "17.9.6 Alarm Part - Item/Extended (Text Table) Settings Guide" (page 17-72)</li> </ul>
Font Type	Choose a font type for the item names from [Standard Font] or [Stroke Font].


Continued

Setting	Description
Show-Item-Name Settings	Choose a font size for the Item Names. <b>Standard Font:</b> Specify "Width x Height" between [8 x 8] to [64 x 128] in 8 dot units, or select a fixed size from [6 x 10], [8 x 13], [13 x 23]. When using fixed sizes, you can display only single-byte alphanumeric characters. <b>Stroke Font:</b> 6 to 127
	If you select [Direct Text], select the language for item names: [Japanese], [ASCII], [Chinese (Simplified)], [Chinese (Traditional)], [Korean], [Cyrillic], or [Thai].
	Select the text attributes. <b>Standard Font:</b> Choose from [Standard], [Bold], [Shadow] (When a fixed size [6 x 10] is selected, choose from [Standard] or [Shadow].) <b>Stroke Font:</b> Choose from [Standard], [Bold], [Outline].
	Choose a color for the Item Names.
	Select the blink and blink speed.  <div style="border: 1px solid black; padding: 2px; width: fit-content;"><b>NOTE</b></div> <ul style="list-style-type: none"> <li>• There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].   "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</li> </ul>
	Set the Alarm part background color. [Address] = selected is when this setting is available.  <div style="border: 1px solid black; padding: 2px; width: fit-content;"><b>NOTE</b></div> <ul style="list-style-type: none"> <li>• When there are items to be scrolled, choose a solid background color for the item names. If the items have no background color, they may overlap in the display.</li> </ul>
	Enabled when [Shadow] is selected from [Text Attribute]. Set a color for the shadow.
	Select whether or not Shadow Color will blink, and the blink speed.  <div style="border: 1px solid black; padding: 2px; width: fit-content;"><b>NOTE</b></div> <ul style="list-style-type: none"> <li>• There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].   "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</li> </ul>

## ◆ Color

Alarm Messages can be color-coded according to whether they are in the [Trigger], [Acknowledged], or [Recovery] state.


When Alarm Messages have levels attached during the registration, the levels can also be color-coded.

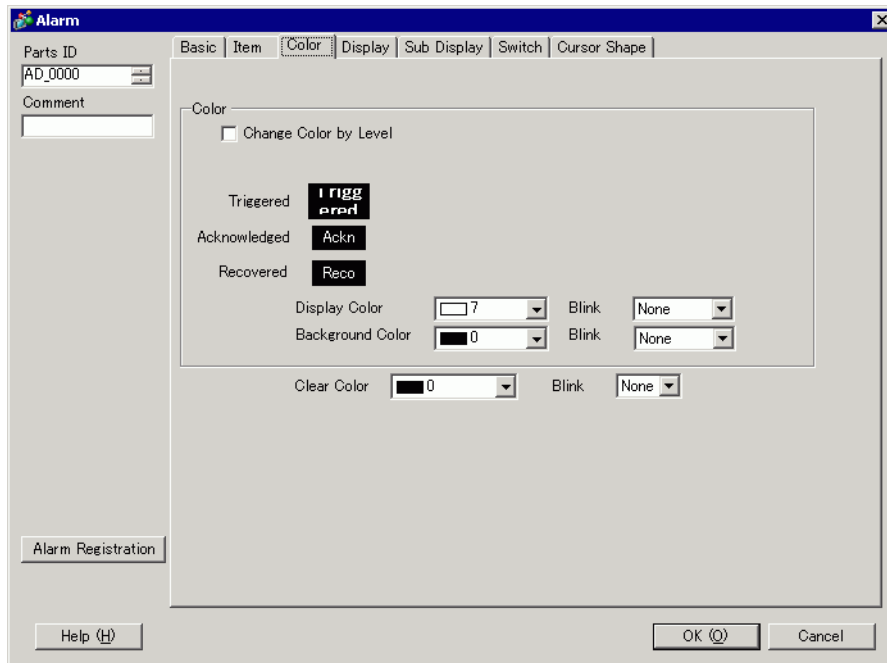



## ◆ Display

Set a font and border for the Alarm Message.

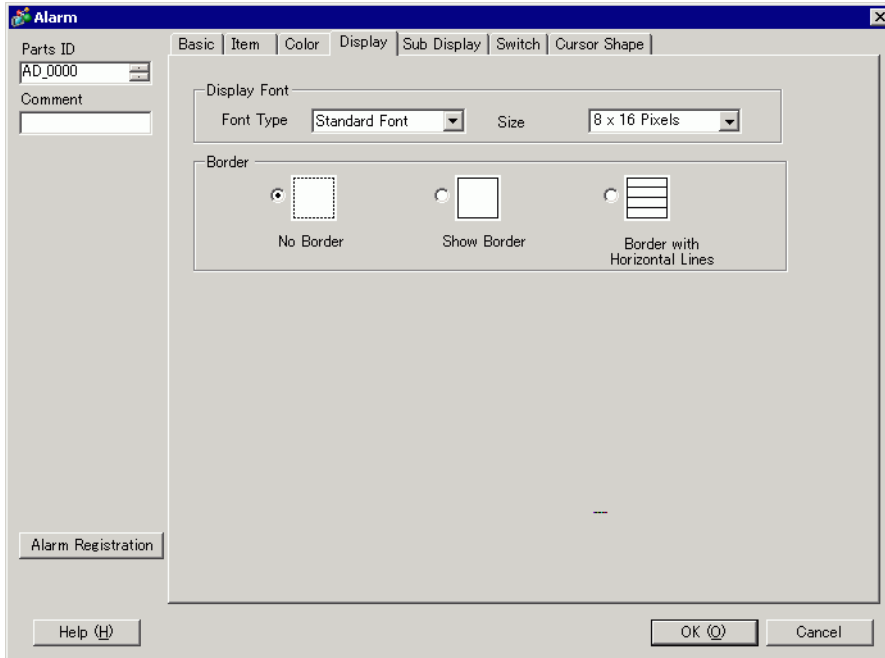


Setting	Description
Display Font	Set a font for the text.
Font Type	Choose a font type for the Alarm Message from [Standard Font] or [Stroke Font].
Size	Choose a font size for the Item Names. Standard Font: Specify "Width x Height" between [8 x 8] to [64 x 128] in 8 dot units, or select a fixed size from [6 x 10], [8 x 13], [13 x 23]. When using fixed sizes, you can display only single-byte alphanumeric characters. Stroke Font: 6 to 127
Border	Choose the Alarm Message border from [No Border], [Show Border], or [Show Border + Horizontal Ruled Line]. <b>NOTE</b> <ul style="list-style-type: none"> <li>The color of the border and ruled line is fixed to white.</li> <li>When [Show Border + Horizontal Ruled Line] is selected, set the [Display Row Spacing] to "1" or higher. When "0" is set, the horizontal ruled lines cannot be displayed.</li> </ul>



## ◆ Sub Display/Basic

You can set a different Sub Screen to display when each Alarm Message is touched.

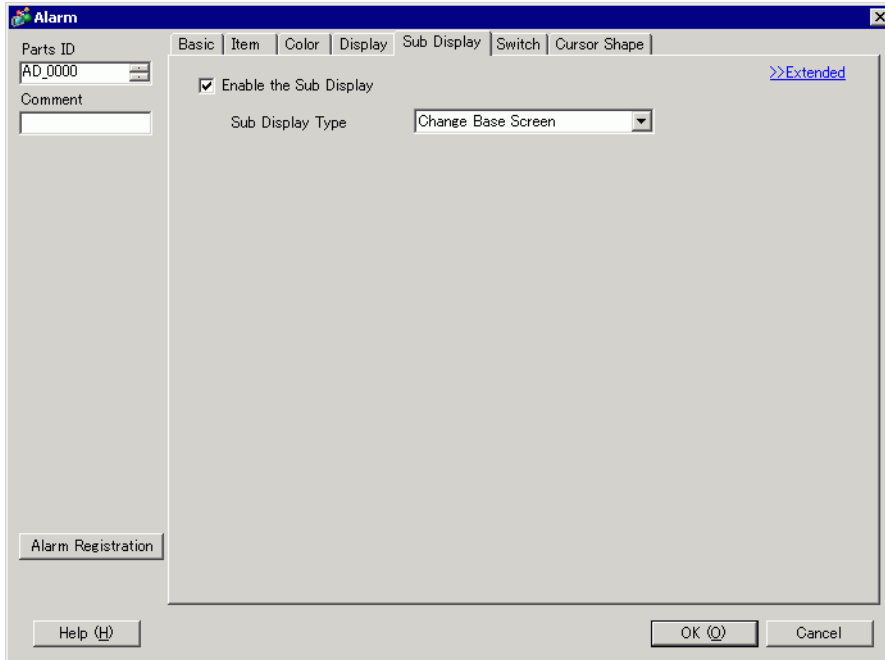

Setting	Description
Enable the Sub Display	Select whether or not to use a Sub Display.
Sub Display Unit	<p>Select the Sub Display Type.</p> <ul style="list-style-type: none"> <li>• <b>Change Base Screen</b> This setting changes the entire screen to another screen. It works the same as a normal screen change. In [Alarm], set the [Sub Display Screen Number] to the destination [Base Screen Number].</li> <li>• <b>Show Text Window</b> Display [Text] in a Window. In [Alarm], set the [Sub Display Screen Number] to the [Text File Number] you want to display in the window.</li> </ul> <div style="border: 1px solid gray; padding: 5px; margin: 10px 0;"> <p>Sub Display Type    Show Text Window ▾</p> <p>Window Size    <input type="radio"/> Large    <input checked="" type="radio"/> Small</p> <p><small>Caution: To register a text, the number of characters in a row must be within 20.</small></p> </div>

Continued

Setting	Description
Window Size	<p>When the [Sub Display Unit] is [Show Text Window], select [Big] or [Small] to choose the window size.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"><li>• The maximum number of text characters on one line of a window is as follows. Big Window Size: Up to 30 characters Small Window Size: Up to 20 characters</li><li>• For some models, the window may not be fully displayed on the GP when the window size is set to [Big]. ☞ "19.11.2 Restrictions for Sub Display/Extended" (page 19-159)</li></ul>


**NOTE**

- When the screen is changed to an invisible state in Sub Display, the Alarm Part will be hidden, but the Sub screen will remain displayed.  
☞ "20.3 Showing and Hiding Objects" (page 20-8)

◆ **Sub Display/Extended**





You can set up a sub-display that changes the Base screen or Window screen, or a sub-display that shows a picture display, message display, or movie player on a Base or Window screen.

☞ "19.11.2 Restrictions for Sub Display/Extended" (page 19-159)




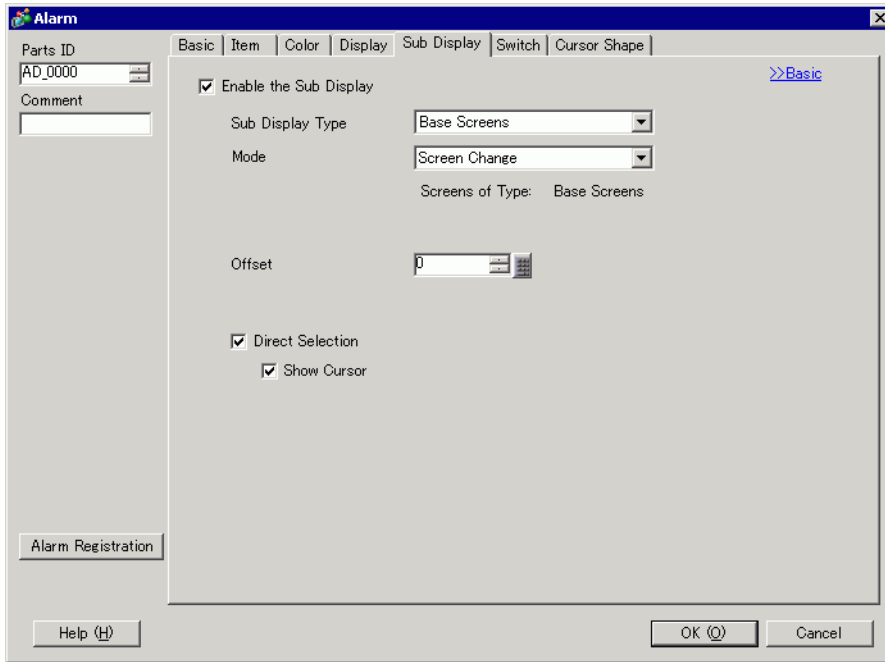


Setting	Description
Enable the Sub Display	Select whether or not to use a Sub Display.
Sub Display Unit	<p>Select the Sub Display Type.</p> <ul style="list-style-type: none"> <li>• Base Screen Change the display to other screen, or display a picture or text directly on a base screen.</li> <li>• Window Screens Display a Sub Screen in a Window. Change the window to another one, or display a picture or text in the Window.</li> </ul> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• An alarm message with a [Sub Display Screen Number] equal to "0" will not display a Sub Screen.</li> </ul>

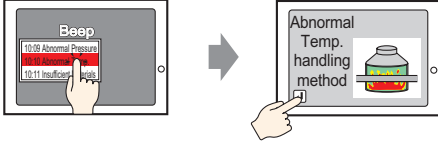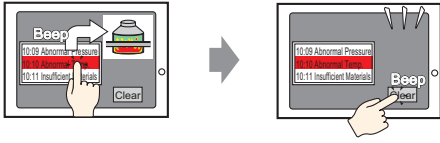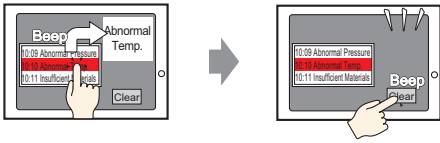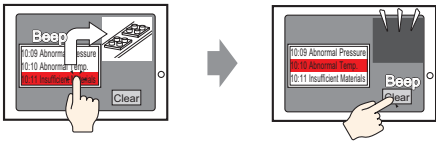


Continued

Setting	Description
<p>Action (Base Screen)</p>	<p>When the [Sub Display Unit] is [Base Screen], select one of the following actions: [Screen Change], [Change Picture Display], [Text Display Change], or [Play Movie].</p> <ul style="list-style-type: none"> <li> <p><b>Screen Change</b> Change the screen to display the sub screen.</p>  <p>Touch the alarm message, and the screen changes to the screen corresponding to the message is displayed.</p> <p>Touch the Change Screen Switch to return to the alarm screen.</p> </li> <li> <p><b>Change Picture Display</b> Use a Picture Display to display the sub screen.</p>  <p>Touch the alarm message, and a picture corresponding to the message is displayed.</p> <p>Touch the Clearing Switch created separately to erase the sub display.</p> </li> <li> <p><b>Text Display Change</b> Use a Message Display to display the sub screen.</p>  <p>Touch the alarm message, and a text corresponding to the message is displayed.</p> <p>Touch the Clearing Switch created separately to erase the sub display.</p> </li> <li> <p><b>Movie</b> Use Movie Player to display the sub screen.</p>  <p>Touch the alarm message, and the movie corresponding to the movie file of the message is played.</p> <p>Touch the clearing switch created separately, (turning the Play Bit OFF), to close the sub-screen.</p> </li> </ul>

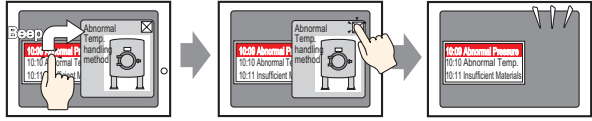

Continued

Setting	Description
<p>Action (Window)</p>	<p>When the [Sub Display Unit] is [Window], select one of the following actions: [Window Change], [Change Picture Display], [Text Display Change], or [Play Movie].</p> <ul style="list-style-type: none"> <li> <p><b>Window Change</b> Change the Window Screen to display the sub screen.</p>  <p>Touch the alarm message, and a Window Screen corresponding to the message is displayed.</p> <p>Touch the switch specially created to delete the window.</p> <p>Window display is erased</p> </li> <li> <p><b>Change Picture Display</b> Use a Picture Display to display the sub screen.</p>  <p>Touch the alarm message, and a picture corresponding to the message is displayed in a window.</p> <p>Touch the switch specially created to delete the window.</p> <p>Window display is erased</p> </li> <li> <p><b>Text Display Change</b> Use a Message Display to display the sub screen.</p>  <p>Touch the alarm message, and a text corresponding to the message is displayed in a window.</p> <p>Touch the switch specially created to delete the window.</p> <p>Window display is erased</p> </li> <li> <p><b>Movie</b> Use a Movie Player to display the sub screen.</p>  <p>Touch the alarm message. The window changes to display the corresponding movie file.</p> <p>Touch the Clearing Switch created separately.</p> <p>Window display is erased.</p> </li> </ul>



Continued

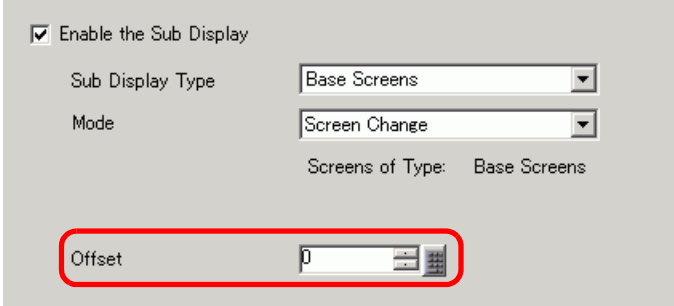Setting	Description
Direct Selection	<p>The Alarm Message displayed on the screen can be selected by touching it directly. When the Alarm Message to which a Sub screen has been set is touched, the Sub screen is displayed.</p>  <p>When this option is not designated, use the [Switch] tab and place a [Sub Display] switch to display a sub screen.</p>
Show Cursor	<p>If [Direct Selection] is designated, set whether or not to display the cursor when the Alarm Message is touched.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• If the cursor is set to be displayed, this setting is enabled even when the screen is changed to invisible state. When the screen is changed to visible state, the cursor is displayed.</li> </ul> <p> "20.3 Showing and Hiding Objects" (page 20-8)</p>
[Base Screen] - [Screen Change]	<p>This setting changes the entire screen to another screen. This operation works the same as a normal screen change.</p> 
Offset	<p>Set the Offset Value of the Sub Display Screen Number to 0 to 9999. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the screen number that is displayed.</p>

Continued

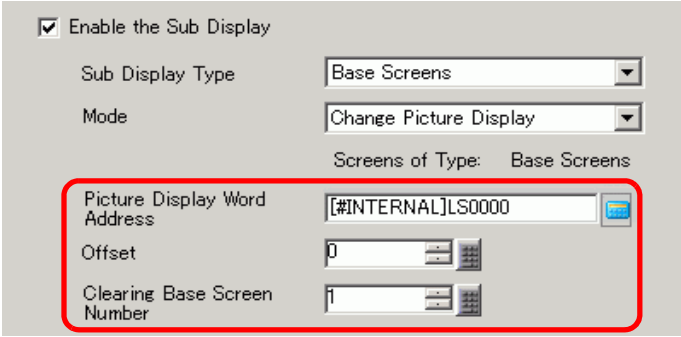
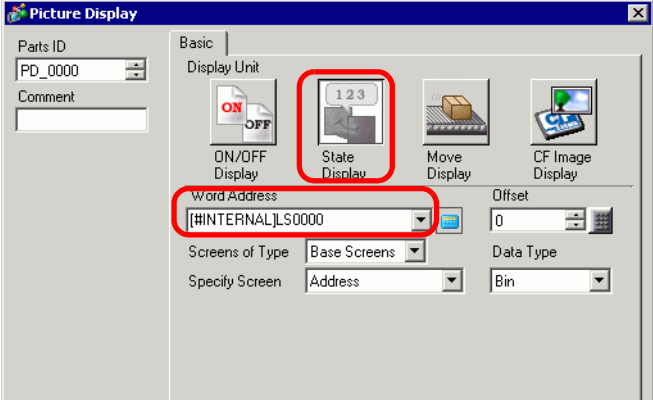
Setting	Description
<p>[Base Screen] - [Screen Change]</p>	<p>Display a picture corresponding to the Alarm Message in the Picture Display placed on the same screen as the Alarm Part.</p> 
<p>Picture Display Word Address</p>	<p>Specifies the GP internal device address (LS area, USR area) that stores the [Sub Display Screen Number] as defined in the [Alarm]. The number stored in this address is the base screen Number displayed on the Picture Display.</p> <p>Set the same address to the [Word Address] of the Picture Display placed on the same screen as the Alarm Part.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Picture Display's [Screens of Type] to [Base Screen], [Specify Screen] to [Address], and [Data Type] to [Bin].</li> </ul>
<p>Offset</p>	<p>Set the Offset Value of the Sub Display Screen Number to 0 to 9999. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the screen number that is displayed.</p>
<p>Clearing Base Screen Number</p>	<p>When you select the [Sub Display Screen Number] in [Alarm] to be Alarm Message "0", the base screen designated here will be called and the previous screen will be erased. Set the screen number that has been created to clear the contents (such as a screen with a black-filled square) from 1 to 9999.</p>

Continued

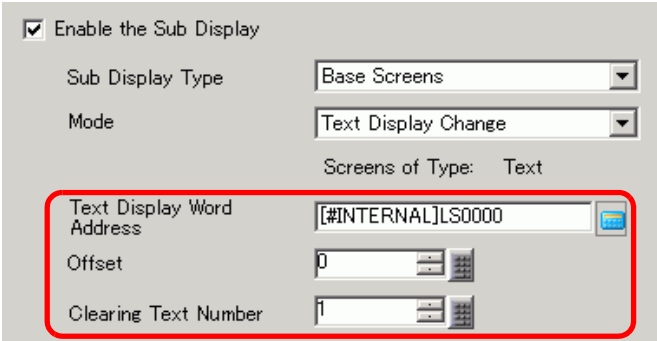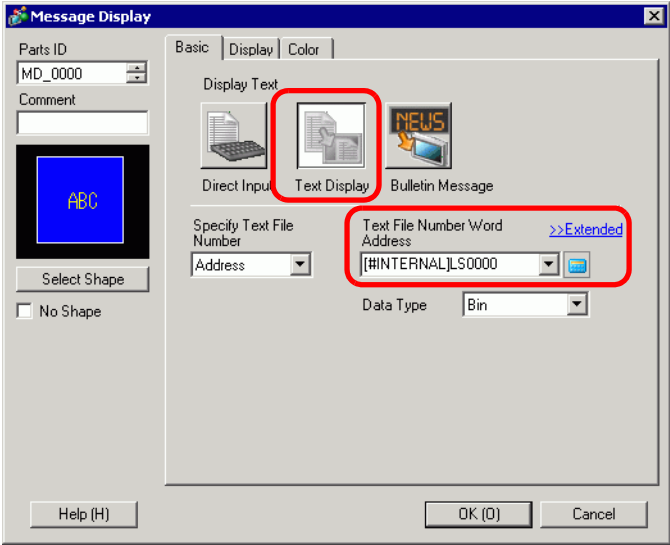
Setting	Description
[Base Screen] - [Text Display Change]	<p>Display a text corresponding to the Alarm Message in the Message Display placed on the same screen as the Alarm Part.</p> 
Text Display Word Address	<p>Specifies the GP internal device address (LS area, USR area) that stores the [Sub Display Screen Number] as defined in the [Alarm]. The number stored in this address is the text Number displayed on the Message Display.</p> <p>Set the same address to the [Text File Number Word Address] of the Message Display placed on the same screen as the Alarm Part.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• Set the Message Display [Text Display]'s [Specify Text File Number] to [Address], and [Data Type] to [Bin].</li> </ul>
Offset	<p>Set the Offset Value of the Sub Display Screen Number to 0 to 8999. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the text that is displayed.</p>
Clearing Text File Number	<p>When you select the [Sub Display Screen Number] in [Alarm] to be Alarm Message "0", the text designated here will be called and the previous text will be erased. Set the text number that has been created to clear the contents (such as text with no content) from 1 to 8999.</p>

Continued

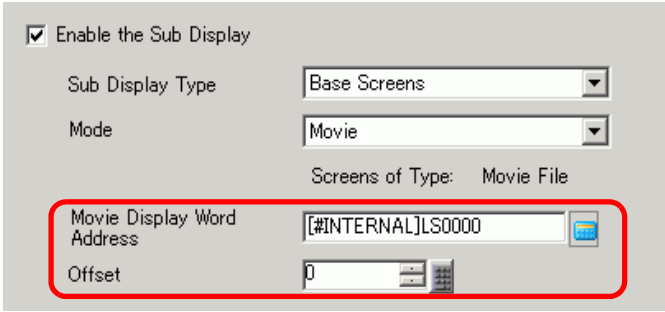
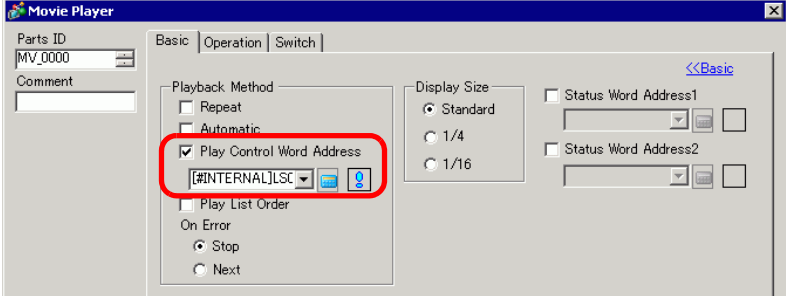


Setting	Description
[Base Screen] - [Play Movie]	<p>Switch to Base Screen set up with a Movie Player. This operation works the same as a normal screen change.</p> 
Movie Display Word Address	<p>Specifies the GP internal device address (LS area, USR area) that stores the [Sub Display Screen Number] as defined in the [Alarm]. This number can act as the index number of the movie file to display in the movie player.</p> <p>Set the same address to the Movie Player [Play Control Word Address] property.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>In the Movie Player [Play Mode] properties, set [Repeat Play] and [Auto Play] off and [Play List Order] to Individually, and set [On Error] to [Stop].</li> </ul>
Offset	<p>Set the Offset Value of the Sub Display Screen Number to 0 to 99. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the index number of the movie file that is displayed.</p>


Continued

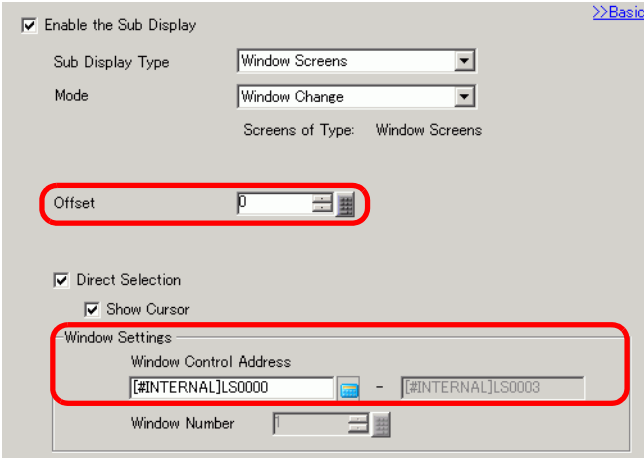Setting	Description
[Window] - [Window Change]	<p>Displays the Window Screen which corresponds to the Alarm Message.</p> 
Offset	<p>Set the Offset Value of the Sub Display Screen Number to 0 to 2000. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the screen number that is displayed.</p>
<p>Window Settings</p> <p>Window Control Address</p>	<p>Configure settings to display a Window Part placed on the same screen as the Alarm Part.</p> <p>Specify the address to control the Window display. Four consecutive words will be used, starting from the designated address. Only the address of the GP internal device (LS area, user area) can be used. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field is written to the next address over from the address defined here, which is used to define the window screen to display. Set the same address to the [Window Control Address] of the Window Part placed on the same screen as the Alarm Part.</p> <p>☞ "12.7.2 Word Action" (page 12-24)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Window Part [Window Specification] to [Address], and [Data Type] to [Bin].</li> </ul>

Continued

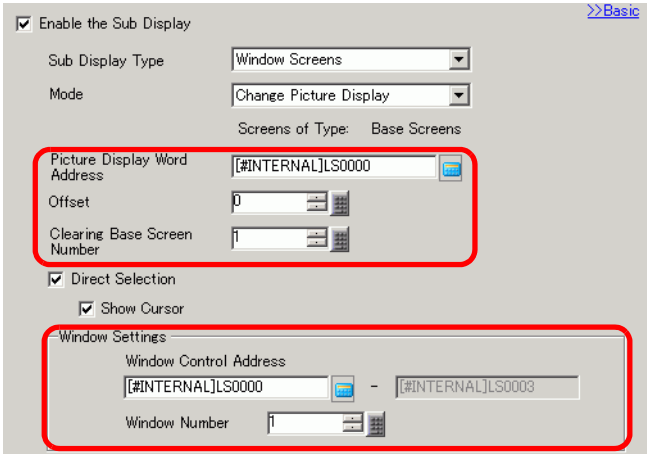
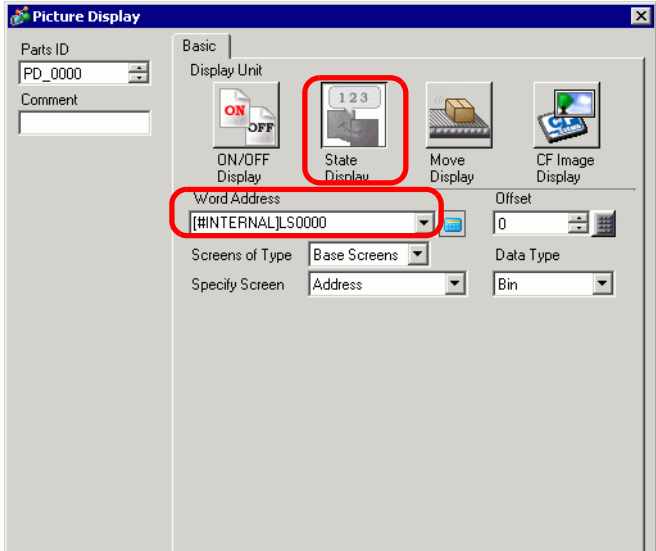
Setting	Description
<p>[Window] - [Change Picture Display]</p>	<p>Display a picture corresponding to the Alarm Message in the Picture Display placed on the Window Screen.</p> 
<p>Picture Display Word Address</p>	<p>Specify the address of the GP internal device (LS area, user area) to store the number which has been set in [Sub Display Screen Number] of [Alarm]. The number stored in this address is the screen Number displayed on the Picture Display.</p> <p>Set the same address to the [Word Address] of the Picture Display placed on the Window Screen.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Picture Display's [Screens of Type] to [Base Screen], [Specify Screen] to [Address], and [Data Type] to [Bin].</li> </ul>
<p>Offset</p>	<p>Set the Offset Value of the Sub Display Screen Number to 0 to 9999. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the screen number that is displayed.</p>

Continued

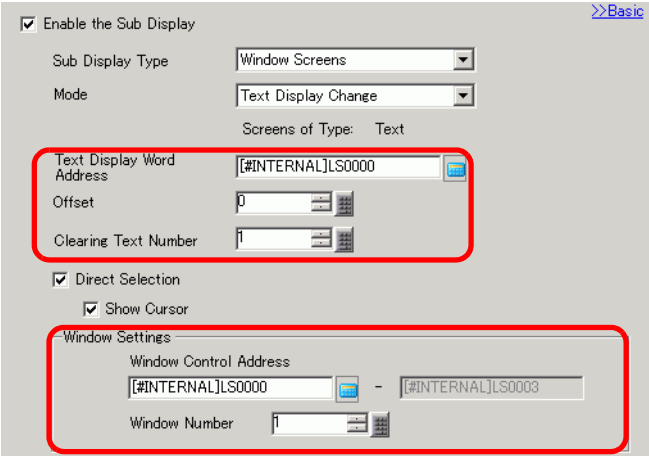
Setting		Description
Change Picture Display	Clearing Base Screen Number	When you select the [Sub Display Screen Number] in [Alarm] to be Alarm Message "0", the base screen designated here will be called and the previous screen will be erased. Set the screen number that has been created to clear the contents (such as a screen with a black-filled square) from 1 to 9999.
	Window Settings	Configure settings to display a Window Part placed on the same screen as the Alarm Part.
	Window Control Address	Specify the address to control the Window display. Four consecutive words will be used, starting from the designated address. Only the address of the GP internal device (LS area, user area) can be used. Set the same address to the [Window Control Address] of the Window Part placed on the same screen as the Alarm Part. ☞ "12.7.2 Word Action" (page 12-24)  <b>NOTE</b> • Set the Window Part [Window Specification] to [Address], and [Data Type] to [Bin].
	Window Number	Set the Window Screen to display (the window that contains the Picture Display) from 1 to 2000. This number is written to ([Window Control Address]+1).
[Window] - [Text Display Change]	Display a text corresponding to the Alarm Message in the Message Display [Text Display] placed on the Window Screen.	

Continued

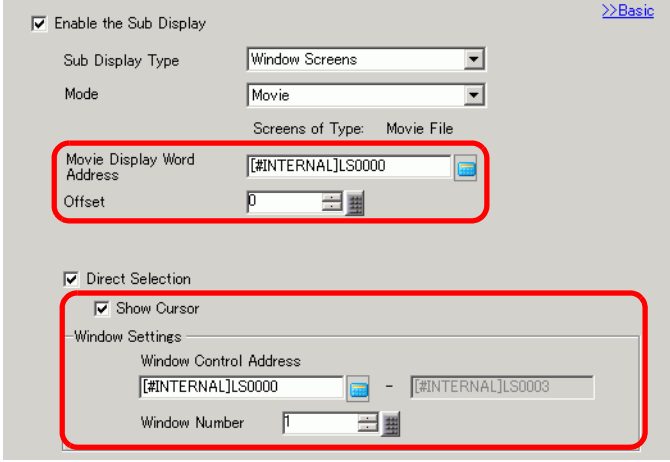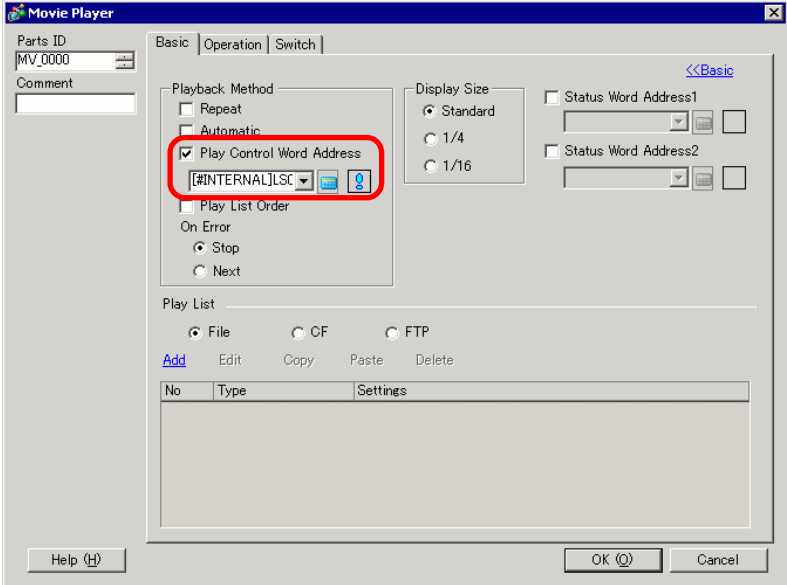


Setting		Description
	Window Number	Set the Window Screen to display (the window that contains the Message Display) from 1 to 2000. This number is written to ([Window Control Address]+1).
Text Display Change	[Window] - [Play Movie]	<p>Sub-display Movie Player that is positioned on the Window Screen.</p> 
	Movie Display Word Address	<p>Specifies the GP internal device address (LS area, USR area) that stores the [Sub Display Screen Number] as defined in the [Alarm]. This number can act as the index number of the movie file to display in the movie player.</p> <p>Set the same address to the Movie Player [Play Control Word Address] property.</p> 
		<p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>In the Movie Player [Play Mode] properties, set [Repeat Play] and [Auto Play] off, [Play List Order] to [Individually], and set [On Error] to [Stop].</li> </ul>

Continued


Setting		Description
	Offset	Set the Offset Value of the Sub Display Screen Number to 0 to 99. In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field plus the offset defines the index number of the movie file that is displayed.
Movie	Window Settings	Configure settings to display a Window Part placed on the same screen as the Alarm Part.
	Window Control Address	<p>Specify the address to control the Window display. Four consecutive words will be used, starting from the designated address. Only the address of the GP internal device (LS area, user area) can be used.</p> <p>In the [Alarm] settings, the number set up in the [Sub Display Screen Number] field is written to the next address over from the address defined here, which is used to define the window screen to display.</p> <p>Set the same address to the [Window Control Address] of the Window Part placed on the same screen as the Alarm Part.</p> <p> "12.7.2 Word Action" (page 12-24)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Window Part [Window Specification] to [Address], and [Data Type] to [Bin].</li> </ul>
	Window Number	Defines the number, from 1 to 2000, of the Window Screen (set up with a Movie Player) that you want to display. This number is written to ([Window Control Address]+1).

**NOTE**

- The GP internal device [#INTERNAL] consists of two areas: the [LS] area and [USR] area. For the available addresses in the LS area, refer to the following:
  -  "A.1.4 LS Area (Direct Access Method)" (page A-8)

## ◆ Switch

Set operation switches to display Alarm Messages.

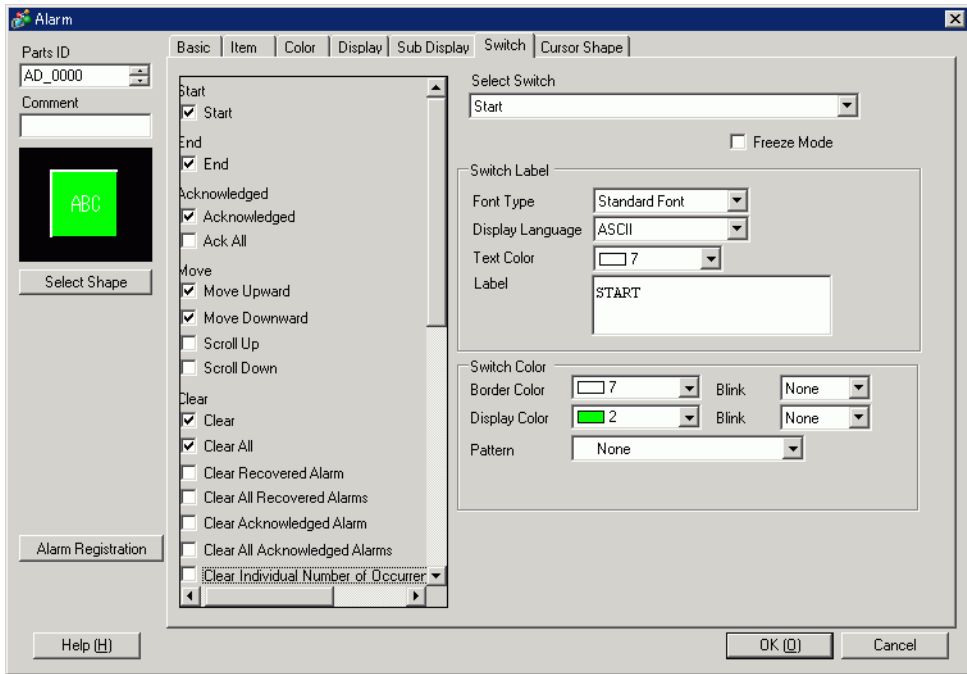

### NOTE

- The same Switch as the one set on this tab can be created with a Switch Lamp Part [Special Switch] - [Alarm History Switch].  
     ☞ 10.15.4 Special Switch ◆ Alarm History Switch 10-73
- If Visibility Animation is set, the set switch becomes invisible when the Alarm Part is changed to invisible.  
     ☞ "20.3 Showing and Hiding Objects" (page 20-8)



Setting	Description
Switch Preview	Displays the selected switch shape.
Select Shape	Open Shape Browser to choose the Part shape.
Types of Switches	Set the Switch type.
Start/End	Set a switch to start/end operation.

Continued




Setting		Description
Type of Switches	Start/End	<p>Touch [Start] and the cursor will appear to operate the other switches. Touching [End] cancels the cursor.</p>
	Acknowledge All	Acknowledges all Alarm Messages that are currently triggered.
	Move	Set the Move switches.
	Move Upward	Moves the cursor 1 row up or down.
	Move Downward	
Scroll Up	Alarm Messages that are currently displayed are scrolled up or down by a given number of rows. For example, Number of Active Alarms: 9, Display Rows: 3, Scroll: 3	
Scroll Down		

Continued

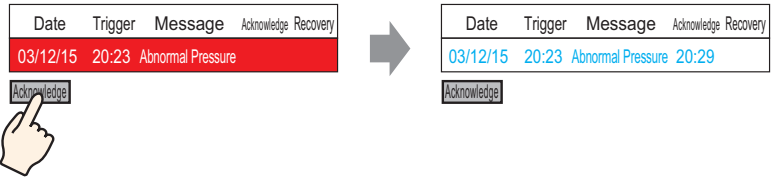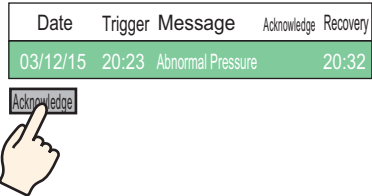Setting		Description
Types of Switches	Acknowledge	Set up the Acknowledge switch.
	Acknowledge	<p>Acknowledges the alarm in the current cursor position. Press [Acknowledge] and the selected Alarm Message's acknowledge time is displayed.</p>  <p>Alarms that have already recovered will not change when [Acknowledge] is touched.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• If an Alarm Message is already displayed with the acknowledge time, the time will not be updated.</li> </ul>

Continued

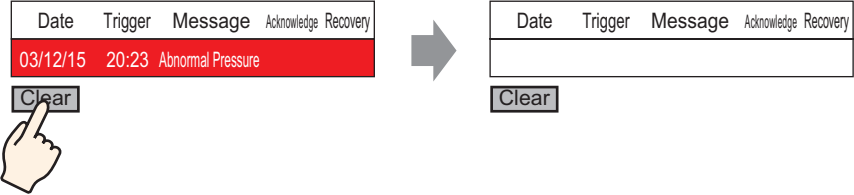Setting		Description
Types of Switches	Clear	Set a switch to clear the display. The Bit or Word data of the host (PLC) will not be cleared.
	Clear	<p>Touch [Clear] to erase the Alarm Message display at the current cursor position.</p> 
	Clear All	Erases all displayed Alarm Messages, regardless of whether they are in the [Trigger], [Acknowledged], or [Recovery] state.
	Clear Recovery Alarm	Erases the recovered alarm message at the current cursor position. The message is not erased if it is not in the Recovery state.
	Clear All Recovery Alarms	Erases all recovered Alarm Messages.
	Clear Acknowledged Alarm	Erases the acknowledged alarm message at the current cursor position. The message is not erased if it is not in the Acknowledged state.
	Clear All Acknowledged Alarms	Erases all Acknowledged Alarm Messages.
	Clear Individual Number of Occurrences	Clears the Number of Occurrences for the alarm in the cursor's current position and replace that value with "0".
	Clear All Number of Occurrences	Clears the Number of Occurrences for all displayed alarms and replace that value with "0".
	Clear Individual Accumulated Time	Clears the accumulated time for the alarm in the cursor's current position and replace that value with "0".
	Clear All Accumulated Time	Clears the accumulated time for all displayed alarms and replace that value with "0".

Continued

Setting		Description
Types of Switches	Sort	<p>Set a switch to sort Alarm Messages.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>This setting is disabled when the Display Mode is set to [Log].</li> <li>Even when the display order of the messages changes on the screen, the Alarm History data is printed or saved to the CF Card in the order of occurrence.</li> </ul>
	In Reverse Order of Trigger Date	Displays Alarm Messages in the order of occurrence, according to the scroll direction.
	In Number of Occurrences Order	<p>Displays Alarm Messages in the order starting with the largest occurrence frequency, according to the scroll direction.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>If multiple alarms with the same frequency exist, they will display in the decreasing order of the accumulated time, according to the scroll direction. If multiple alarms have the same number of occurrences and accumulated time, the newest alarm will display first.</li> </ul>
	In Descending Order of Accumulated Time	<p>Displays Alarm Messages in the order starting with the largest accumulated time, according to the scroll direction.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>If multiple alarms with the same accumulated time exist, they will display in the decreasing order of the number of occurrences, according to the scroll direction. If multiple alarms have the same number of occurrences and accumulated time, the newest alarm will display first.</li> </ul>
	Level & In Reverse Order of Trigger Date	Displays Alarm Messages in the order starting with the highest registered level, according to the scroll direction. If multiple Alarm Messages with the same level exist, messages will display in the order starting with the latest occurrence date.
	Level & In Descending Order of Number of Occurrences	<p>Displays Alarm Messages in the order starting with the highest registered level, according to the scroll direction. If multiple Alarm Messages with the same level exist, messages will display in the decreasing order of the alarm frequency, according to the scroll direction.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>If multiple alarms with the same frequency exist, they will display in the decreasing order of the accumulated time.</li> </ul>
	Alarm Registration Order	Displays Alarm Messages in ascending order of the registration number (Row Number) set in [Alarm], according to the scroll direction.
	Reverse Order	Displays Alarm Messages in the reverse order of the specified sorting order.
	Scroll	Set the scroll switch used by the [Address] column.

Continued

Setting		Description
Type of Switches	Scroll	<p>Scrolls displayed data to the right.</p>
		<p>Scrolls displayed data to the left.</p>
	Sub Display	Set the Sub Display switch.
	Sub Display	Displays the sub screen registered to the Alarm Message at the current cursor position.
	Alarm Number Acquisition	Set the Alarm Number Acquisition switch.
	Alarm Number Acquisition	Obtains the Alarm Message Number (the row number registered in [Alarm]) of the message at the current cursor position.
	Ladder Monitor Start	Sets up a switch to start ladder monitoring.
Ladder Monitor Start	If you have purchased and installed the Ladder monitor, use the Ladder Monitor to search the step that uses the device address that corresponds to the selected alarm.	
Select Switch	Choose a switch to set the label or scroll count.	
Samples to Scroll	Set the number of rows to scroll up or down from 1 to 768 when you place the [Scroll Up]/[Scroll Down] switch.	

Continued


Setting	Description												
Freeze Mode	<p>Specify whether to use Freeze Mode when you place the [Start] switch. Freeze Mode suspends the currently displayed alarms and prohibits the screen display from refreshing. This can be used to temporarily stop the display when alarms are triggered too often to be seen. When Freeze Mode is set, touch [Start] twice to begin freeze mode, and touch [End] to cancel it.</p> <p>When the following operations are performed in freeze mode, the management and display will be as follows.</p> <table border="1" data-bbox="403 494 1225 716"> <thead> <tr> <th>Action/Switch operation</th> <th>Processing</th> <th>Display</th> </tr> </thead> <tbody> <tr> <td>Alarm: Trigger, Recovery Switch Operation: [Acknowledge], [Clear]</td> <td style="text-align: center;">○</td> <td style="text-align: center;">×</td> </tr> <tr> <td>Switch Operation: [Move Upward], [Move Downward], [Scroll Up], [Scroll Down], [Sort], [Sub Display]</td> <td style="text-align: center;">○</td> <td style="text-align: center;">○</td> </tr> <tr> <td>Switch Operation: [Alarm Number Acquisition Key]</td> <td style="text-align: center;">○</td> <td style="text-align: center;">-</td> </tr> </tbody> </table> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Note that executing a clear while Freeze Mode is activated will clear the messages stored inside the GP, even though the messages remain on the display.</li> <li>When the message stored in the GP has been cleared as mentioned above, the sub display is not displayed in the Freeze Mode.</li> <li>The Freeze Mode remains activated even when the Alarm Part is changed to invisible in the Freeze Mode. Change the Alarm Part to visible to cancel the Freeze Mode.</li> </ul>	Action/Switch operation	Processing	Display	Alarm: Trigger, Recovery Switch Operation: [Acknowledge], [Clear]	○	×	Switch Operation: [Move Upward], [Move Downward], [Scroll Up], [Scroll Down], [Sort], [Sub Display]	○	○	Switch Operation: [Alarm Number Acquisition Key]	○	-
Action/Switch operation	Processing	Display											
Alarm: Trigger, Recovery Switch Operation: [Acknowledge], [Clear]	○	×											
Switch Operation: [Move Upward], [Move Downward], [Scroll Up], [Scroll Down], [Sort], [Sub Display]	○	○											
Switch Operation: [Alarm Number Acquisition Key]	○	-											
Switch Label	<p>Set the text to display on the switch label.</p> <table border="1" data-bbox="148 1141 1271 1578"> <tbody> <tr> <td data-bbox="148 1141 395 1228">Font Type</td> <td data-bbox="395 1141 1271 1228">Choose a font type for the switch label from [Standard Font] or [Stroke Font].</td> </tr> <tr> <td data-bbox="148 1228 395 1344">Display Language</td> <td data-bbox="395 1228 1271 1344">Select a language for the switch label from [Japanese], [Western], [Chinese (Traditional)], [Chinese (Simplified)], [Korean], [Cyrillic], or [Thai].</td> </tr> <tr> <td data-bbox="148 1344 395 1396">Text Color</td> <td data-bbox="395 1344 1271 1396">Select a color for the switch label.</td> </tr> <tr> <td data-bbox="148 1396 395 1578">Label</td> <td data-bbox="395 1396 1271 1578"> <p>Input the text to display on the switch label.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Select the switch and press the [F2] key to directly edit the text of the label.</li> </ul> </td> </tr> </tbody> </table>	Font Type	Choose a font type for the switch label from [Standard Font] or [Stroke Font].	Display Language	Select a language for the switch label from [Japanese], [Western], [Chinese (Traditional)], [Chinese (Simplified)], [Korean], [Cyrillic], or [Thai].	Text Color	Select a color for the switch label.	Label	<p>Input the text to display on the switch label.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Select the switch and press the [F2] key to directly edit the text of the label.</li> </ul>				
Font Type	Choose a font type for the switch label from [Standard Font] or [Stroke Font].												
Display Language	Select a language for the switch label from [Japanese], [Western], [Chinese (Traditional)], [Chinese (Simplified)], [Korean], [Cyrillic], or [Thai].												
Text Color	Select a color for the switch label.												
Label	<p>Input the text to display on the switch label.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Select the switch and press the [F2] key to directly edit the text of the label.</li> </ul>												



Continued

Setting	Description
Switch Color	Set the Switch color.
Border Color	Designate the switch border color and background color.
Display Color	<p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>The Switch Color setting is common to all Alarm parts, regardless of the switch type selected.</li> </ul>
Blink	<p>Select the blink and blink speed. You can set up blink settings for the [Border Color], [Display Color], and [Pattern Color].</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].  <a href="#">☞ "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</a></li> </ul>
Pattern	Select the switch pattern from 9 types.
Pattern Color	Specify the pattern color when you select options other than [No Pattern].

◆ **Cursor Shape**

If handling Alarm Messages, choose the cursor display shape. Also, select cursor settings for when the Alarm Message confirmation is sent from the device/PLC.

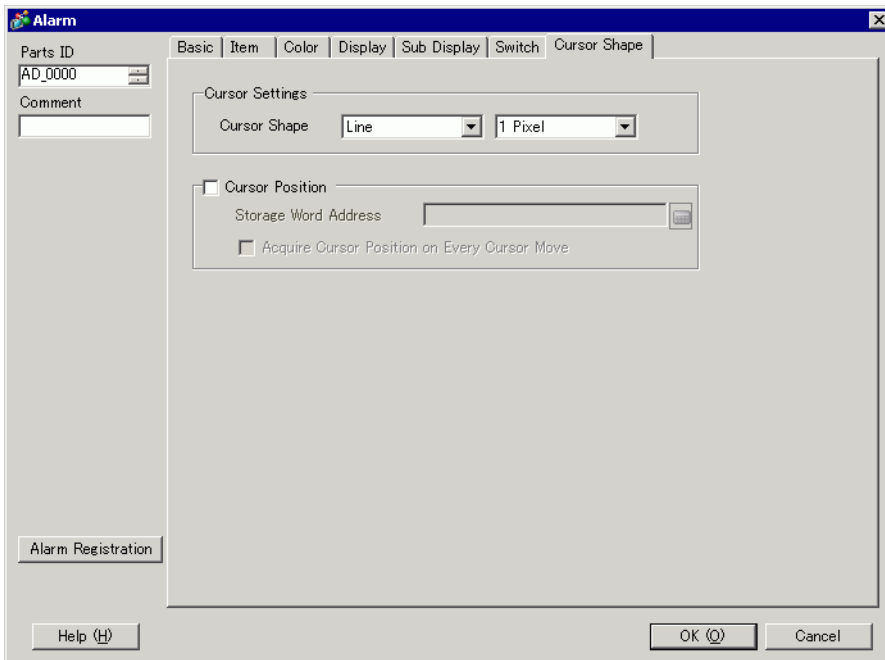

Setting	Description
<p>Cursor Settings</p> <p>Cursor Shape</p>	<p>If handling Alarm Messages, choose the cursor display shape.</p> <p>Choose the cursor shape from [Vertical] or [Mirror].</p> <p>Up/Down</p>  <p>Reverse</p> 
<p>Number of Pixels</p>	<p>If the cursor shape is [Vertical], choose the cursor thickness from [1 dot] or [2 dots].</p>
<p>Cursor Position</p> <p>Storage Word Address</p>	<p>Configure settings for the notification of the registration number (Row Number) of the Alarm Message selected with the cursor.</p> <p>Set the address where the registration number (Row Number) of the selected Alarm Message will be stored.</p> <p>When Alarm Messages are registered with [Bit Monitoring], the value of the registration number (Row Number) will be directly stored. When Alarm Messages are registered with [Word Monitoring], the value of "the registration number (Row Number) + 10,000" will be stored.</p> <p>For example, when an Alarm Message is registered with Word Monitoring and the registration number (Row Number) of the Alarm Message is 152:  Value stored in the [Storage Word Address] = 152 + 10000 = 10152</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• While in [Freeze Mode], the notification of the current cursor position for cleared data is not provided.</li> </ul>
<p>Acquire Cursor Position on Every Cursor Move</p>	<p>Stores the Alarm Message registration number (Row Number) to [Storage Word Address] every time the cursor moves.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• To provide a notification of the alarm cursor position without designating this option, you need to place the [Alarm Number Acquisition Key] switch.</li> </ul>




■ **Summary**

Alarm Messages that are currently triggered are displayed in a list.

◆ **Basic**

Set the format of the Alarm Summary display.

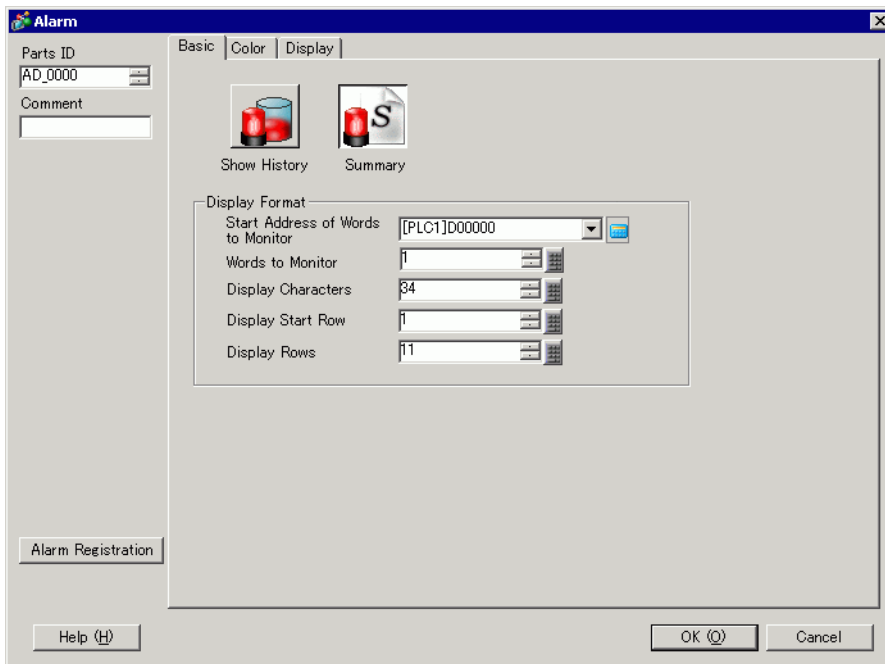


Setting	Description
Display Format	Set the format of the Alarm Summary display.
Start Address of Words to Monitor	Set the top address of the monitoring bit for the Alarm Message designated in [Alarm].
Words to Monitor	Set the number of words allotted for the Monitoring Bits from 1 to 100. <b>NOTE</b> • For the number of monitoring words, 1 word is treated as 16 bits. For 32 bit devices, set the number of monitoring words to multiples of 2 (2, 4, 6, and so on).
Display Characters	Set the maximum number of Alarm Message characters that can display on one row from 1 to 160.

Continued

Setting	Description
<p style="writing-mode: vertical-rl; transform: rotate(180deg);">Display Format</p> <p>Display Start Row</p>	<p>Designate the row of the currently active Alarm Messages to start a display from 1 to 1600.</p> <p>When multiple alarms are triggered, the extra rows that did not fit into a single Alarm part can be seen by setting a different display start row for several Alarm parts.</p> <div style="text-align: center;"> </div>
<p>Display Rows</p>	<p>Set how many Alarm Message rows will display at maximum on one screen from 1 to 50.</p>

◆ **Color**


Select the color when the Alarm Message is not displayed. (The Alarm Message text color and background color are designated in [Alarm].)

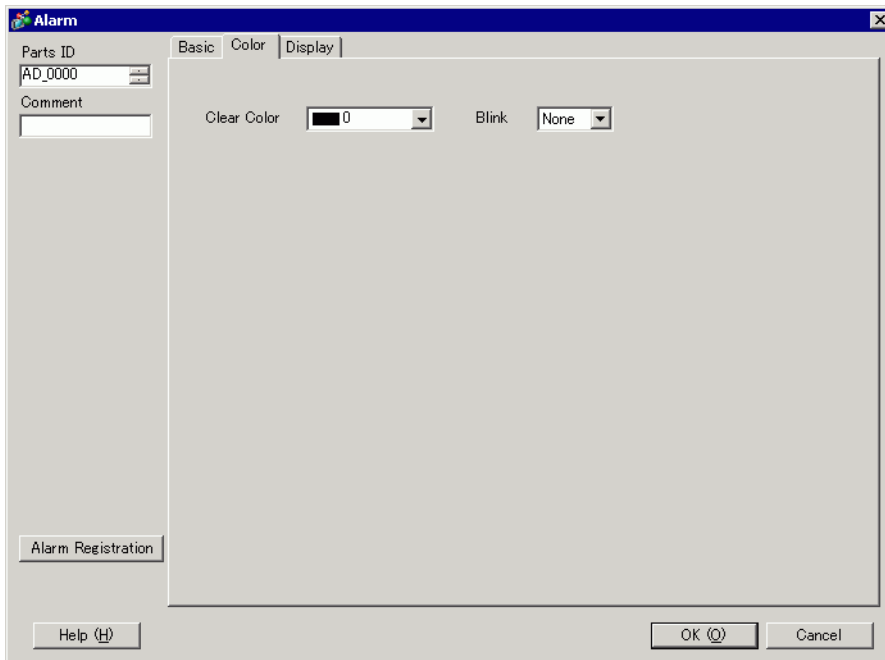

Setting	Description
Clear Color	Select a color used when an Alarm Message is cleared (or not displayed). <b>NOTE</b> • The Alarm Message text color and background color are designated in [Alarm].
Blink	Select the blink and blink speed. You can choose blink settings for [Clear Color]. <b>NOTE</b> • There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings]. ☞ "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)

## ◆ Display

Set a font and border for the Alarm Message.

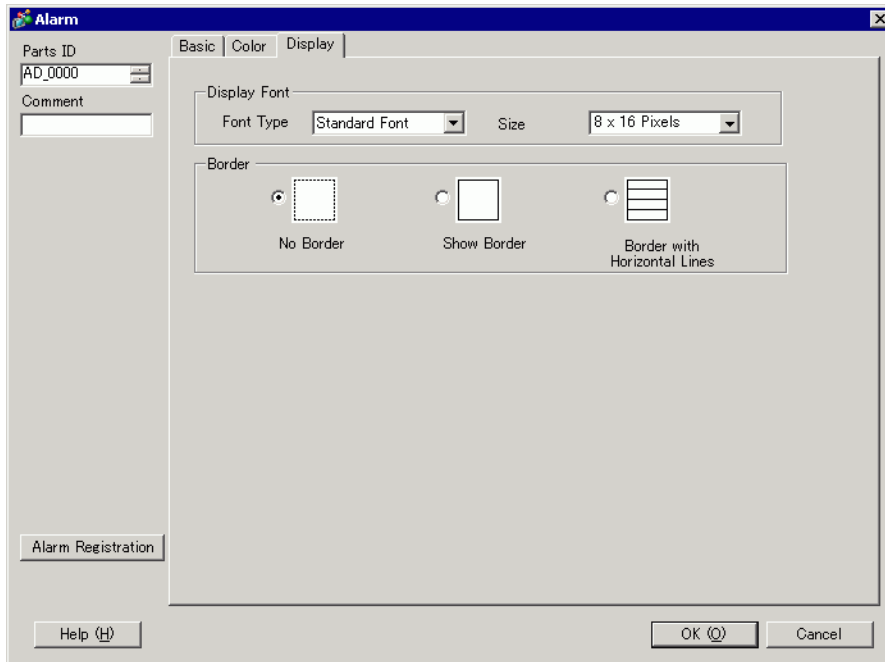

Setting	Description
Display Font	Set a font for the text.
Font Type	Choose a font type for the Alarm Message from [Standard Font] or [Stroke Font].
Size	Choose a font size for the Alarm Message. Standard Font: Specify "Width x Height" between [8 x 8] to [64 x 128] in 8 dot units, or select a fixed size from [6 x 10], [8 x 13], [13 x 23]. When using fixed sizes, you can display only single-byte alphanumeric characters. Stroke Font: 6 to 127
Border	Choose the Alarm Message border from [No Border], [Show Border], or [Show Border + Horizontal Ruled Line]. <b>NOTE</b> • The color of the border and ruled line is fixed to white.


### 19.10.3 Text Alarm Part Settings Guide

#### ■ Text Alarm

A Message registered on a Text Screen is displayed by each row. (It does not need to be registered in Common [Alarm].)

Among the Messages registered as a batch on a Text Screen, only the necessary rows are listed on the screen. Each message can be displayed as a Sub Screen so this is useful for showing troubleshooting guides.


☞ "19.11.4 Text Alarm Part Restrictions" (page 19-162)

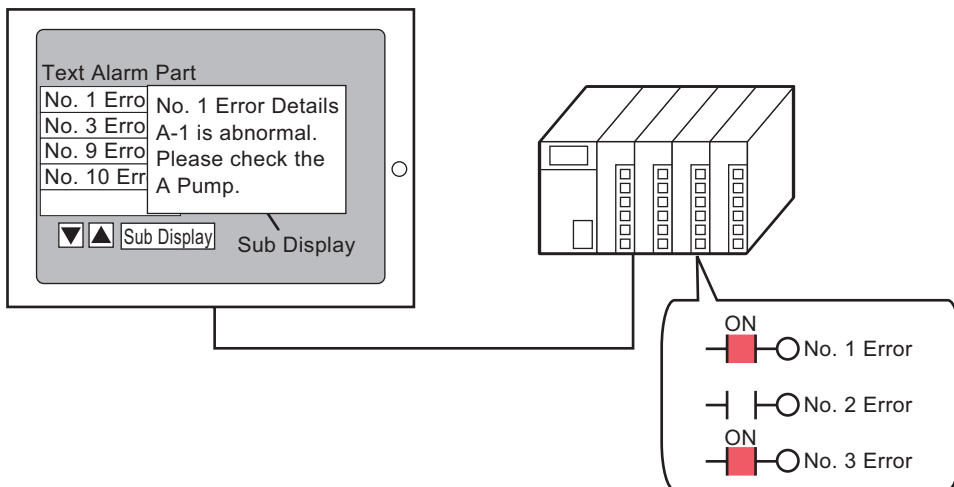

When the bit turns ON, the message is displayed. When the bit turns OFF, the message is erased.


◆ **Basic**

Configure settings to display alarm messages registered on a Text Screen.

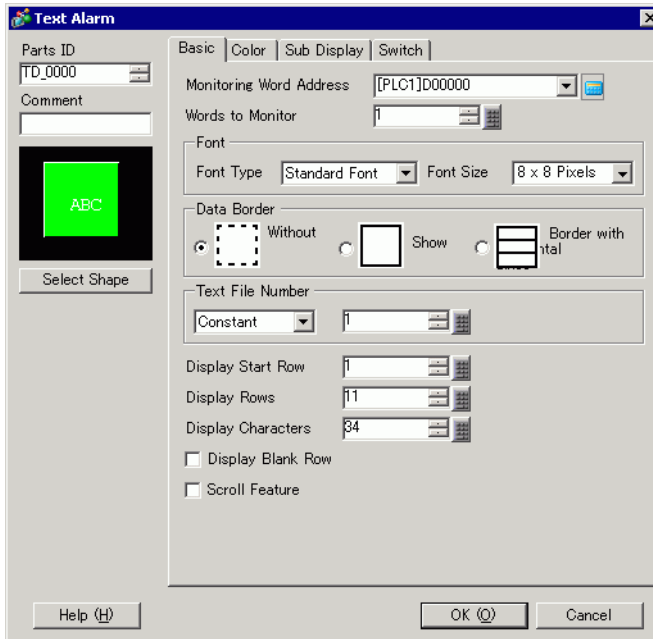


Setting	Description
Monitoring Word Address	<p>Set the word which contains the monitoring bit top address. When the Monitoring Word Address is set, one monitoring bit is allotted to each row of the text.</p>
Words to Monitor	<p>Set the number of words allotted for the Monitoring Bits from 1 to 32. Set the number according to the number of rows inputted in the text. When the device address is expressed as 32 bits, one address contains two words.</p>
Font	<p>Set a font for the Alarm Message to be displayed.</p>
Font Type	<p>Choose a font type for the Alarm Message from [Standard Font] or [Stroke Font].</p>
Font Size	<p>Choose a font size for the Alarm Message.                      Standard Font: Specify "Width x Height" between [8 x 8] to [64 x 128] in 8 dot units, or select a fixed size from [6 x 10], [8 x 13], [13 x 23]. When using fixed sizes, you can display only single-byte alphanumeric characters.                      Stroke Font: 6 to 127</p>

Continued

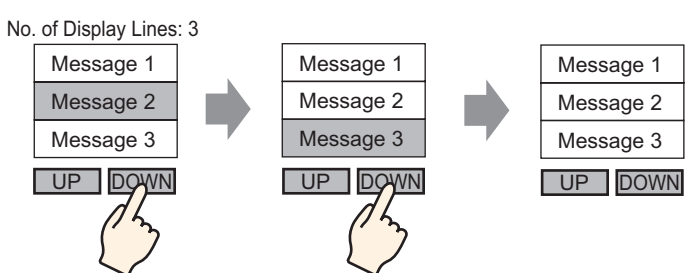Setting	Description
Data Border	Choose the ruled line of the Text Alarm Part from [Without Ruled Line], [Show Border], or [Show Border + Horizontal Ruled Line]. <b>NOTE</b> • The color of the border and ruled line is fixed to white.
Text Number	Set the text Number of the text to be displayed. Select the designation method of the text Number from [Constant] or [Address]. <ul style="list-style-type: none"> <li>• Constant Designate a set constant as the Text File Number (Direct Specification)</li> <li>• Address Select an address that will store the Text Number. (Indirect Specification)</li> </ul>
Text Screen Number	Set the text Number from 1 to 8999.
Display Start Row	Designate the row of the currently active Alarms to start a display from 1 to 512. <b>NOTE</b> • When [Show Blank Row] is selected, the maximum number of rows is 512 including blank rows.
Display Rows	Set how many Alarm Message rows will display at maximum on one screen from 1 to 50.
Display Characters	Set the maximum number of Alarm Message characters that can display on one row from 1 to 100.
Show Blank Row	Specify whether to display any blank lines in the text as an Alarm Message.
Scroll Feature	Set whether to use the scroll feature or not. When the scroll feature is not used, touching the cursor moving switch does not move the cursor to the messages out of the display area, and the cursor disappears.  

◆ **Color**

Set the color of the Alarm Message.

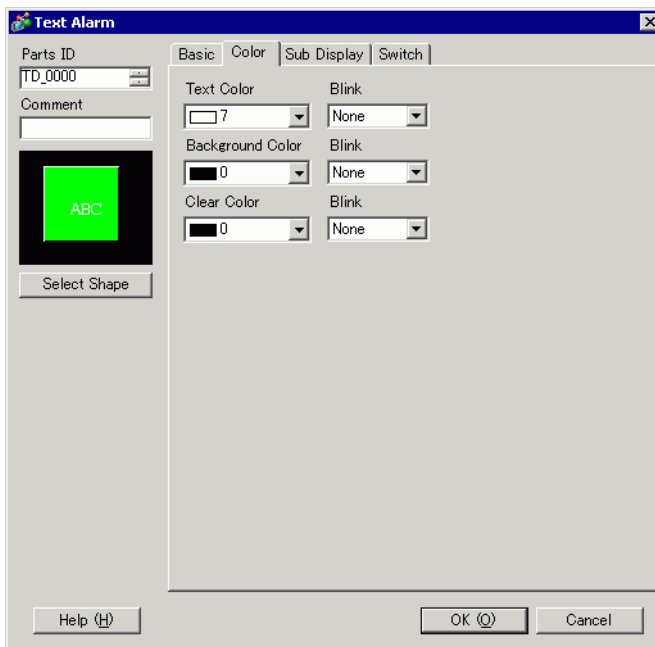



Setting	Description
Text Color	Select a color for the message text.
Background Color	Select a background color for the message text.
Clear Color	Select a color used when an Alarm Message is cleared (or not displayed).
Blink	<p>Select the blink and blink speed. For the [Font Color], [Background Color], and [Clear Color], you can define blink settings.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].                      ⤵ "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</li> </ul>



◆ **Sub Display/Basic**

Configure settings to display a sub screen corresponding to each Alarm Message.

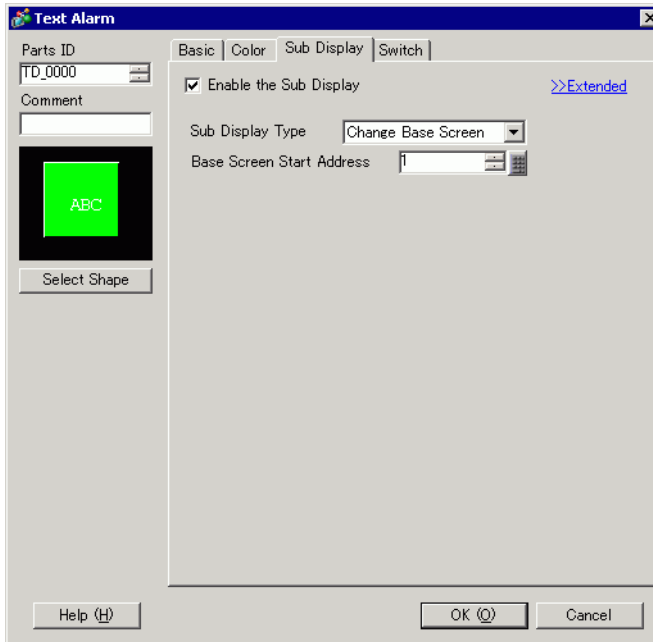

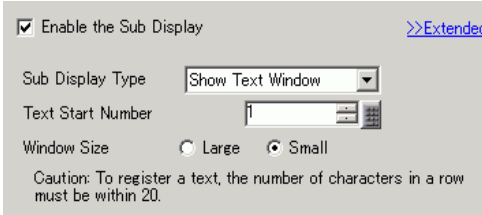
Setting	Description
Enable the Sub Display	Select whether or not to use a Sub Display.
Sub Display Unit	<p>Select the Sub Display Type.</p> <ul style="list-style-type: none"> <li>• Change Base Screen This setting changes the entire screen to another screen. It works the same as a normal screen change.</li> <li>• Show Text Window Display the registered text in a Window.</li> </ul> 
Base Screen Start Address	When setting [Sub Display Type] to [Change Base Screen], set the Start Base Screen Number to change screens with the Sub Display from 1 to 9999.
Text Start Number	When setting [Sub Display Type] to [Show Text Window], set the Start Text File Number to display in the Sub Screen from 1 to 8999.

Continued

Setting	Description
Window Size	<p>When the [Sub Display Type] is [Show Text Window], select [Big] or [Small] to choose the window size.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"><li>• The maximum number of text characters on one line of a window is as follows. Big Window Size: Up to 30 characters Small Window Size: Up to 20 characters</li></ul>



◆ **Sub Display/Extended**

Configure settings to change a Base or Window Screen into a Sub Screen, or to use a Picture Display or a Message Display to display a sub screen on a Base or Window Screen.


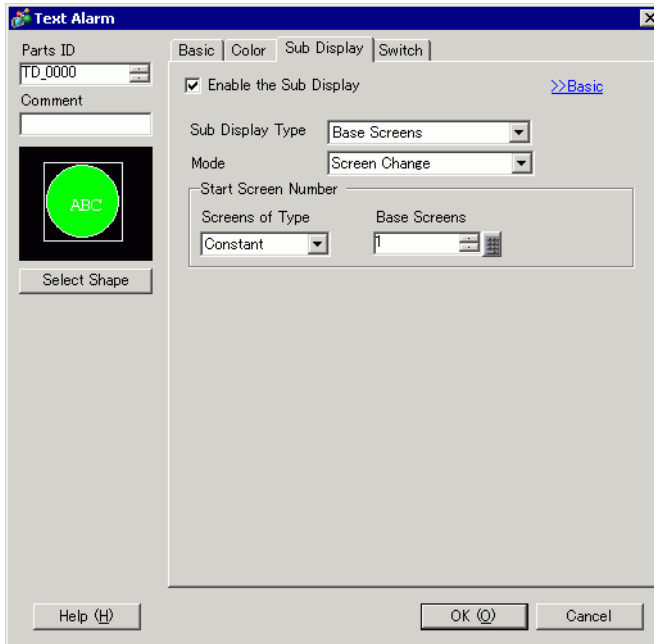


Setting	Description
Enable the Sub Display	Select whether or not to use a Sub Display.
Sub Display Unit	Select the Sub Display Type. <ul style="list-style-type: none"> <li>• Base Screen Change the display to other screen, or display pictures or text on a base screen.</li> <li>• Window Screens Display a Sub Screen in a Window. Change the window to another one, or display a picture or text in the Window.</li> </ul>
Action	Select the Sub Display action type. When [Base Screen] is selected for [Sub Display] <ul style="list-style-type: none"> <li>• Screen Change Change the Base Screen to display the sub screen.</li> <li>• Change Picture Display Use a Picture Display to display the sub screen.</li> <li>• Text Display Change Use a Message Display to display the sub screen.</li> </ul> When [Window] is selected for [Sub Display] <ul style="list-style-type: none"> <li>• Window Change Change the Window Screen to display the sub screen.</li> <li>• Change Picture Display Use a Picture Display on the Window Screen to display the sub screen.</li> <li>• Text Display Change Use a Message Display on the Window Screen to display the sub screen.</li> </ul>



Continued

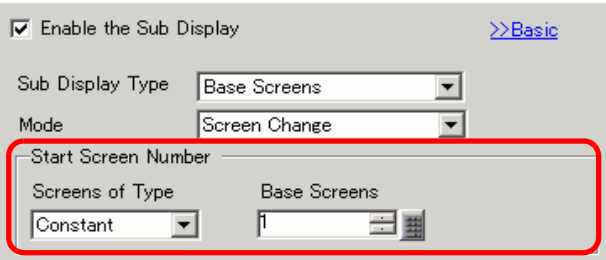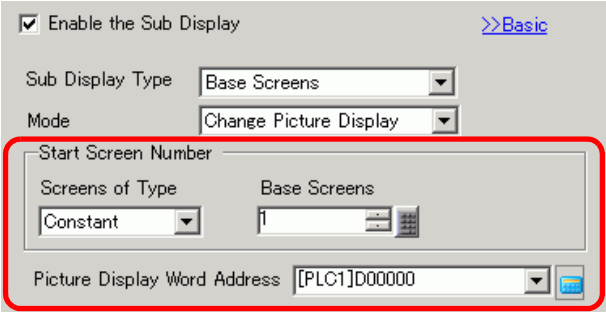Setting	Description
<p>[Base Screen] - [Screen Change]</p>	<p>This setting changes the entire screen to another screen. This operation works the same as a normal screen change.</p> 
<p>Start Screen</p>	<p>Set the Base Screen Start Number to display a sub screen. Select the method to designate the screen Number from [Constant] or [Address].</p> <ul style="list-style-type: none"> <li>• Constant Designate a set constant as the Base Screen Start Number. The setting range is from 1 to 9999.</li> <li>• Address Select a word address that stores the Base Screen Start Number</li> </ul>
<p>[Base Screen] - [Screen Change]</p>	<p>Display a picture corresponding to the Alarm Message in the Picture Display placed on the same screen as the Text Alarm Part.</p> 
<p>Start Screen</p>	<p>Set the start number of the Base Screen for the sub display in the Picture Display Select the method to designate the screen Number from [Constant] or [Address].</p> <ul style="list-style-type: none"> <li>• Constant Designate a set constant as the start Number of the screen used for picture display. The setting range is from 1 to 9999.</li> <li>• Address Select a word address that stores the start Number of the screen used for picture display.</li> </ul>


Continued

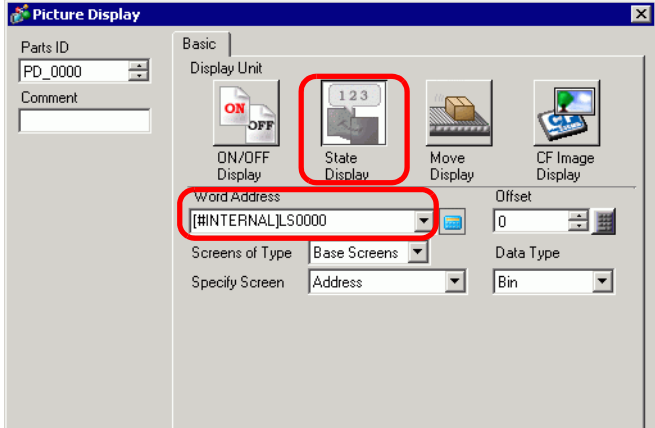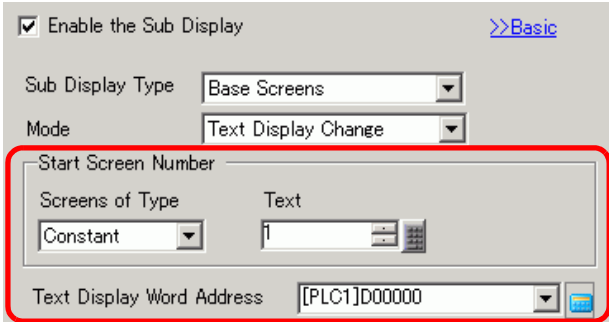Setting	Description
<p>[Base Screen] - [Screen Change]</p> <p>Picture Display Word Address</p>	<p>Set a word address to store the screen Number of the screen displayed in a Picture Display.</p> <p>Set the same address as the [Word Address] of the Picture Display placed on the same screen as the Text Alarm Part.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• With [State Display] selected, in [Screens of Type] select [Base Screen], in [Specify Screen] select [Address], and in [Data Type] select [Bin].</li> </ul>
<p>[Base Screen] - [Text Display Change]</p>	<p>Display a text corresponding to the Alarm Message in the Message Display placed on the same screen as the Text Alarm Part.</p> 
<p>Start Screen</p>	<p>Sets up the start number for the sub display's text that will appear in the "Message Display".</p> <p>Select the method to designate the text Number from [Constant] or [Address].</p> <ul style="list-style-type: none"> <li>• Constant Designate a set constant as the Text's Start Number. The setting range is from 1 to 8999.</li> <li>• Address Select a word address that stores the Text's Start Number.</li> </ul>


Continued

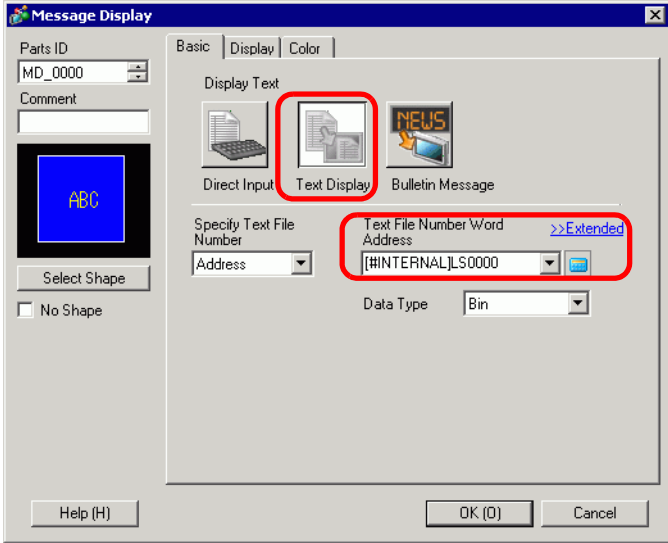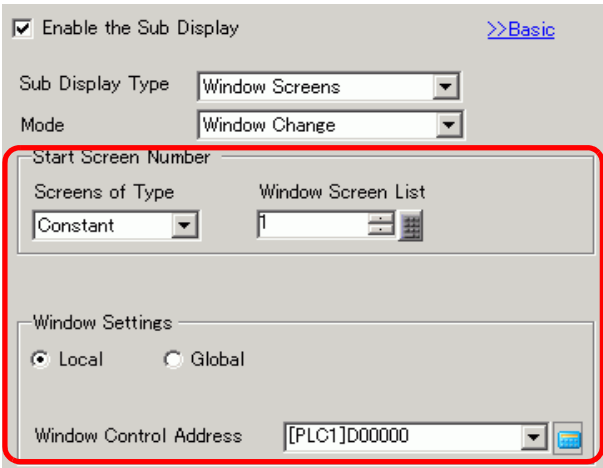Setting	Description
<p>[Base Screen] - [Text Display Change]</p> <p>Text Display Word Address</p>	<p>Set a Word Address to store the Text File Number of the text displayed in a Message Display.</p> <p>Set the same address as the [Text File Number Word Address] of the Message Display placed on the same screen as the Text Alarm Part.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Message Display [Text Display]'s [Specify Text File Number] to [Address], and [Data Type] to [Bin].</li> </ul>
<p>[Window] - [Window Change]</p>	<p>Displays the Window Screen which corresponds to the Alarm Message.</p> 

Continued

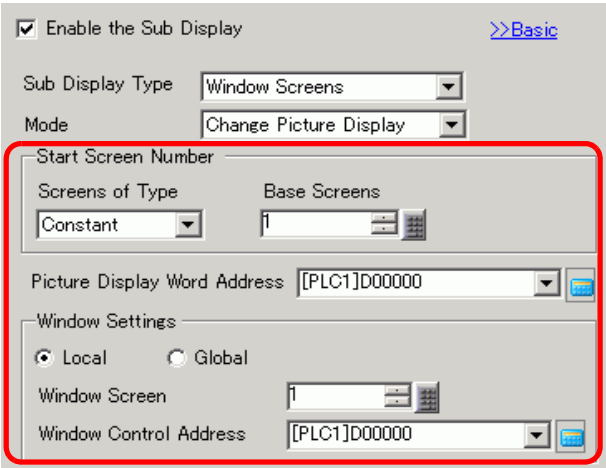
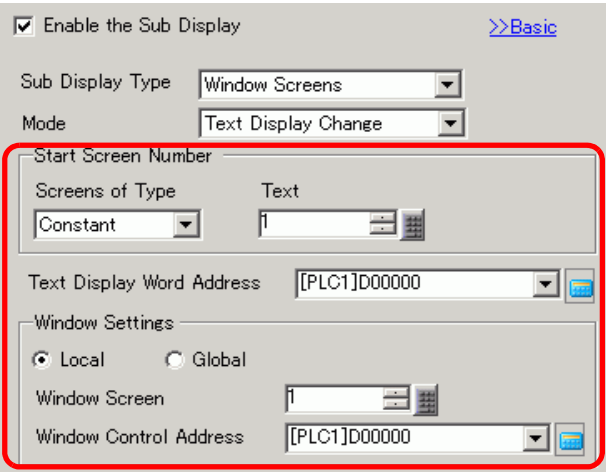
Setting	Description
	<p>Defines the sub display window screen start number Select the method to designate the Window Screen from [Constant] or [Address].</p> <ul style="list-style-type: none"> <li>• Constant Designate a set constant as the start Number of the Window Screen used for a Sub Display. The setting range is from 1 to 2000.</li> <li>• Address Set the address where the Start Screen of the Window Screen used for a Sub Display is stored.</li> </ul>
[Window] - [Window Change]	<p>Window Settings</p> <p>Configure the Window settings.</p>
	<p>Local/Global</p> <p>Defines whether to use a local window or global window for the Sub-Display.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• To use a global window, refer to "12.6.2 Setup Procedure" (page 12-19). On the [System Settings] window, select [Display Unit]. In the [Action] tab, set [Global Window Operation] to [Indirect], and [Data Type] to [Bin]. Use LS16 to display or erase the Window.</li> </ul>
	<p>Window Control Address</p> <p>To use a local window for a Sub Display, designate the address used to control the window display. Four consecutive words will be used, starting from the designated address. Set the same address as the [Window Control Address] of the Window Part placed on the same screen as the Text Alarm Part. ☞ "12.7.2 Word Action" (page 12-24)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• Set the Window Part [Window Specification] to [Address], and [Data Type] to [Bin].</li> </ul>
[Window] - [Change Picture Display]	<p>Display a picture corresponding to the Alarm Message in the Picture Display placed on the Window Screen.</p> 

Continued

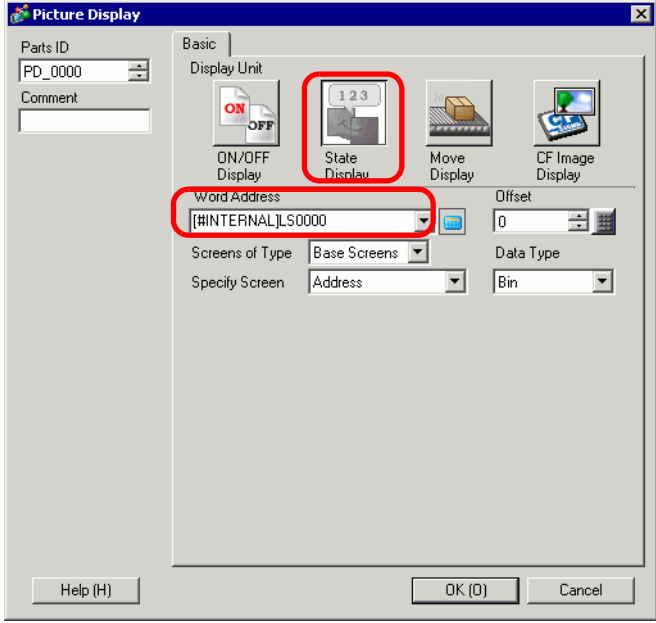
	Setting	Description
[Window] - [Change Picture Display]	Start Screen	<p>Set the Base Screen Start Number to display a sub screen for a Picture Display on the Window Screen. Select the method to designate the screen Number from [Constant] or [Address].</p> <ul style="list-style-type: none"> <li>• Constant Designate a set constant as the start Number of the screen used for picture display. The setting range is from 1 to 9999.</li> <li>• Address Select a word address that stores the start Number of the screen used for picture display.</li> </ul>
	Picture Display Word Address	<p>Set a word address to store the screen Number of the screen displayed in a Picture Display. Set the same address as the [Word Address] of the Picture Display placed on the Window Screen.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• With [State Display] selected, in [Screens of Type] select [Base Screen], in [Specify Screen] select [Address], and in [Data Type] select [Bin].</li> </ul>
	Window Settings	<p>Configure the Window settings.</p> <p>Local/Global</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>• To use a global window, refer to "12.6.2 Setup Procedure" (page 12-19). On the [System Settings] window, select [Display Unit]. In the [Action] tab, set [Global Window Operation] to [Indirect], and [Data Type] to [Bin]. Use LS16 to display or erase the Window.</li> </ul>

Continued




Setting		Description
[Window] - [Change Picture Display]	Window Screen	Designate the Screen Number of the window used for a Sub Display from 1 to 2,000.
	Window Settings Window Control Address	<p>To use a local window for a Sub Display, designate the address used to control the window display. Four consecutive words will be used, starting from the designated address.</p> <p>Set the same address as the [Window Control Address] of the Window Part placed on the same screen as the Text Alarm Part.</p> <p> "12.7.2 Word Action" (page 12-24)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Window Part [Window Specification] to [Address], and [Data Type] to [Bin].</li> </ul>
[Window] - [Text Display Change]		<p>Display a text corresponding to the Alarm Message in the Message Display placed on the Window Screen.</p> 
	Start Screen	<p>Set the Start Number of the text for a sub screen displayed in a Message Display on the Window Screen.</p> <p>Select the method to designate the text Number from [Constant] or [Address].</p> <ul style="list-style-type: none"> <li>Constant Designate a set constant as the Text's Start Number. The setting range is from 1 to 8999.</li> <li>Address Select a word address that stores the Text's Start Number.</li> </ul>



Continued

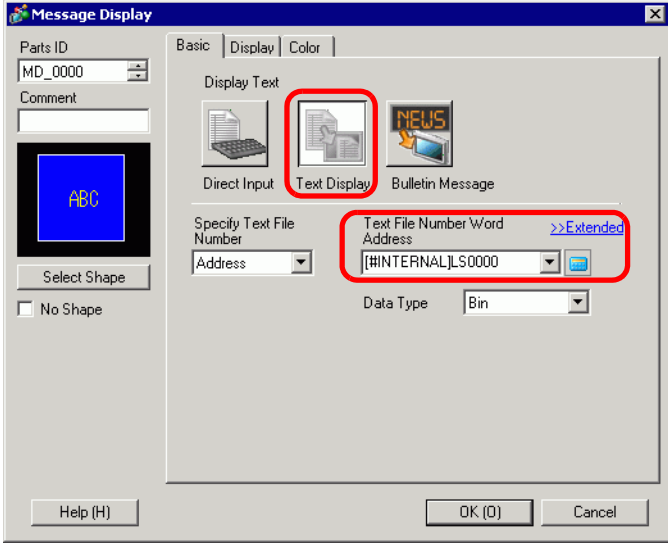	Setting	Description
Text Display Change	Text Display Word Address	<p>Set a Word Address to store the Text File Number of the text displayed in a Message Display. Set the same address as the [Text File Number Word Address] of the Message Display placed on the Window Screen.</p>  <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Message Display [Text Display]'s [Specify Text File Number] to [Address], and [Data Type] to [Bin].</li> </ul>
	Window Settings	Configure the Window settings.
	Local/Global	<p>Set whether to use a local window or global window for a Sub Display.</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>To use a global window, refer to "12.6.2 Setup Procedure" (page 12-19). On the [System Settings] window, select [Display Unit]. In the [Action] tab, set [Global Window Operation] to [Indirect], and [Data Type] to [Bin]. Use LS16 to display or erase the Window.</li> </ul>
	Window Screen	Designate the Screen Number of the window used for a Sub Display from 1 to 2,000.
Window Control Address	<p>To use a local window for a Sub Display, designate the address used to control the window display. Four consecutive words will be used, starting from the designated address.</p> <p>Set the same address as the [Window Control Address] of the Window Part placed on the same screen as the Text Alarm Part.</p> <p>☞ "12.7.2 Word Action" (page 12-24)</p> <p><b>NOTE</b></p> <ul style="list-style-type: none"> <li>Set the Window Part [Window Specification] to [Address], and [Data Type] to [Bin].</li> </ul>	


◆ **Switch**

Select an operation switch to display an Alarm Message. Using a Sub Display requires an operation switch to designate the message to display its sub display.

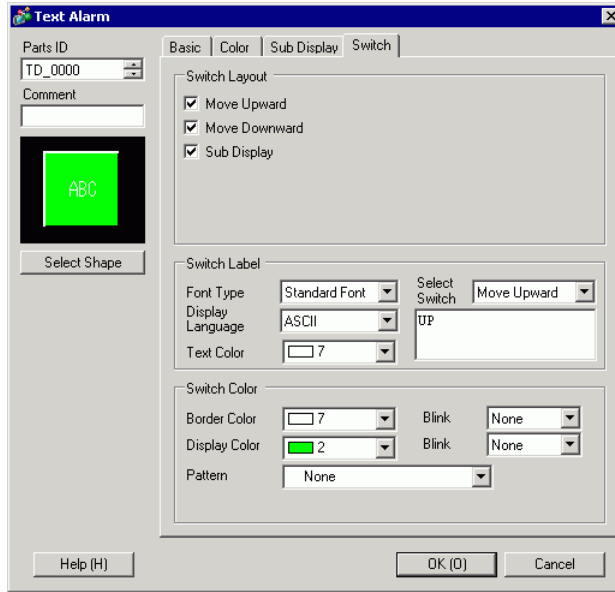

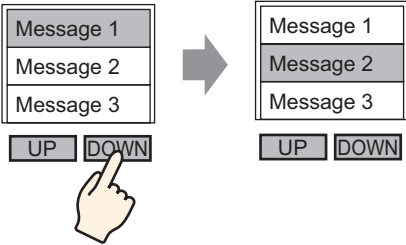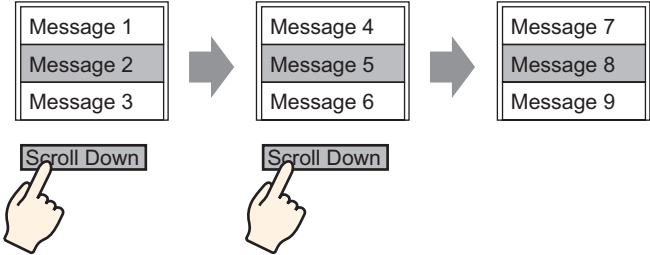
Setting	Description
Switch Layout	Set the Switches to be placed.
Move Upward/ Move Downward	<p>Moves the cursor 1 row up or down.</p> 
Sub Display	Shows the Sub Display of the message currently selected with the cursor.
Scroll Up/Scroll Down	<p>Alarm Messages that are currently displayed are scrolled up or down by a given number of rows. For example, Number of Active Alarms: 9, Display Rows: 3, Rows to Move: 3</p> 
Rows to Move	Set the number of rows to scroll up and scroll down from 1 to 512.

Continued

Setting		Description
	Exit	Set a switch to end the Text Alarm. Touching the switch erases the cursor as well as the Sub Display.
Switch Label		Set the Switch label.
	Font Type	Choose a font type for the switch label from [Standard Font] or [Stroke Font].
	Display Language	Select a language for the switch label from [Japanese], [Western], [Chinese (Traditional)], [Chinese (Simplified)], [Korean], [Cyrillic], or [Thai].
	Text Color	Select a color for the switch label.
	Select Switch	Select the switch to which the label is set.
	Label	Input the text of the label. <b>NOTE</b> <ul style="list-style-type: none"> <li>• Select the switch and press the [F2] key to directly edit the text of the label.</li> </ul>
Switch Color		Set the switch color. <b>NOTE</b> <ul style="list-style-type: none"> <li>• The Switch Color setting is common to all Text Alarm parts, regardless of the switch type selected.</li> </ul>
	Border Color	Select a border color for the Switch.
	Display Color	Set the switch color.
	Pattern	Select the switch pattern from 9 types.
	Pattern Color	Specify the pattern color when you select options other than [No Pattern].
	Blink	Select the blink and blink speed. You can set up blink settings for the [Border Color], [Display Color], and [Pattern Color]. <b>NOTE</b> <ul style="list-style-type: none"> <li>• There are cases where you can and cannot set Blink depending on the Display Unit and System Settings' [Color Settings].   "8.5.1 Setting Colors ■ List of Compatible Colors" (page 8-36)</li> </ul>

**NOTE**


- If you want to change the shape and color of each switch, create a switch with a Special Switch of a Switch Lamp Part (Text Alarm Switch).  
 10.15.4 Special Switch ◆ Text Alarm Switch 10-74
- If [Scroll Feature] is not set on the [Basic] tab, the messages are not scrolled even when the [Move Upward], [Move Downward], [Scroll Up], or [Scroll Down] switch is touched. The cursor moves only within the display area.

## 19.11 Restrictions

### 19.11.1 Restrictions for Printing Alarm History

- If you select colors other than black and white from the Print Format Settings - [Trigger Color], [Acknowledged Color], or [Recovery Color] options, or if the text to print goes beyond the page margins, some printers may not print out normally.
- ◆ **[Real-time Print]**
- In the Real-time Print, block names such as "Message", "Date", and "Trigger" are not printed.
  - The GP unit can store printing information for a maximum of 1,000 Alarm Messages (Banner) and Alarm Histories. If no printer is connected to the GP, it can still store up to 1000 messages, but any messages over 1000 will be lost while the GP is waiting to print.
  - If the printer goes offline during printing due to a paper jam or some other reason, fix the printer error without turning off the display unit. Print information stored in the GP will be sent to the printer when it comes back online.
  - If the printer's power goes off during printing, the data sent from the GP during that time will not be printed.
  - (Real Time Printing) which prints data every time sampling occurs, or (Block Unit Printing) which prints data in collected groups. This is because the printers don't support paper feed per line.
  - In Real-time, data is not printed.
- ◆ **[Batch Print]**
- Alarms that are triggered or recover during printing will not be printed. Alarm information which exists when printing starts will be printed.
  - If the GP unit turns OFF during printing, printing will not continue when power is turned back ON. If the trigger bit is ON when power is turned back ON, printing will start from the beginning.
  - When turning the print trigger bit from ON to OFF or from OFF to ON, be sure to allow at least one communication cycle<sup>\*1</sup> or one Display Scan Time period<sup>\*2</sup>, whichever is longer.
  - If the number of stored alarms is set to "0" on the [Alarm] - [Common] tab, or if no alarms have yet been triggered, "Number of Messages = 0" will be printed.
  - If the number of stored alarms is set to "0" on the [Alarm] - [Common] tab, the [Completion Bit] will not turn ON.
  - Only the first 2 lines of block names, such as [Messages], [Date], and [Trigger] will be printed. However, even if the line extends over several pages, block names will only be printed on the first page.
- \*1 The Communication Cycle Time is the time from when the display unit requests data from the device/PLC, until the display unit receives the data. It is stored in the internal device LS2037 as binary data. The unit is 10 milliseconds (ms).
- \*2 Display Scan Time is the time required to process one screen. It is stored in the internal device LS2036 as binary data. The unit is in milliseconds (ms).

- When the alarm message language is set to Japanese, item names such as "Message", "Date", or "Trigger" are output in Japanese. When using any other language (ASCII, Korean, Chinese (Simplified), Chinese (Traditional), Cyrillic or Thai), the item names are output in English.

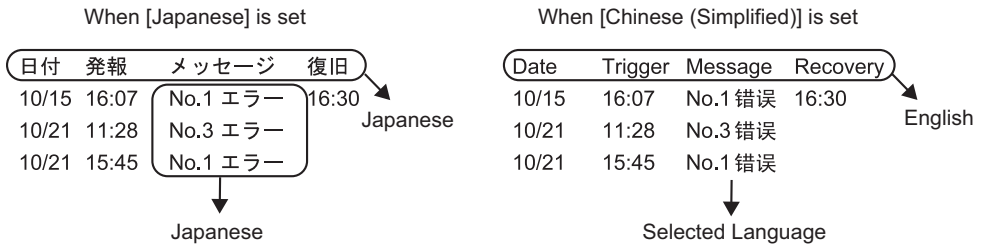

## 19.11.2 Restrictions for Sub Display/Extended

- The Message Display [Text Display] and Picture Display [State Display] Word Addresses as well as Window Part window control addresses used for a Sub Display are set only in the address of the internal device (LS area, user area).
- The cursor movement and sub display are not linked. Even when the cursor moves, the sub display remains the same.
- Sub displays will not be cleared automatically. Even when an Alarm Message in the sub screen is cleared, the sub display still remains. When, however, the screen is changed, "0" is written to the word address of the Picture Display [State Display] and Message Display [Text Display], and window control address used for the sub display, and the sub display is cleared.
- When displaying a sub screen, only one Alarm Part (History Display) can be set on each base screen. If multiple Alarm Parts (History Display) are set, a sub display is disabled.
- When [Direct Selection] is set, buttons may be hard to touch depending on the calibration of the touch panel<sup>\*1</sup> and the message line spacing.
- When [Play Movie] is selected as the Sub Display, the [Sub Display Screen Number] specified in the [Alarm] acts as the index number of the Movie File played on the [Movie Player]. Define a value from 0 to 99.

Assigning "0" to the Sub Display Screen Number specifies Index Number "0" in the Movie File. For alarms not requiring a Sub Display, assign "9999" to the Sub Display Screen Number.

If you assign the index number of a Movie File that does not exist, then the player will stop.

- Bit 8 (Play Bit) of the specified [Play Control Word Address] is used to control play operations. To stop playing the movie, create a switch to turn the Play Bit OFF instead of using a typical stop operation.
- When the Video Display bit is ON, the Video Display takes precedence over the Alarm Sub Display. The Alarm Sub Display is hidden but continues operating. When the Video Display turns OFF, the Alarm Sub Display video continues playing from the elapsed period of time.
- The window size for Show Text Window includes two types according to the size of the window to be displayed: [Large] and [Small]. For the following models, the window is not fully displayed on the GP when the window size is set to [Large].<sup>\*2</sup> Be sure to set the window size to [Small] for these models.

GP-3200 Series/GP-3300 Series/ST-3200 Series/ST-3300 Series/  
LT-3200 Series/LT-3300 Series

\*1 The adjustment of the touch panel's touch area and display so that their settings synchronize. This can be set in the GP unit.

\*2 Models with a resolution other than 320x240 dots (QVGA) are excluded. Refer to the following for resolution.



"5.17.6 [System Settings] Setting Guide ■ [Display] Settings Guide" (page 5-145)

### 19.11.3 Restrictions for Running External Operations from Multiple Display Units

External operations can be performed by multiple GP units at the same time. However, a time lag will occur due to each display unit's read time, and the order in which the operations are performed and the [Completion Bit] turns ON will differ. Set the operation code after verifying that every [Completion Bit] in each GP has turned OFF. Also, when clearing the operation code to "0", ensure that every [Completion Bit] in every GP has turned ON.

For example:

Set the same external operation [Control Word Address] for multiple GP units (GP1, GP2), and set the [Completion Bit] to separate addresses for each GP.

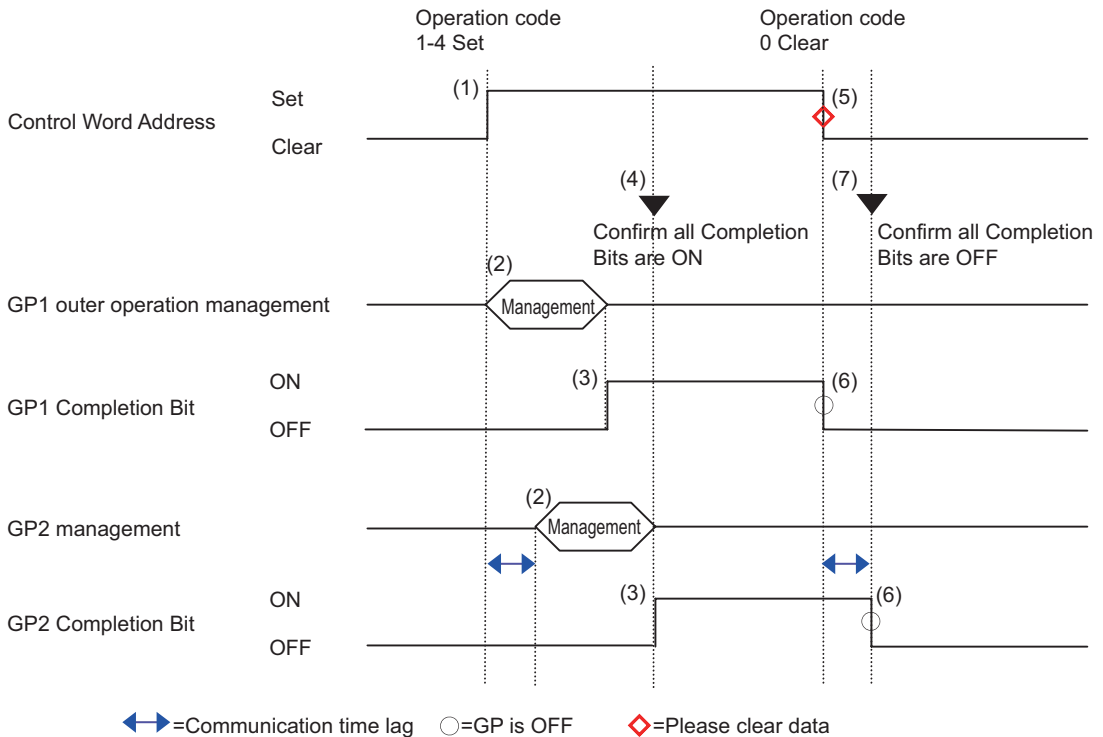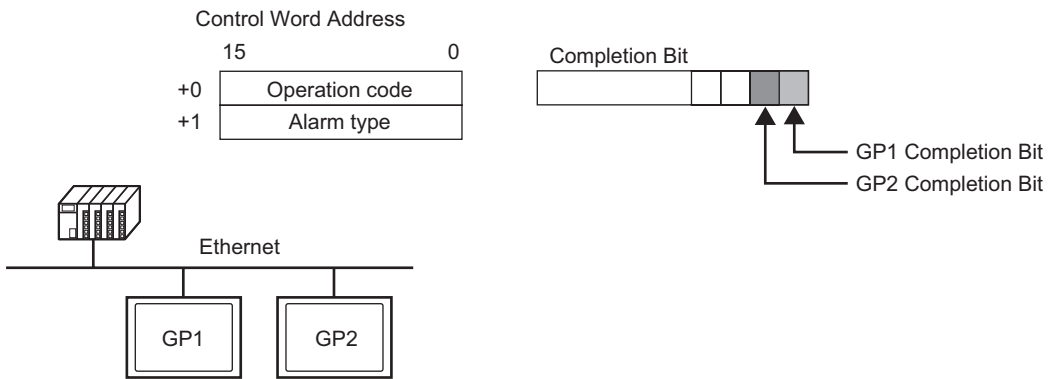



- 1 Set the operation code and alarm type in the [Control Word Address] from the PLC.
- 2 GP1 and GP2 process orders from the PLC.
- 3 When the operations finish, the GP1 and GP2 [Completion Bit] turns ON.
- 4 The PLC verifies that each [Completion Bit] in all the GP units is now turned ON.
- 5 Run the [Control Word Address]'s [Operation Code] "0" (no operation) from the PLC.
- 6 When the GP writes "0" as the [Operation Code], the [Completion Bit] turns OFF.
- 7 The PLC verifies that each [Completion Bit] in all the GP units is now turned OFF.

---

**NOTE**

- In case the power gets turned OFF during the process, set the [Control Word Address] to 0 clear and turn OFF [Completion Bit] for all settings.
  - While running operations on multiple GP units from the PLC, alarms that are triggered or recovered may not be the same on each GP unit.
  - In [Alarm], [Common], when [Print Settings] is set to [Real-time Print], if you run an external operation to acknowledge all within a block, the acknowledge order will be [History], [Log], [Active]. If the same message is registered in both [History] and [Log], the History acknowledge time and Log acknowledge time will both be printed in Real-time, so the same acknowledgment message will be printed twice.
-

---

### 19.11.4 Text Alarm Part Restrictions

---

- Only one Text Alarm can be set to a single Base Screen. To display two or more Text Alarm Parts on one screen, use a Window Screen.
- The maximum number of display characters on one row is decided by the GP model and the text size.
- If the Alarm Message is wider than the display area, the portion that exceeds the area is truncated and is not displayed.
- When the Text File Number of the text displayed in the Text Alarm Part is changed during operation, the cursor and sub display are cleared.
- When too many alarms arise simultaneously, you can place Text Alarm Parts on multiple screens and designate [Display Start Row] as follows to view the messages by changing screens.
  - 1st screen: Start row (normally "1")
  - 2nd screen: Number of display rows on one screen + Start row
  - nth screen: Number of display rows on one screen x (n-1) + Start row
- The Base Screen Number or Text File Number used for a sub display should be created in sequential numbers in the same order as the text rows to which Alarm Messages are registered.
- The Base Screen and Text used for a Sub Display use screens equal to "(16 x Words to Monitor) + 1". These screens cannot be used for other purposes.
- When the cursor is cleared during a sub display (the cursor is moved to the place outside of the display area, or the "End" switch is touched), the sub display is also be cleared.
- The value of "the designated [Start Screen] + (Words to Monitor x 16)" is used as the Clear Base Screen Number or Clear Text File Number to clear the sub display. For example, when the Start Screen is "100" and the Words to Monitor is "1", Screen Nos. 100 to 115 are used for the sub display screen and Screen Number 116 is used for the clearing screen.
- When a sub screen is displayed with a Message Display [Text Display] and no clearing text is provided, the sub screen is cleared with [Clear Color] designated for the Message Display.
- When a screen with a sub screen is changed, the sub screen is cleared. The GP writes "0" to the designated word addresses of the Picture Display [State Display], Message Display [Text Display], and Window Part used for a Sub Display.
- When [Start Screen] of the sub display is designated with [Address], do not change the Start Screen while the sub screen is displayed. This may interfere with proper sub display.
- While a Sub Screen is displayed, communication time may increase.

## 19.12 Alarm Feature List

