

PL-7900 Series Panel Computer User Manual

When printing out this PDF manual, since the printer setting can effect the quality of the printout, be sure your printer's quality setting is set to "High".

Preface

Digital's PL-7900 series of Panel Computers (each of which are hereafter referred to collectively as the "PL") are multipurpose factory automation (FA) computers, which embody Digital's latest, cost-effective architecture. Before using the PL-7900 series read this manual thoroughly to familiarize yourself with the PL-7900 series operation procedures and functions.

NOTE:

1. It is forbidden to copy the contents of this manual in whole, or in part, without the permission of the Digital Electronics Corporation.
2. The information in this manual is subject to change without notice.
3. This manual was written with care; however, if you should find any errors or omissions, please contact Digital Electronics and inform them of your findings.
4. Please be aware that Digital is not responsible for any damages resulting from the use of our products, regardless of article 3 above.

Product names used in this manual are the trademarks of their respective manufacturers.

© Copyright 2000, Digital Electronics Corporation

MS-DOS®, Windows®95, and WindowsNT® are registered trademarks of the Microsoft Corporation.

IBM®, and DOS® are registered trademarks of IBM.

Essential Safety Precautions

This manual includes the following cautions concerning procedures that must be followed to operate the PL correctly and safely. Prior to operating the PL, be sure to read this manual and any related materials thoroughly to understand the correct operation and functions of this unit.

Safety Icons

To allow you to use the PL correctly, throughout this manual, the following icons are provided next to operations requiring special attention. These icons are used to describe the following situations:



Indicates situations where severe bodily injury, death or major equipment damage may occur.



Indicates situations where slight bodily injury or machine damage can occur.

WARNINGS

- To avoid the possibility of an electric shock, be sure to connect the power cord to the PL before connecting it to the main power supply.
- A fire or electrical shock may occur if voltages used with the PL are beyond the specified range. Be sure to use only the specified voltage.
- Before opening the PL's protective cover, be sure to turn the unit's power OFF. This is because the PL's internal parts carry high voltages.
- To avoid fires or electrical hazards, do not modify the PL in any way.
- Do not create touch panel switches that are used to either control or to ensure the safety of equipment and personnel. Mechanical switches, such as an emergency stop switch, a deadman (two-handed) start switch, etc., must be installed and operated via a separate control system.

WARNINGS

- Do not create touch panel switches which could possibly endanger the safety of humans and equipment. This is due to the possibility of a malfunction in the PL or its cable(s), causing the output of a signal that could result in a major accident. All of a system's major, safety-related switches should be designed to be operated separately from the PL.
- After the PL's backlight burns out, unlike the PL's "Standby Mode", the touch panel is still active. If the operator fails to notice that the backlight is burned out and touches the panel, a potentially dangerous machine miss-operation can occur.

If your PL's backlight suddenly turns OFF, use the following steps to determine if the backlight is actually burned out.

- 1) If your PL is not set to "Standby Mode" and the screen has gone blank, your backlight is burned out.
 - 2) Or, if your PL is set to Standby Mode, but touching the screen does not cause the display to reappear, your backlight is burned out.
- If metal particles, water or other types of liquids contact any of the PL's internal parts, immediately turn the unit's power OFF, unplug the power cord, and contact either your PL distributor or the Digital Electronics Corporation.
 - Read and understand Chapter 4 "Installation and Wiring" thoroughly in order to select an appropriate installation location for the PL.
 - Before either plugging in or unplugging a board or interface connector, be sure to turn the PL's power OFF.



WARNINGS

- To prevent a possible explosion, do not install the PL in areas containing flammable gases.
- The PL is not appropriate for use with aircraft control devices, aerospace equipment, central trunk data transmission (communication) devices, nuclear power control devices, or medical life support equipment, due to these devices' inherent requirements of extremely high levels of safety and reliability.
- When using the PL with transportation vehicles (trains, cars and ships), disaster and crime prevention devices, various types of safety equipment, non-life support related medical devices, etc. redundant and/or fail-safe system designs should be used to ensure the proper degree of reliability and safety.



CAUTIONS

- Do not push on the PL's screen too strongly, with either your finger or with a hard object. Excessive pressure can scratch, crack or damage the screen. Also, do not use a pointed object, such as a mechanical pencil or screw-driver, to press any of the touch panel's switches, since they can damage the display.
- If the screen becomes dirty or smudged, moisten a soft cloth with diluted neutral detergent, wring the cloth well, and wipe the display. Do not use thinner or organic solvents.
- Avoid exposing the PL to, or operating the PL in direct sunlight, high temperatures and humidity, and in areas where excessive dust and vibration will occur.
- Avoid using the PL in areas where sudden, extreme changes in temperature can occur. This may cause condensation to form inside the unit, possibly leading to an accident.
- To prevent the PL from overheating, be sure its air circulation vents are clear and clean, and keep the unit's operation area well-ventilated.
- Avoid operating or storing the PL near chemicals, or where chemicals can come into contact with the unit.

When PL Hard Disk (HDD) data is lost:

- The Digital Electronics Corporation can not be held responsible or provide any compensation for damage(s) caused by the loss of data stored in the PL's hard disk drive (HDD). It is therefore strongly suggested that all important data and software be backed up regularly to an external data backup device.
- Please be aware that the Digital Electronics Corporation bears no responsibility for any damages resulting from the customer's application of this unit's hardware or software.

- The displayed color will look different when viewed from an angle outside the specified view angle. This is also normal.
- Displaying a single screen image for long periods of time can cause an afterimage to remain on the screen. To correct this, turn the unit OFF for 5 to 10 minutes, then ON again. This phenomenon is a common attribute of the LCDs, and is not a defect. To prevent this effect, you can:
 - use the Display OFF feature; if the same image is to be displayed for a long period of time.
 - change the screen display periodically to prevent the displaying of a single image for a long period of time.

Notes on Handling the Hard Disk Drive

- The Digital Electronics Corporation cannot take responsibility or provide any compensation for damage(s) caused by the loss of data stored in the PL-7900 series' hard disk drive (HDD). It is therefore strongly suggested that all important data and software be backed up regularly to an external data backup device.
- Please be aware that the Digital Electronics Corporation bears no responsibility for any damages resulting from the customer's application of this unit's hardware or software.
- Please be aware that the Digital Electronics Corporation will not provide compensation for any damages occurring as a result of problems with this unit's software or hardware.
- Since the PL's hard disk drive (HDD) is a consumable item, i.e. it has a finite usage lifetime, be sure to back up its data frequently and perform regular maintenance.
- To prevent damage to file data, be sure to shut down the PL's OS before turning OFF the main power.

Table of Contents

Preface

Preface	i
Essential Safety Precautions	ii
Table of Contents	vii
Prior to Using the PL	x
Symbol Information	xi
Package Contents	xii
PL-7900 Series Features	xiii
UL/cUL Application Notes	xiv
CE Marking	xv

Chapter 1 Overview

1-1 System Configuration	1-1
1-2 Options	1-2
1-3 PL Series Panel Types	1-5

Chapter 2 Specifications

2-1 General Specifications	2-1
2-1-1 Electrical Specifications	2-1
2-1-2 Environment Specifications	2-2
2-1-3 Dimensions	2-3
2-2 Performance Specifications	2-4
2-2-1 Performance Specifications	2-4
2-2-2 Display Functions	2-5
2-2-3 Expansion Slots	2-5
2-2-4 Clock(RTC) Accuracy	2-5
2-3 Interface Specifications	2-6
2-3-1 Printer Interface	2-6
2-3-2 Keyboard Interface	2-6
2-3-3 Mouse Interface	2-6
2-3-4 RS-232C Interface (COM1/COM2/COM3)	2-7
2-3-5 RAS Interface	2-7
2-4 PL External Features	2-9
2-5 PL Dimensions	2-11
2-5-1 PL-7900T General Dimensions	2-11
2-5-2 PL-7901T General Dimensions	2-12
2-5-3 Full Sized Cover Attachment Dimensions	2-13
2-5-4 Installation Slot Dimensions	2-14

Chapter 3 Installing Optional Units and Expansion Boards

3-1 Installing Options and Expansion Boards	3-1
3-1-1 Removing the Rear maintenance cover	3-2
3-1-2 Installing the DIM Module (PL-EM220 / PL-EM230)	3-4
3-1-3 Installing the FDD Unit (PL-FD200)	3-5
3-1-4 Installing the FDD Unit (PL-FD210)	3-6
3-1-5 Removing/Installing the HDD unit (PL-HD220)	3-7
3-1-6 Installing an Expansion Board	3-8
3-1-7 Connecting the CD-ROM Unit (PL-DK200)	3-9
3-1-8 Removing the Cooling Fan Unit	3-10

Chapter 4 Installation and Wiring

4-1 Installation Cautions	4-1
4-2 Installing the PL	4-3
4-2-1 Installation Procedures	4-3
4-3 Wiring the PL	4-6
4-3-1 Connecting the Power Cord	4-6
4-3-2 Power Supply Cautions	4-8
4-3-3 Grounding Cautions	4-9
4-3-4 Cautions When Connecting I/O Signal Lines	4-9

Chapter 5 System Setup

5-1 Setup Procedures	5-1
5-2 System Parameters	5-2
5-2-1 STANDARD CMOS SETUP	5-2
5-2-2 BIOS FEATURES SETUP	5-4
5-2-3 CHIPSET FEATURES SETUP	5-6
5-2-4 POWER MANAGEMENT SETUP	5-8
5-2-5 PNP/PCI CONFIGURATION SETUP	5-10
5-2-6 SYSTEM MONITOR UTILITY	5-12
5-2-7 INTEGRATED PERIPHERALS	5-14
5-2-8 IDE HDD AUTO DETECTION SETUP	5-16

Chapter 6 OS Setup

6-1 Setting Up Your PL OS	6-1
6-1-1 Touch Panel Device Driver Settings	6-2

Chapter 7 Maintenance and Inspection

7-1 Regular Cleaning	7-1
7-1-1 Cleaning the Display	7-1
7-1-2 Moisture Resistant Gasket Replacement	7-2
7-2 Cleaning the Filter	7-2

7-3 Replacing the PL Backlight	7-4
7-4 Periodic Check	7-8


Appendix

1 Hardware Configuration	A-1
1-1 I/O Mapping	A-1
1-2 Memory Mapping	A-2
1-3 IRQ Mapping	A-3
2 RAS Feature	A-4
2-1 PL's RAS Features	A-4
2-2 RAS Feature Details	A-5
2-3 RAS Feature Overview	A-9

Index

Prior To Using the PL

Prior to actual use, be sure to setup your PL as follows.

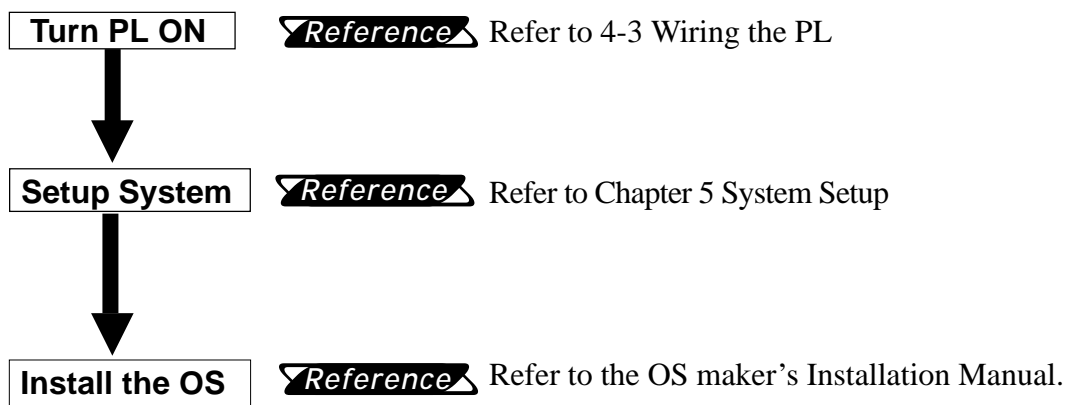





After completing the hardware setup, before any data or applications can be placed on the HDD drive, the OS (Windows® or MS-DOS®, etc.) must be used to initialize the HDD and create partitions. For details concerning these procedures, refer to the OS maker's installation manual.



- The PL-7900T/PL-7901T's hard disk is designed for use with the Windows® 95, Windows NT®4.0 or later OS. The Mirror Disk unit will operate only with the Windows NT®4.0 operating system. Other operating systems do not support this driver software, etc.
- For system setup and OS installation, a PS/2 type keyboard is necessary.
- When using Windows NT®4.0/Windows® 95, be sure to install the PL-7900 series Driver & Utility Disk's Display Driver (For installation procedures, see the disk's README text file).
- For information on the PL-7900 series' bundled utility software, see the README text file on the Driver & Utility Disk.
- Since the PL-7900 series' hard disk drive (HDD) is a consumable item, i.e. it has a finite usage lifetime, be sure to back up its data frequently and perform regular maintenance.
- After turning the PL OFF, be sure to wait a few seconds before turning ON again. If the unit is started within a few seconds, it may not start up correctly.

Symbol Information

The list below describes the symbols used in this manual:


Symbol	Meaning
 Warning	Failure to observe this instruction may cause severe bodily injury, death or major machine damage.
 Important	Failure to observe this instruction may cause abnormal operation of equipment or data loss.
*1	Indicates useful or important supplemental information.
 Note:	Used to provide useful or important supplemental information.
 Reference	Used to refer to useful or important supplemental information.
1), 2)	Indicates steps used to accomplish a given task. Be sure to follow these steps in the order they are written.

Package Contents

The PL package should include the following items:


PL Unit

(PL-7900T/PL-7901T)

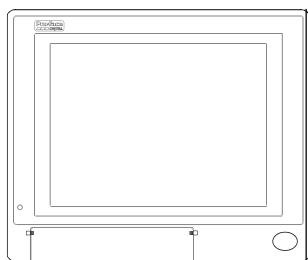

Be careful when handling the PL not to damage the built-in HDD


Power Cord

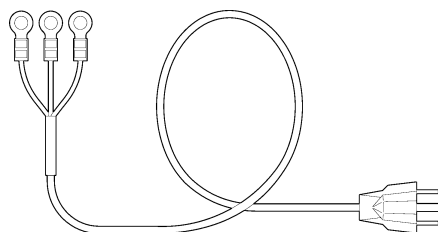


This cord is designed only for AC100/115V use. Any other voltage will require a different cable.

Floppy Disks

“PL-X900 Series Driver & Utility Disk” (3)



Installation Brackets (12)




CD-ROM (1)

Contains PL-7900 Series User Manual (This Manual)*



Instruction Guide

(English1/Japanese1)



————— If your PL contains a built-in HDD —————

Your PL unit package will also contain an Installation Guide for your built-in HDD unit.
Be sure to check that guide's package contents.

New PL-7900 Series Features

The PL-7900 series displays are equipped with the following features:

- **The Latest, High-Performance Architecture**

Designed around the AMD-K6®-2 333MHz CPU, the PL utilizes the type of high performance architecture that offers you superior compatibility. Add to this unrivalled support of the Windows 95®/WindowsNT® and other operating systems.

- **Bright 15" LCD with a Wide Viewing Angle**

The PL's large 15-inch 1024× 768 dot TFT LCD display offers excellent visibility and brightness.



- **Digital's top of the line TFT color LCD model allows you to create detailed and powerful visual images, with excellent brightness, a wide viewing angle, and a display capable of 260,000 colors.**

- **Easy Front Panel Installation**

The PL is designed to be installed easily into the front of any panel or device. It is also rugged enough for use in harsh, industrial environments, such as those found in the factory automation industries and boasts an IP65f rating.

- **High Resolution, Analog-Resistance-Film Touch Panel**

Standard equipment with the PL is a high resolution 1024 × 1024 touch panel. Also, the Windows® mouse emulation utility provides mouse-like functionality and pointer control.

- **Highly Expandable**

The PL units consist of two types; a 2 slot type (with 1 PCI bus also available), and a 4 slot type (with 2 PCI buses available). These slots can accommodate both Digital's own optional boards as well as other commercially available expansion boards.

Digital also offers a wide variety of optional products, such as a -5/-12V DC power unit, DIM memory modules, etc.

UL/cUL Application Notes

The PL790*-T4* is (c)UL 1950 recognized product. (UL File No. E171486). Please pay special attention to the following instructions when applying for UL/cUL approval for machinery which includes any of these PL units.

The PL conforms as a component to the following standards:

UL 1950, Third Edition, dated March 1, 1998 (Standard for Safety of Information Technology Equipment, including Electrical Business Equipment)

CSA-C22.2 No. 950-95 (Standard for Safety of Information Technology Equipment, including Electrical Business Equipment)

PL7900-T4* (UL Registration Model No.: 2780054-02)

PL7901-T4* (UL Registration Model No.: 2780054-01)

- Equipment with a PL mounted in it requires UL/cUL evaluation for the combination of the PL and equipment.
- The PL must be used as a built-in component of an end-use product.
- Use the PL indoors only.
- When connecting the PL's power cable, be sure to use a cable that is appropriate for the current and voltage used and that has conductive wires that are 0.75 mm² or larger.
- With an end-use product which includes the PL, be sure to place the PL's Power cut-off switch as the disconnect device where the unit's operator can easily reach it.
- Danger of explosion if backup battery is incorrectly replaced. Replaced only with same or equivalent type recommended by the manufacturer. Dispose of used batteries according to the manufacturer's instructions.
- Be sure the unit the PL is built into uses a UL1950 compatible equipment structure.

CE Marking

The PL790*-T4* units are CE marked, EMC and LVD compliant products.

<Complies with the following Standards>

■ **Safety**

EN60950

■ **EMI (EN50081-2)**

EN55011 group1 (Class A)

■ **EMS (EN50082-2)**

EN61000-4-2, EN61000-4-3, EN61000-4-4,

EN61000-4-6, EN61000-4-8, ENV50204

If following requirements are not met, the PL may fail to meet EN60950 standard requirements.


- Equipment with a PL mounted in it requires UL/cUL evaluation for the combination of the PL and equipment.
- The PL must be used as a built-in component of an end-use product.
- Use the PL indoors only.
- When connecting the PL's power cable, be sure to use a cable that is appropriate for the current and voltage used and that has conductive wires that are 0.75 mm² or larger.
- When installing the PL in a metal panel or cabinet, be sure to place the PL's Power disconnect device (cut-off switch) where the unit's operator can easily reach it.
- There is a danger of explosion if the backup battery is incorrectly replaced. This battery should be replaced only with same or equivalent type recommended by the manufacturer. Dispose of used batteries according to the manufacturer's instructions.
- Be sure the cabinet/enclosure the PL is built into uses an EN60950 approved sheet steel structure.

MEMO

This page intentionally left blank.

1-1 System Configuration

The following chart shows the range of peripheral items connected to the PL.

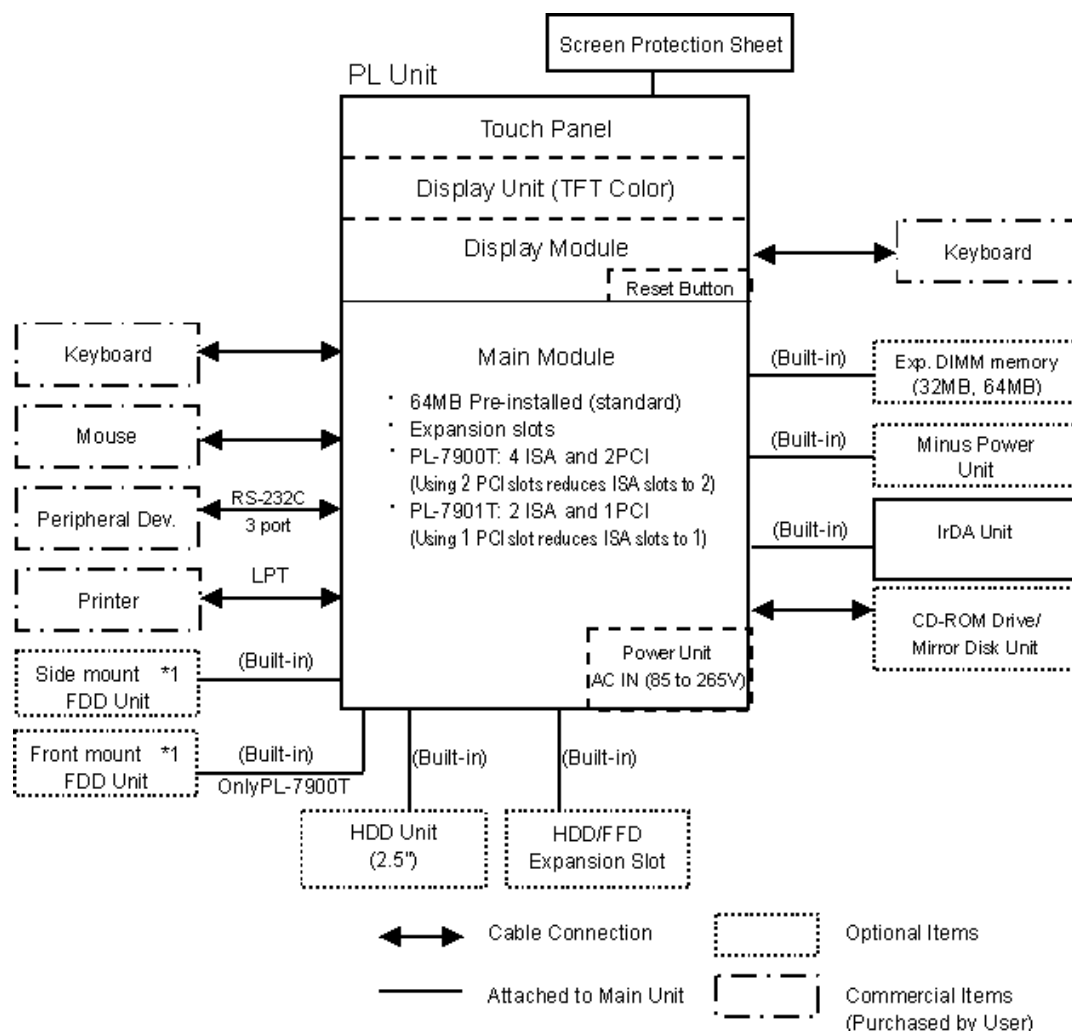

The figure above shows simply the internal data flow and the PL's peripheral connections, and may differ from the actual layout used by the customer.

**1 Only one FDD unit can be used at one time, i.e. either the front panel's FDD, or the main unit's FDD.*

1-2 Options

The following table provides a list of optional products for the PL.

Expansion Options

Name	Model number	Description
LAN Board	DAX-IET02	NE2000 compatible board. Provides connectors for 10BASE-5, 10BASE-2 and 10BASE-T
DIM Module	PL-EM220	SDRAM (DIMM) Provides 32MB of memory
	PL-EM230	SDRAM (DIMM) Provides 64MB of memory
FDD Unit	PL-FD200*1	IBM PC Compatible 3.5" FDD unit (Attaches to side slot)
	PL-FD210*1	IBM PC Compatible 3.5" FDD unit (Attaches to front slot) Only for PL-7900T
-5V/-12V Power Unit	PL-PW100	Provides -5V and -12V power to expansion slots. Can provide a total of 200mA of current (sum of both slots)
FFD Unit (Flash File Disk)	PL-FF200	Flash File Disk Provides 20MB of memory, connected to IDE I / F. Used as HDD.
CD-ROM Unit	PL-DK200	IDE (ATAPI) compliant CD-ROM drive unit – for development and maintenance use (special connection cable is included with unit)
Mirror Disk Unit	PL-MD200-HU01	IDE compliant mirror disk unit without OS

Accessories

Name	Model number	Description
Screen Protection Sheet	PL-CS100	Disposable overlay sheets for display face protection and stain resistance. Touch panel senses User's touch through sheet. (5 sheets/set)

**1 Both the PL-FD200 and the PL-FD210 cannot be used at the same time.*


Maintenance Options

Name	Model number	Description
Mounting Brackets	GP070-AT 01	Used to install the PL into a panel or cabinet. Same as original equipment brackets
Moisture Resistant Gasket	PL-WS300	Used to prevent moisture from entering into the PL's case from the front face. Same as original equipment gasket
HDD Unit	PL-HD220	2.5" HDD unit (10.0GB or larger - contains no pre-installed OS)
Mirror Disk Unit Replacement HDD	PL-MD200-MD01	Mirror Disk Unit's replacement HDD (1)
Full-sized cover	PL-FC200	Attached when ISA bus full-sized board is used in the expansion slot. (for PL-7901T)
	PL-FC210	Attached when ISA bus full-sized board is used in the expansion slot. (for PL-7900T)
Backlight	PL7900-BL 00-MS	Spare PL-7900 series backlight for maintenance (2 bulbs/set)



Be aware that not only does the Hard Disk have a fixed lifetime, but that accidents can always occur. Therefore, be sure to back up your Hard Disk's data regularly, or prepare another Hard Disk unit that can be used for backup.

When Installing Commercially Available Products

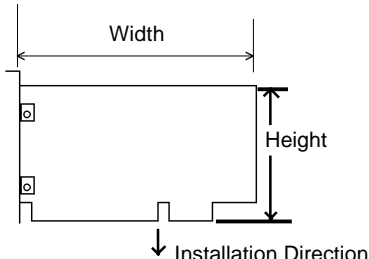Product	Description	Installation Area
PCI/ISA Bus compatible board	<p>In all PL-7900 series units, slot 1 can accommodate boards up to 163mm wide. Slot 2 (slots 2, 3 and 4 for PL-7900T) can accommodate boards up to 250mm wide.</p> <ul style="list-style-type: none"> ■ All PL-7900 series slot heights are 122mm. When using the full-sized cover, be sure to use boards that are no more than 338mm wide and 122mm high in slot 2. ■ The height of the devices attached to the face of an expansion board can be, for slot 1 (slots 1 and 4 for PL-7900T), up to 13mm, and for slot 2 (slots 2 and 3 for PL-7900T), up to 18mm. 	Into the PL's expansion slots.



<Expansion Slot's Width >

- *Check that your expansion board's "foot" matches the width of the expansion slot. Slot 1 (slot 1 and 4 for PL-7900T) is 20 mm wide, and slot 2 (slot 2 and 3 for PL-7900T) is 25 mm wide. Be sure the width of your expansion board's width matches that of the intended slot.*

<Power Supply>

- *Since the PL does not supply -5 and -12 V current, ISA(AT)-bus compatible boards requiring -5 or -12 V can be used only if the optional PL-PW100 power supply is installed.*

<Commercially Available Boards>

- *Certain commercially available boards may not be compatible with Digital's PL unit. Installing incompatible boards may result in either damage to or failure of the PL and will void your warranty. Prior to using those boards, be sure to contact your local PL distributor.*

<PCI Bus>

- *Within the entire range of PCI buses currently available on the market, there may be certain devices which will not operate when used with the PL. Prior to the use of any PCI Bus, be sure to contact your local PL distributor.*

<Main Memory>

- *Be sure to use only DIM modules manufactured by Digital. Installing other DIM modules may result in either damage to or failure of the PL, and will void your warranty.*

<When using Standard PC Peripheral Devices>

- *Within the range of peripheral devices currently available on the market, there may be certain devices which will not operate correctly when used with the PL. Prior to using any peripheral device, be sure to contact your local PL distributor. Installing incompatible boards may result in either damage to or failure of the PL and will void your warranty.*

1-3

PL Series Panel Types

Model Number:

PL790

X

-

T

X

X

A

B

C

D

E

A	PL790	PL-7900 Series Unit
B	0	4-slot type
	1	2-slot type
C	T	TFT Color LCD display
D	4	CE Marking, UL/cUL Approval
E	X	PL Revision No.

MEMO

This page intentionally left blank.

Specifications

2-1 General Specifications

1 Electrical Specifications

	PL-7900T	PL-7901T
Operating Voltage	AC 100V to AC 240V	
Voltage Endurance	AC 85V to AC 265V	
Rated Frequency	50/60Hz	
Allowable Pause Duration	shorter than 1 cycle (however, pause occurrences must be more than 1 second apart)	
Power Consumption	less than 150VA	less than 100VA
Voltage Endurance	AC 1500V at 20mA for 1 minute (between the live wire and the grounding (FG) terminal)	
Insulation Resistance	Greater than 10M Ω at DC 500V (between the live wire and the grounding (FG) terminal)	

2 Environment Specifications

Ambient Operating Temperature	Panel Interior	W/Fan	5 °C to 50°C
		W/out Fan	5°C to 40°C
	Panel Face *1	5°C to 40°C	
Ambient Storage Temperature	-10 °C to 60 °C		
Ambient Operating Humidity	30% RH to 85% RH (no condensation)		
Ambient Storage Humidity	30% RH to 85% RH (no condensation)		
Dust Level	Free of dust		
Operating Atmosphere	Free of corrosive gas		
Vibration Endurance	2G: 10 to 25Hz applied in X, Y, and Z directions for 30 minutes each (0.5G when using HDD unit, 1.0G when using FDD)		
Noise Endurance	Noise Voltage: 1500V(via noise simulator) Pulse Duration: 50ns, 500ns, 1μs Start-up Time: 1ns		
Noise Immunity	1kV IEC 61000-4-4		
Electrostatic Discharge Immunity	4kV IEC 61000-4-2		

*1 The PL's internal cooling fan is removed.




- When using any of the PL's optional devices, be sure to check that device's specifications for any special conditions or cautions that may apply to its use.
- When using a full sized expansion board, be sure to check its dimensions and shape, since they will affect the board's environment specifications, such for vibration, etc.
- Be aware that not only does the Hard Disk have a fixed lifetime, but that accidents can always occur. Therefore, be sure to back up your Hard Disk's data regularly, or prepare another Hard Disk unit that can be used for backup.
- The Hard Disk lifetime given here may be reduced due to unforeseen environmental factors, however, generally speaking, at an operating temperature of 20°C the disk should last for 20,000 hours (of operation) or approximately 5 years, whichever comes first.
- Using the Hard Disk in an environment that is excessively hot and/or humid will shorten the disk's usage lifetime. A maximum wet bulb temperature of

Temperature	Humidity
at 35°C	no higher than 71%RH
at 40°C	no higher than 54%RH
at 50°C	no higher than 33%RH

3 Dimensions

	PL-7900T	PL-7901T
Grounding ^{*1}	Exclusive grounding only. 100Ω or less, or your country's applicable standard.	
Rating ^{*2}	Equivalent to IP65f (JEM1030)	
Cooling Method	Via cooling pipes and electric fan	
Weight	Less than 10.5 kg (with HDD and FDD installed)	Less than 9.5kg (with HDD And FDD installed)
External Dimensions	W374 x H325 x D180mm (excluding projections)	W374 x H325 x D134mm (excluding projections)
Dimensions Including Full-sized Cover	W422 x H325 x D180mm (excluding projections)	W422 x H325 x D134mm (excluding projections)
Dimensions Including Mirror Disk Unit	W374 x H325 x D184mm (excluding projections)	W374 x H325 x D184mm (excluding projections)

***1**  Refer to 4-3-3, **Grounding Cautions**.

***2** The front face of the PL unit, installed in a solid panel, has been tested using conditions equivalent to the standard shown in the specification. Even though the PL unit's level of resistance is equivalent to the standard, oils that should have no effect on the PL can possibly harm the unit. This can occur in areas where either vaporized oils are present, or where low viscosity cutting oils are allowed to adhere to the unit for long periods of time. If the PL's front face protection sheet becomes peeled off, these conditions can lead to the ingress of oil into the PL and separate protection measures are suggested. Also, if non-approved oils are present, it may cause deformation or corrosion of the front panel's plastic cover. Therefore, prior to installing the PL be sure to confirm the type of conditions that will be present in the PL's operating environment.

If the installation gasket is used for a long period of time, or if the unit and its gasket are removed from the panel, the original level of the protection cannot be guaranteed. To maintain the original protection level, you need to replace the installation gasket regularly.

2-2 Performance Specifications

1 Performance Specifications

CPU		AMD-K6®-2 333 MHz (AMD Corporation)		
DRAM (SDRAM DIMM)		64MB (2 DIMM sockets – expandable to 128MB)		
BIOS		AWARD PC/AT Compatible		
Secondary Cache Memory		512KB (built-in)		
Graphics		XGA (1024 x 768 dots) VESA 16 colors/256 colors/32K colors/64K colors		
Video Memory		2MB (SDRAM)		
Touch Panel	Type	Resistive Film (Analog type)		
	Resolution	1024 x 1024		
	Interface	COM4 (uses Mouse Emulator)		
Interfaces	Serial	RS-232C (w/FIFO)	COM1	D-Sub 9 pin (male)
			COM2	D-Sub 9 pin (male)
			COM3	D-Sub 9 pin (male)
	Printer	Complies with Centronics Standards (ECP/EPP equivalent) D-sub 25 pin, female		
	Keyboard	PS/2 Interface (mini DIN 6 pin, female) side & front		
	Mouse	PS/2 Interface (mini DIN 6 pin, female) side		
	RAS	RAS Interface (D-sub 25 pin, male)		
	Disk I/F	FDD Unit	Side Access/ 2 modes/ 3.5 inch FD	
			Front Access/ 2 modes/ 3.5 inch FD (Available for only PL-7900T)	
	Disk I/F	E-IDE	2.5 inch HDD I/F	
			PL units equipped with a built-in HDD will use a 6.0 or more GB unit.	

2 Display Functions

Display Type	TFT Color LCD (15 Inch)
Pixel Density	1024 x 768 (pixels)
Dot Pitch	0.297 x 0.297mm
Effective Display Area	W304.1 x H228.1mm
Display Colors	260,000 colors
Contrast Control	Not Possible
Backlight	CFL (Replaceable)
Backlight Life time	More than 50,000 hours at an ambient temperature of 25°C. (Until the backlight's brightness dims to half of the original level.)



The PL's backlight should only be replaced by a trained maintenance person. For information about changing the PL's backlight, refer to Chapter 7-3 Replacing the PL Backlight, or contact your local PL distributor.

3 Expansion Slots

	PL-7900T (4-slot type)	PL-7901T (2-slot type)	Board Size		Slot Pitch	Actual thickness of Expansion Board
			Without Full-sized cover	With Full-sized cover		
1 st slot	ISA	ISA	163 x 122 mm	163 x 122 mm	20 mm	Less than 13 mm
2 nd slot	PCI	PCI	250 x 122 mm	250 x 122 mm	25 mm	Less than 18 mm
	ISA	ISA		338 x 122 mm		
3 rd slot	PCI/ISA	None	250 x 122 mm	338 x 122 mm	25 mm	Less than 18 mm
4 th slot	ISA	None	250 x 122 mm	338 x 122 mm	20 mm	Less than 13 mm
Power Supply	5V: 4A, 12V: 1A (total for 4 slots)	5V: 2A, 12V: 0.5A (total for 2 slots)	_____	_____	_____	_____



Note: For the 2nd and 3rd slots on the PL-7900T, and the 2nd slot on the PL-7901T, either the PCI or the ISA type of expansion board can be used.



Reference For PL dimensions when using the full-sized cover, refer to 1-2 Options.

4 Clock(RTC) Accuracy


Clock(RTC) accuracy	±180 seconds per month
---------------------	------------------------

The PL's built-in clock (RTC) may have a slight error. With the ambient temperature mentioned in the specification with no power flow, the allowance is +180 seconds per month, however, the allowance may vary and could be up to +300 seconds per month depending on the ambient temperature difference or how old the unit is. If the clock accuracy is essential for the system, you need to adjust the clock regularly.

2-3 Interface Specifications

1 Printer Interface (LPT1)

D-sub 25 Pin (Female)




Screw Size: (4-40): Inch Type

Pin No.	SPP/ECP Mode Signal Name	EPP Mode Signal Name	Direction	Electrical Specif.	Pin No.	SPP/ECP Mode Signal Name	EPP Mode Signal Name	Direction	Electrical Specif.
1	STRB	WRITE	In/Output	O.D	14	AUTOFD	DSTRB	In/Output	O.D
2	DATA0	DATA0	In/Output	O.D	15	ERROR	ERROR	Input	TTL
3	DATA1	DATA1	In/Output	O.D	16	INIT	INIT	In/Output	O.D
4	DATA2	DATA2	In/Output	O.D	17	SLCTIN	ADSTRB	In/Output	O.D
5	DATA3	DATA3	In/Output	O.D	18	GND	GND		
6	DATA4	DATA4	In/Output	O.D	19	GND	GND		
7	DATA5	DATA5	In/Output	O.D	20	GND	GND		
8	DATA6	DATA6	In/Output	O.D	21	GND	GND		
9	DATA7	DATA7	In/Output	O.D	22	GND	GND		
10	ACKNLG	ACKNLG	Input	TTL	23	GND	GND		
11	BUSY	WAIT	Input	TTL	24	GND	GND		
12	PE	PE	Input	TTL	25	GND	GND		
13	SLCT	SLCT	Input	TTL					

**1 The Input and Output settings used will depend the BIOS set up screen settings used.*

2 Keyboard Interface

Mini - DIN 6 pin (Female)

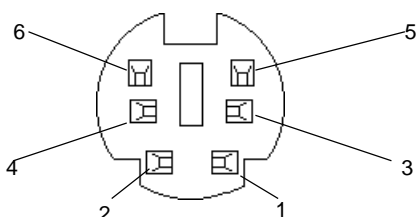


(The PL's front and side connectors are the same)

Pin No.	Signal Name
1	KEY DATA
2	NC
3	GND
4	+5V
5	KEY CLK
6	NC
SHIELD	GND

3 Mouse Interface


Mini - DIN 6 pin (Female)

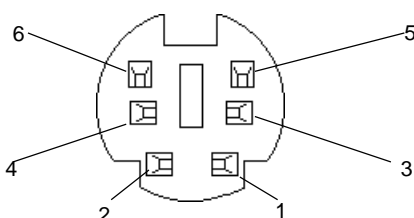

Pin No.	Signal Name
1	Mouse DATA
2	NC
3	GND
4	+5V
5	Mouse CLK
6	NC
SHIELD	GND

4 RS-232C Interface (COM1/COM2/COM3)

D-sub 9 pin (Male)




Screw Size: (4-40): Inch Type

Pin No.	Signal Name	Pin No.	Signal Name
1	CD	6	DSR
2	RXD	7	RTS
3	TXD	8	CTS
4	DTR	9	RI
5	GND		

5 RAS Interface

Item		Feature
Input	DIN 0,1	Digital Input Port (2 points)
	RESET	Hardware can be reset via external reset signal.
Output	DOUT	Digital output port (1 point)
	Alarm	Alarm signal output port (1 point)
	Lamp	Alarm lamp connection port (1 point)

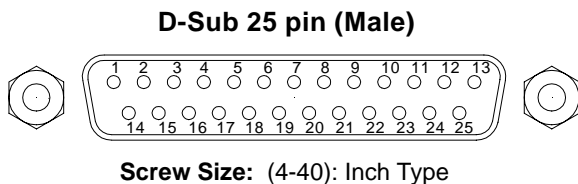

Screw Size: (4-40): Inch Type

Pin No.	Signal Name	Pin No.	Signal Name
1	GND	14	GND
2	+5V	15	+5V
3	+12V	16	NC
4	NC	17	NC
5	RESET INPUT (+)	18	NC
6	DIN 0 (+)	19	NC
7	DOUT (-)	20	NC
8	DOUT (+)	21	LAMP OUT (-)
9	ALARM OUT (-)	22	LAMP OUT (+)
10	ALARM OUT (+)	23	NC
11	RESET INPUT (-)	24	DIN1 (-)
12	DIN 0 (-)	25	NC
13	DIN 1 (+)		

■ Power Lamp LED Error Display

The Power Lamp LED indicates when the RAS feature has detected an error, due to a PL operation or environment related problem.


To use this feature, you need to install the RAS system monitor feature from the PL's additional floppy disk.

Reference 6-1 Floppy Disk File List

LED	Status
Green, Lights Continuously	Normal Operation
Orange, Lights Continuously	System Monitor Alarm has occurred
Orange, Blinking	When the Mirror Disk unit is installed, indicates that a hard disk error has detected


■ Input Port (Dual use of DIN, Remote Set Input Port)

- External Power : DC12V to 24V connection possible
- Input Hold : Hold Diode
- Isolation : Used (Photo isolation)


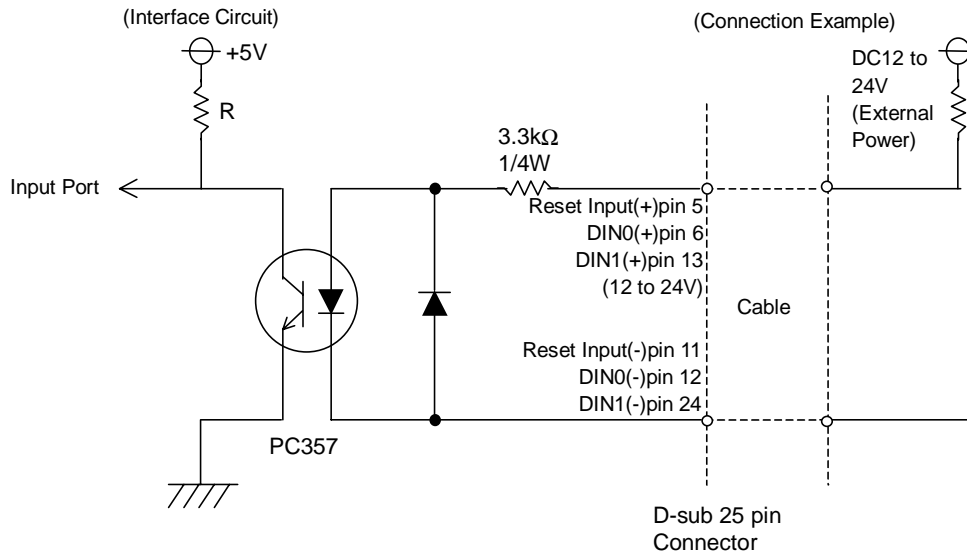


■ Output Port (DOUT, Alarm Output, Lamp Output Port)


- Output Specifications : DC 24V 100mA (MAX)
- Isolation : Used (Photo isolation)

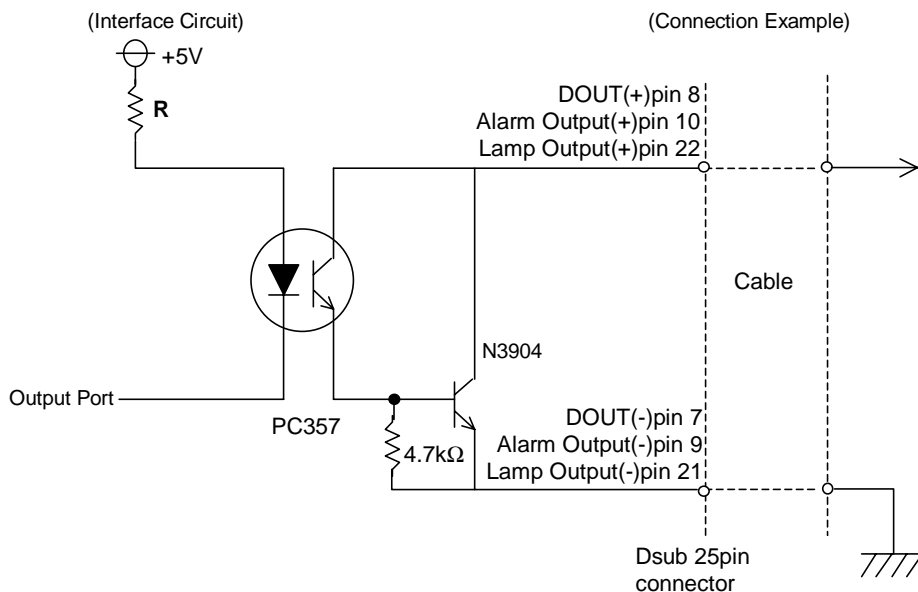

2-4 PL External Features

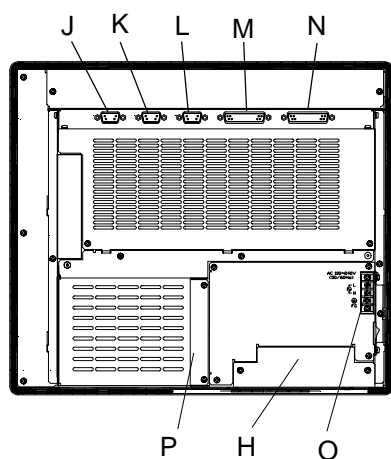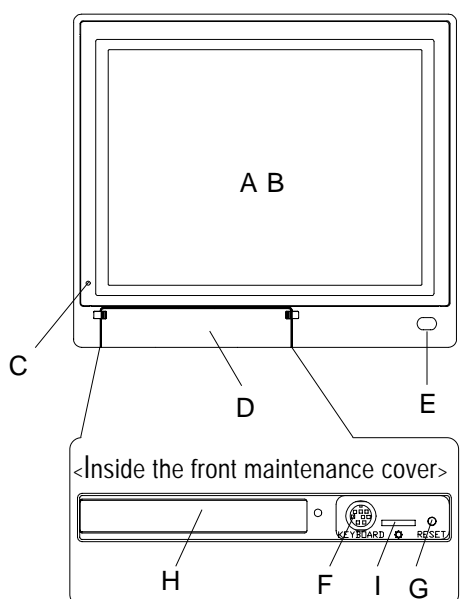

PL-7900T(4Slot)

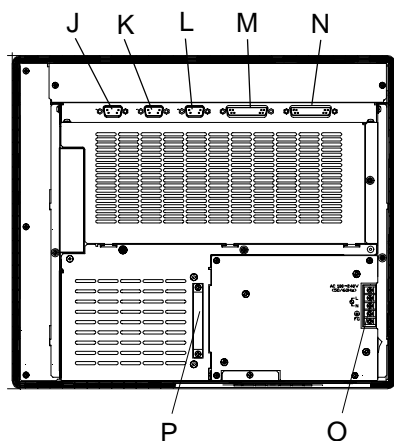

PL-7901T(2Slot)

A: Display Area

Display output area. The built-in XGA controller supports PC compatible architecture.

B: Touch Panel

This high-resolution analogue touch panel allows you to configure a keyboard-less system.

C: Power Lamp LED

The status of the lamp changes according to the alarm type detected by the RAS feature. **Reference** 2-3-5 RAS Interface

D: Front Maintenance Cover

Open this cover to connect the optional FDD unit.

E: IrDA

Infra-red signals can be sent and received by this unit.

F: Keyboard Connector

A PS/2 compatible keyboard is connected here.

G: Hardware Reset Switch

H: FDD Slot (only for PL-7900T)

Slot for installing the FDD unit.

I: Brightness Adjustment Slide

Allows adjustment of backlight brightness.

J : RS-232C Connector (COM1)

K: RS-232C Connector (COM2)

L: RS-232C Connector (COM3)

These RS-232C interfaces (D-sub 9 pin male connectors), allow communication with other computers and connection to peripheral devices.

M: Printer Connector (LPT1)

Centronics standard interface (D-sub 25 pin female connector), which connects a parallel device, such as a printer. (supports ECP/EPP)

N: RAS Connector


Interface for DIN, DOUT, Watchdog, and Remote Reset. (D-sub 25 pin male connector)

O: Power Terminals


The PL's AC100V/240V power cord terminals are connected here.

P: IDE I/F Cover


To connect the optional CD-ROM drive unit (PL-DK200) and Mirror Disk Unit (PL-MD200-HU01), remove this cover and use this connector.

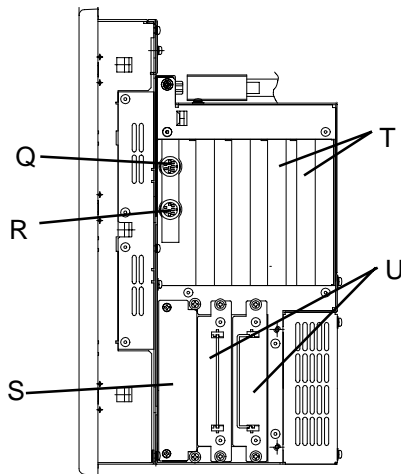

PL-7900T(4Slot)

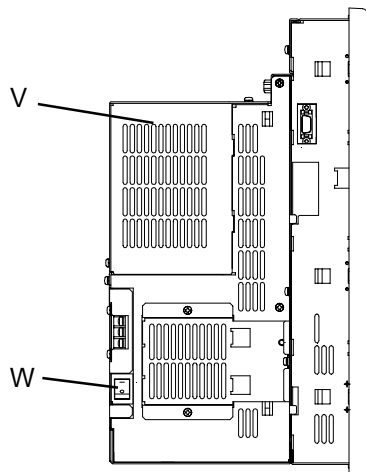

PL-7900T(4Slot)

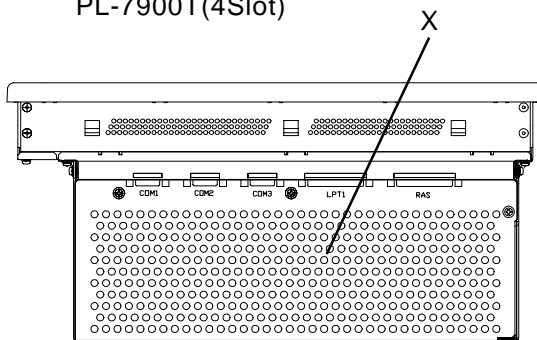

PL-7900T(4Slot)

Q: Keyboard Connector

A PS/2 compatible keyboard can be connected here.

R: Mouse Connector

A PS/2 compatible mouse can be connected here.

S: FDD Slot

Houses the FDD (PL-FD200) unit.

T: Expansion Slots (2)

U: HDD/FFD Expansion Unit Slot

Houses an additional HDD or FFD unit.

V: Half Cover

When an optional DIM module or expansion board is used here, this cover is removed.

W: Power Switch

Use this switch to turn the PL's power ON or OFF.

X: Rear Maintenance Cover

Remove this cover to install the optional DIM module, or an expansion board.



Important


To avoid an electrical shock, be sure to first disconnect the PL's power cord from the power supply before connecting the cord's power terminals or any peripheral devices to the PL.

Reference 4-3-1 Connecting the Power Cord


2-5 PL Dimensions

1 PL-7900T General Dimensions


(Unit: mm - excluding projections)

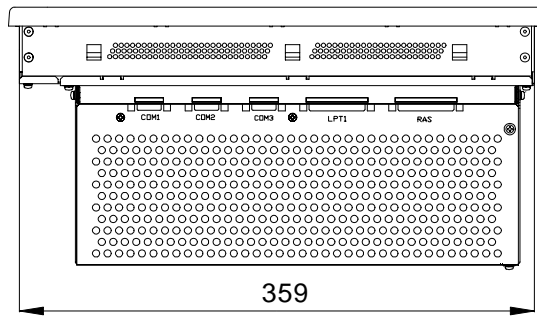


Top View

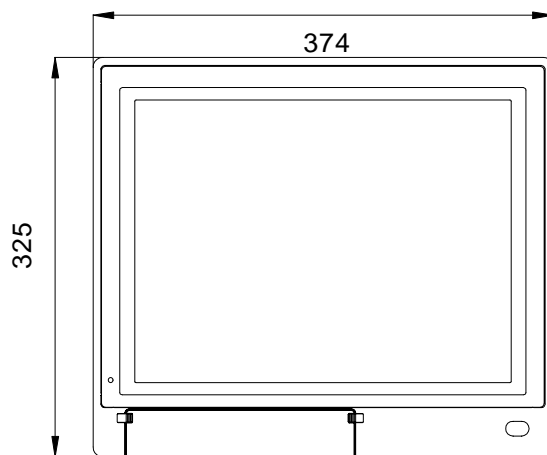

Front View

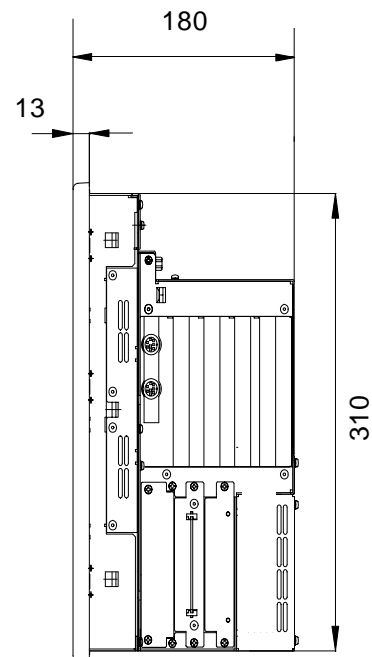


Side View

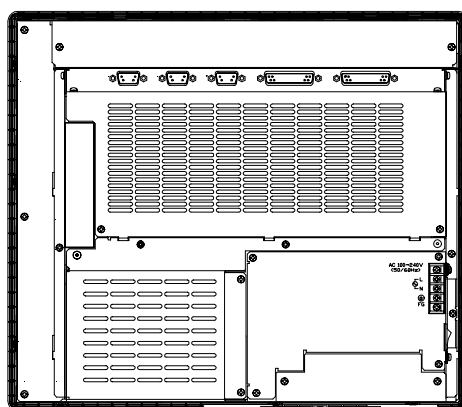


Rear View

2 PL-7901T General Dimensions


(Unit: mm - excluding projections)

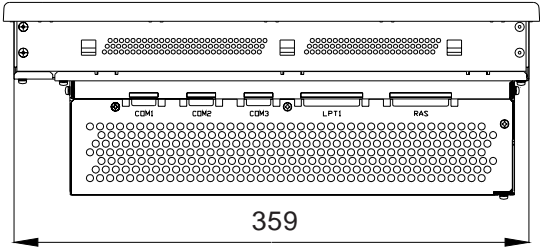


Top View

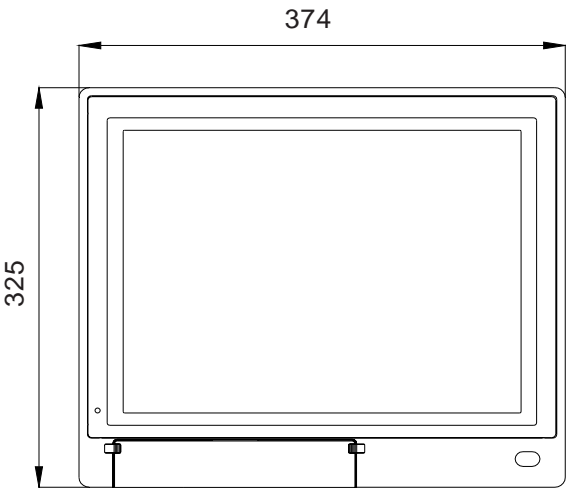

Front View

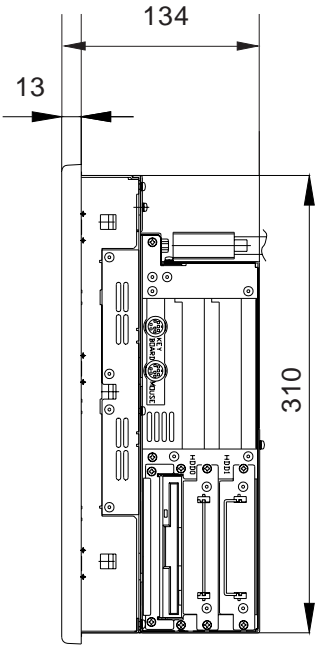

Side View

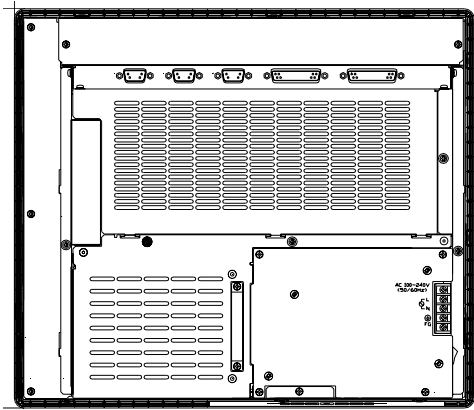


Rear View

3 Full-Sized Cover Attachment Dimensions

(Unit: mm - excluding projections)

(PL-7900T)

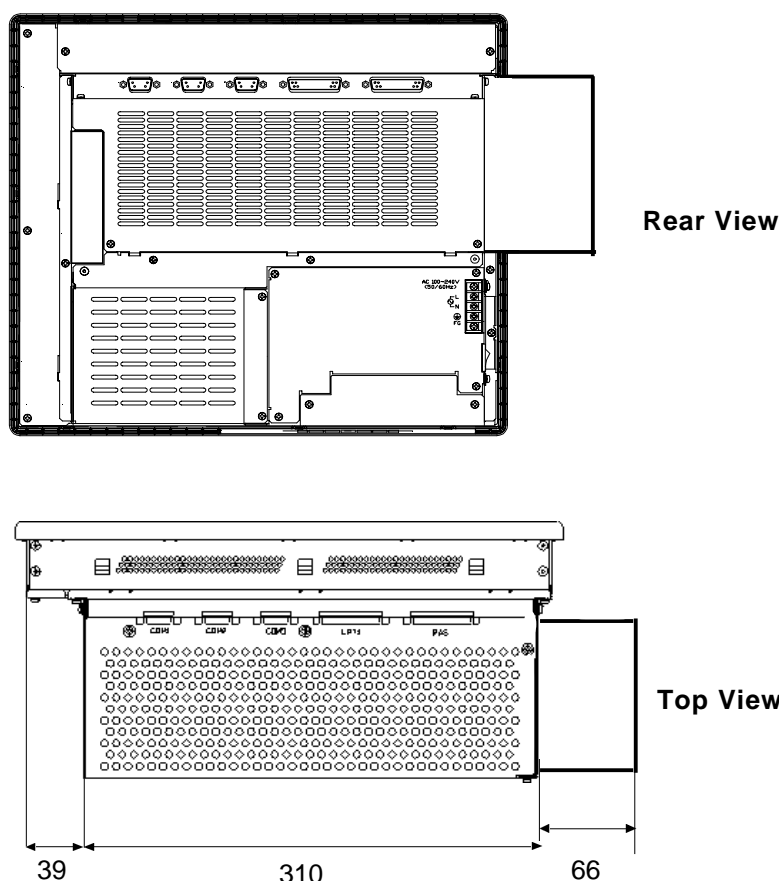

Note:

The above figure's dimensions are the same for the 2 and 4 slot units.




Important

- When using a full-sized board and the PL's full-sized cover (PL-FC200/PL-FC210), be sure that the PL is mounted in its attachment panel/cabinet before starting this work. Due to size differences, the PL-FC200 or a full sized expansion board cannot be attached first and then the PL installed into a panel.
- When using a full sized expansion board, be sure to check its dimensions and shape, since they will affect the board's environment specifications, such as for vibration, etc.

4 Installation Slot Dimensions

(Unit: mm)

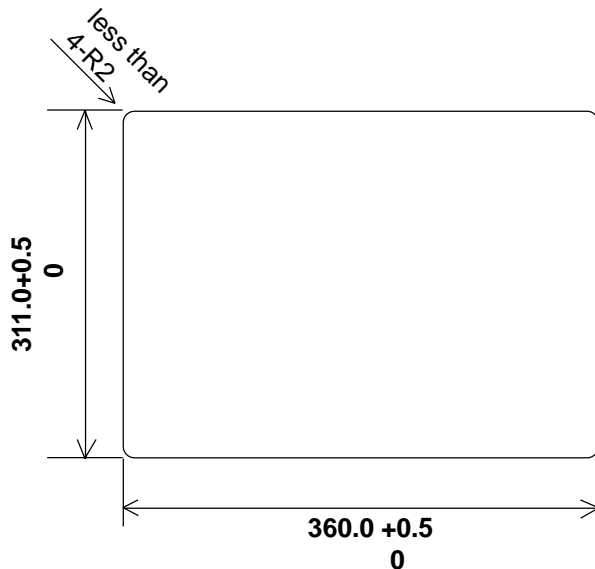

- Be sure the thickness of the panel is from 1.6 to 10 mm.
- All panel surfaces used should be strengthened. Especially, if high levels of vibration are expected and the PL's installation surface (i.e. an operation panel's door, etc.) can move (i.e. open or close) due consideration should be given to the PL's weight.
- To insure that the PL's water resistance is maintained, be sure to install the PL into a panel that is flat and free of scratches or dents.
- Be sure all installation tolerances are maintained to prevent the unit from falling out of its installation panel.

3

Installing Optional Units and Expansion Boards

The User can install a variety of optional units and expansion boards made by Digital in the PL, as well as a number of commercially available PCI-bus or ISA-bus compatible boards. This chapter describes how to install these products in the PL.

3-1 Installing Options and Expansion Boards

The following explanation pages describe the installation procedures for the PL's DIM module (PL-EM220/PL-EM230), FDD unit (PL-FD200/PL-FD210), HDD unit (PL-HD220), expansion boards, and the CD-ROM drive unit (PL-DK200).

For information about the installation of other option units, please refer to those unit's individual [Operation Instructions].



WARNING


To avoid electric hazards, be sure to turn the PL's power OFF before installing any optional units or expansion boards.



- *Use a screw driver to loosen or tighten the screws. Be careful not to over-tighten any screws, since it may damage the equipment.*
- *Be careful when removing or inserting any screws that they do not fall inside the body of the PL.*

1 Removing the Rear Maintenance Cover

■ PL-7901T (2 slot type)

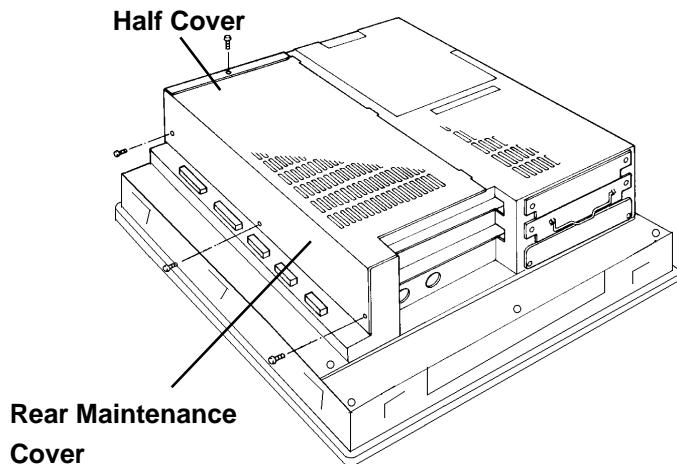


- 1) Unscrew four (4) attachment screws used to hold the rear maintenance cover and half cover.




Important

Remove the rear maintenance cover, and then the half cover.

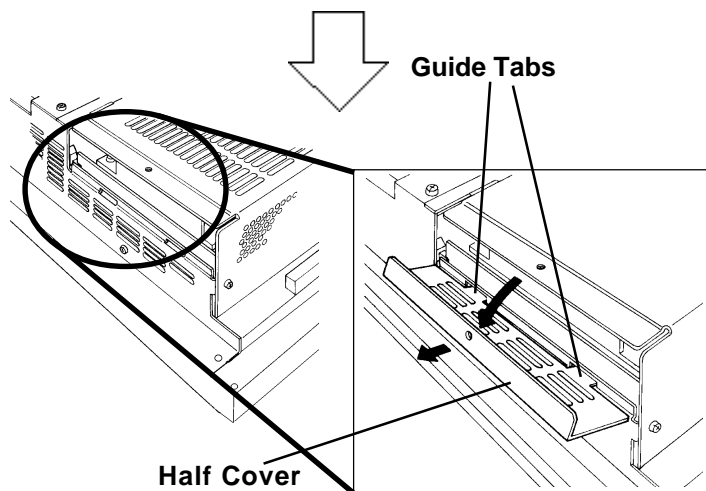

- 2) Pivot the half cover open and lift up slightly to free the guide tabs. Next, remove the half cover.

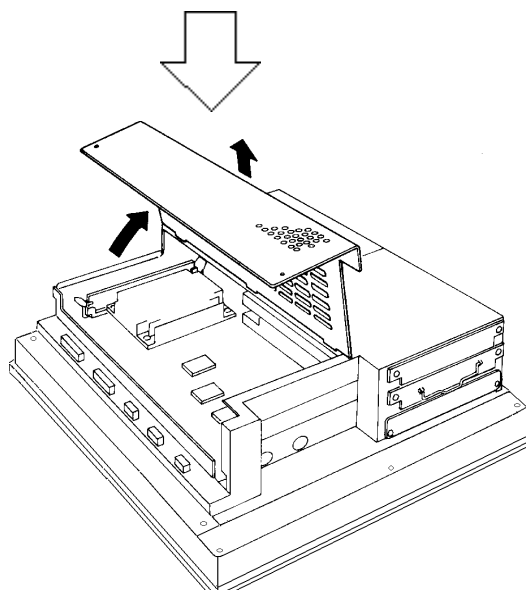

- 3) Remove the rear maintenance cover.




Important

Handle the rear maintenance cover with care, since it is made of aluminum and is easily bent.

Installing Optional Units and Expansion Boards

■ PL-7900T (4 slot type)

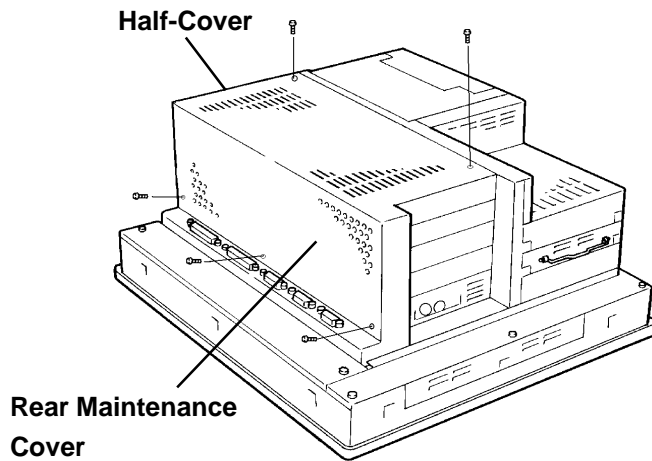


- 1) Unscrew five (5) attachment screws used to hold the rear maintenance cover and half cover.




Important

Remove the half cover, and then the rear maintenance cover.

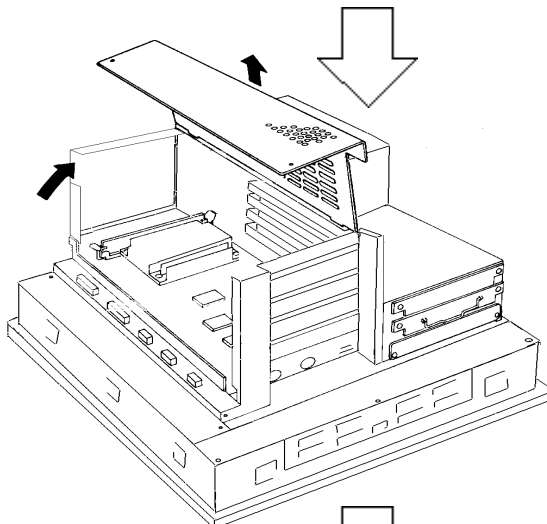

- 2) Remove the rear maintenance cover.

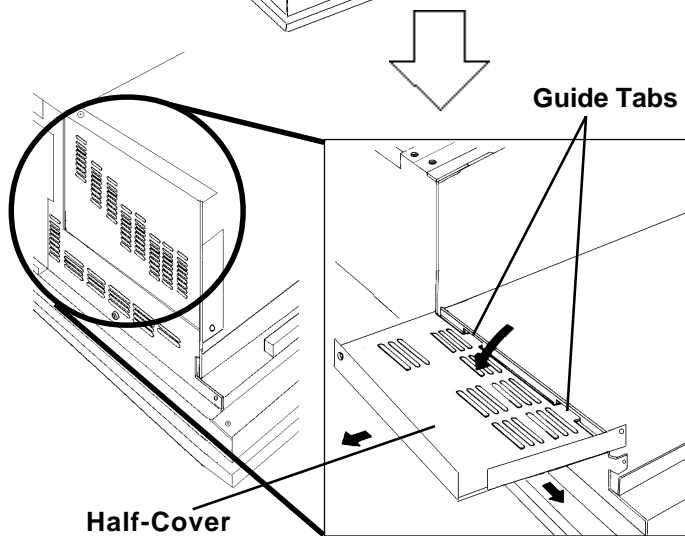

- 3) Pivot the half cover open and slide the cover slightly to the side to free the guide tabs. Next, remove the half cover.




Important

Handle the rear maintenance cover with care, since it is made of aluminum and is easily bent.

2 Installing the DIM Module (PL-EM220 / PL-EM230)

The PL-7900T/PL-7901T come with a single, 64MB DIM module pre-installed. There is one more empty socket that can be used and the procedures that follow describe how to install a second DIM module in that socket.

Note: Since DIM module sockets are easy to break, be sure to install the DIM module very carefully.

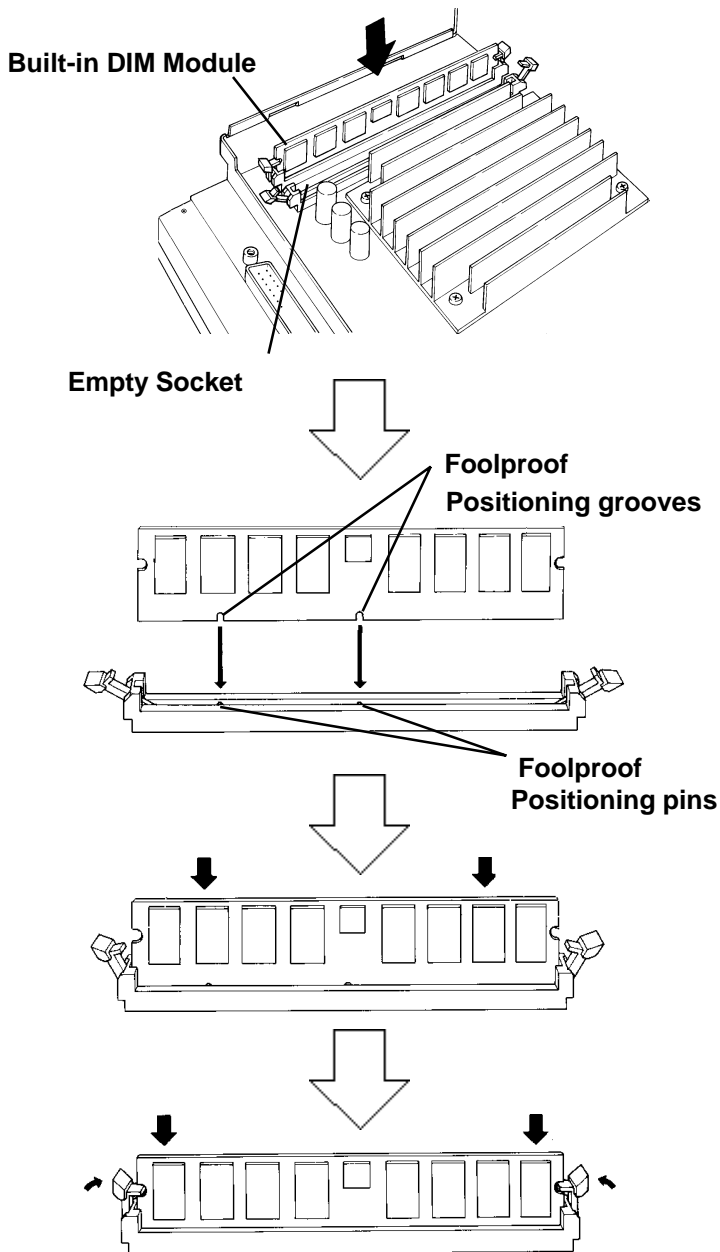

1) Install the DIM expansion module in the empty socket.

2) Adjust the foolproof positioning grooves so that they align with the foolproof positioning pins.


3) Insert the DIM module into the DIM module socket.

4) Push the DIM module down until the ejector tabs lock.


5) Replace the rear maintenance cover and the half cover and secure them in place with the attachment screws.

◆ To Remove the DIM Module



When removing the module from its socket, press down on the socket's ejector tabs to release the module.

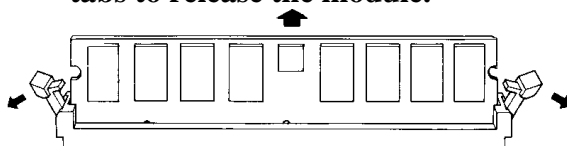

3 Installing the FDD Unit (PL-FD200)

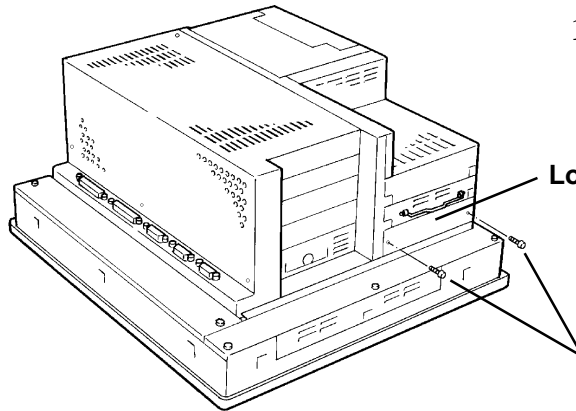


- 1) Remove the two(2) attachment screws from the lowermost Expansion Slot Cover, and remove the cover.

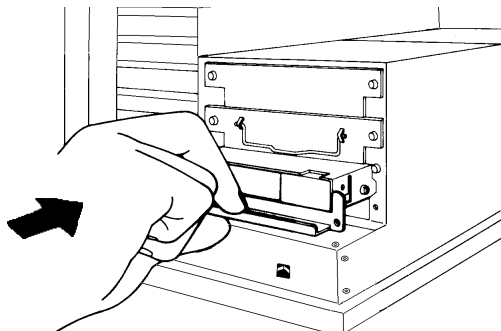

- 2) Insert the FDD unit so that its guide grooves fit the slot's guide ways. Push the unit in until its rear connector is connected securely.


- 3) Secure the unit in place with its two(2) attachment screws.

4 Installing the FDD Unit (PL-FD210)

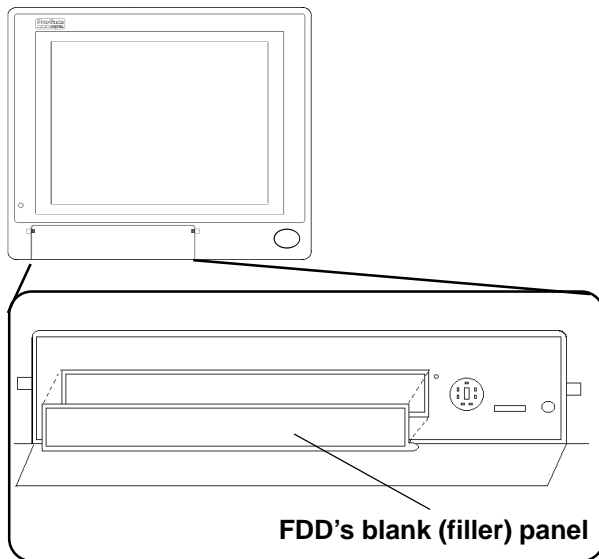


1) Open the front maintenance cover and remove the FDD's blank (filler) panel.

2) Close the front maintenance cover.

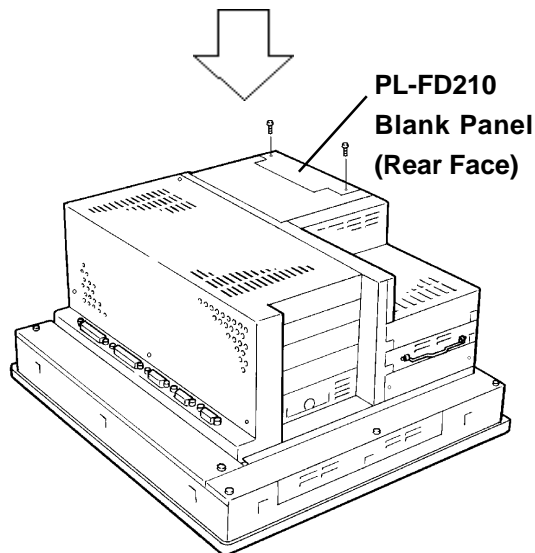

3) Unscrew the two(2) attachment screws from the PL-FD210's Blank Panel, and remove it.

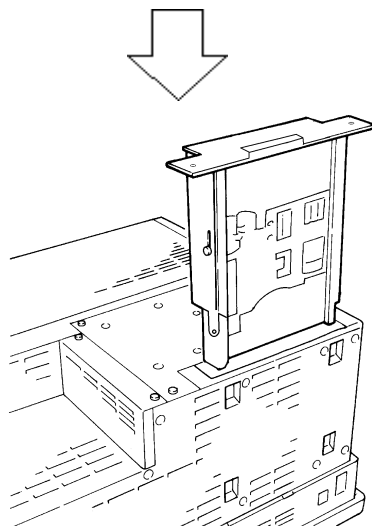

4) Insert the FDD unit so that its guide grooves fit the chassis guide ways. Push the unit in until its connector (middle of unit) is connected securely.

5) Fix the unit in place with its two(2) attachment screws.

6) Last, replace the Blank Panel, (removed in step 3).

5 Removing/ Installing the HDD Unit (PL-HD220)

The following explanation demonstrates the procedure for removing an existing HDD unit, and for installing a new HDD unit.




Note: The following procedure is applicable also to the FFD(PL-FF200) unit and the HDD (IDE) expansion slot.




Important

• **Since the PL-HD220 is a precision instrument, be sure not to jar or shake it unnecessarily.**

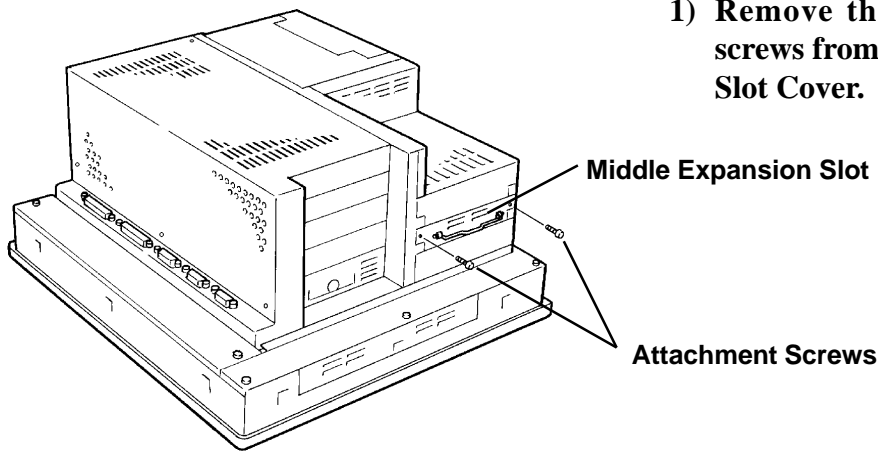

- 1) Remove the two(2) attachment screws from the middle Expansion Slot Cover.

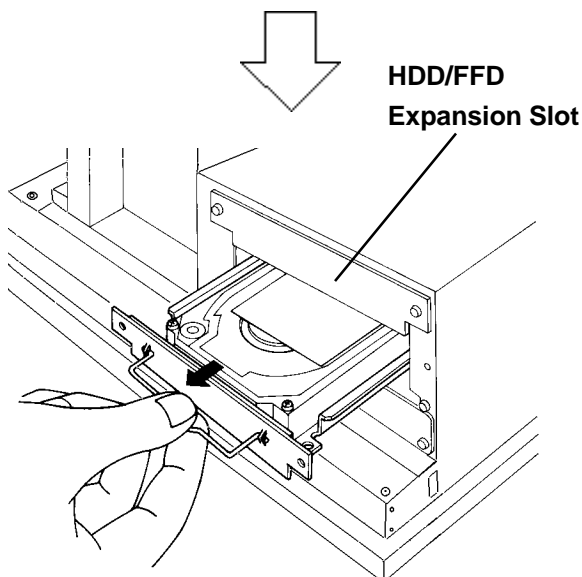


- 2) Grasp the HDD unit's handle and pull the unit slowly out of the PL. Be sure you do not damage the unit.

- 3) Insert the new HDD unit into the PL's guideways and push it in until its rear connector is securely connected.

- 4) Fix the unit in place with its two(2) attachment screws.

6 Installing an Expansion Board

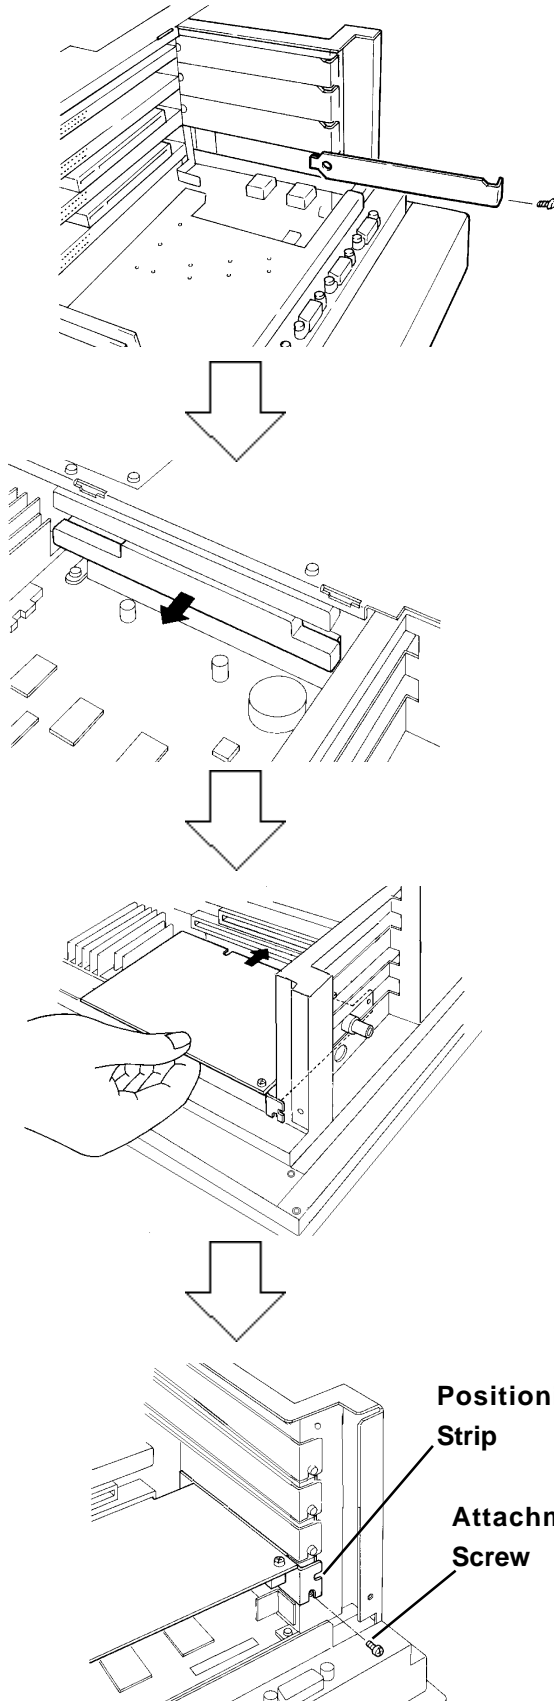

- 1) Unscrew the desired expansion slot's cover attachment screw, and remove the cover. **Reference** 3.1.1, *Removing the Rear Maintenance Cover*

Unscrew the Blank Panel's attachment screw to remove the Blank Panel.

- 2) Remove the expansion slot's dust cover.


- 3) Insert the expansion board into the expansion slot.

- 4) Secure the expansion board's metal positioning strip in place with its attachment screw.


- 5) Last, replace the rear maintenance cover and the half cover and secure them in place with their attachment screws.

7 Connecting the CD-ROM Unit (PL-DK200)

■PL-7901T(2-Slot)Unit

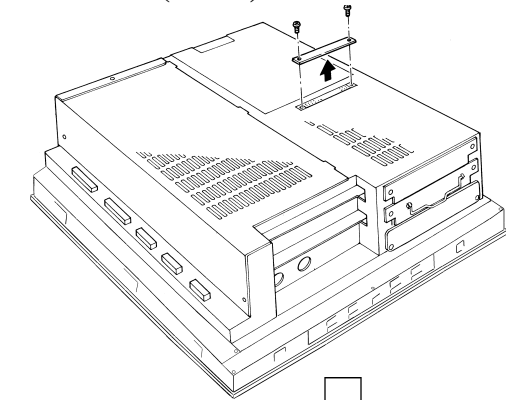

- 1) Unscrew the two(2) IDF I/F cover attachment screws, and remove the cover.

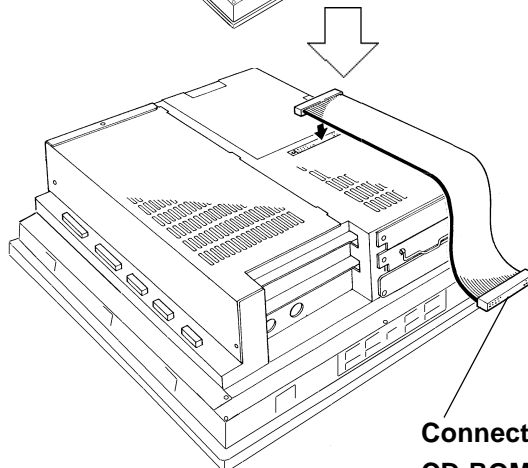


- 2) Connect the CD-ROM unit's cable (PL-x900) to the IDF I/F connector.




Be sure that the cable is securely connected before turning ON the PL's power switch.

■PL-7900T(4-Slot) Unit

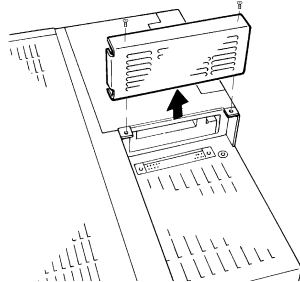

- 1) Unscrew the two(2) IDF I/F cover's attachment screws, and remove the cover.

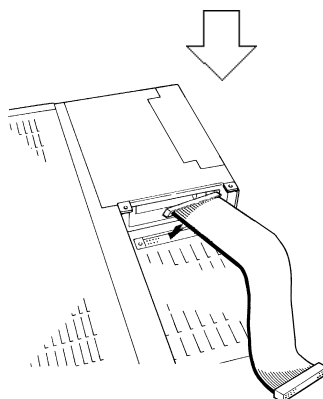

- 2) Connect the CD-ROM unit cable (PL-x900) to the PL's IDF I/F connector.




Be sure that the cable is securely connected before turning ON the PL's power switch.


8 Removing the Cooling Fan Unit

The PL-7900 Series can be operated without its bottom face cooling fan unit. The user should, however, be aware that doing so (i.e. removing the fan unit) will cause the PL's ambient temperature to rise. **Reference** See "2-1-2 Environment Specifications"


■ PL-7901T (2 slot type)

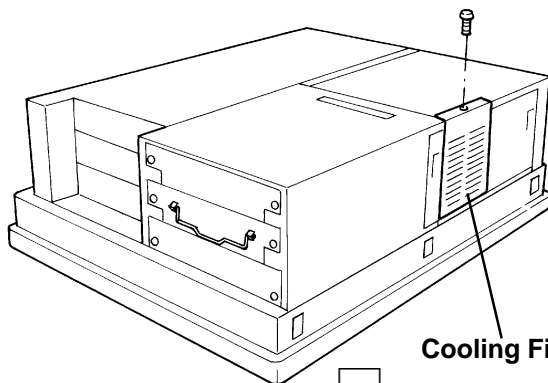

- 1) Remove the attachment screw on the cooling filter cover, and remove the cover.

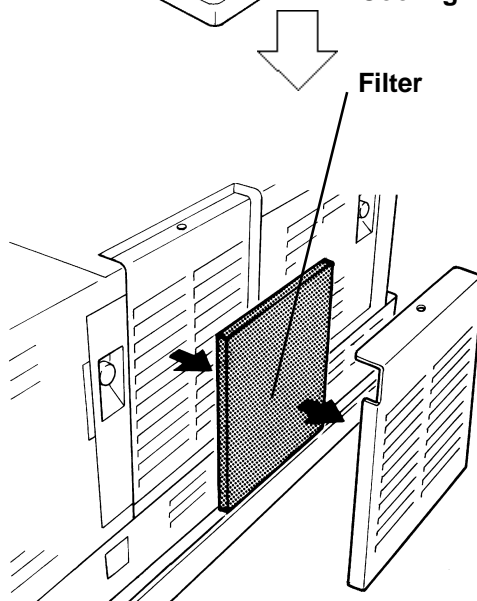


- 2) Remove the filter.

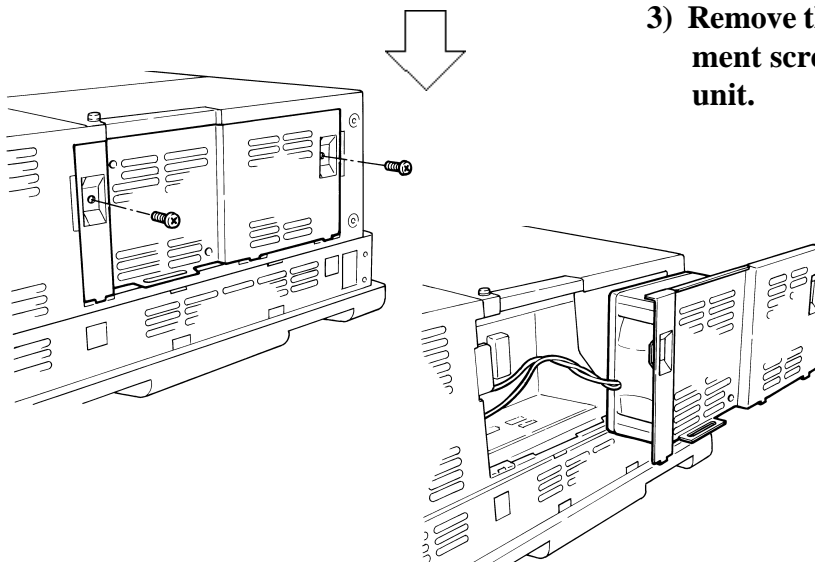


- 3) Remove the two(2) fan unit attachment screws, and take out the fan unit.


Installing Optional Units and Expansion Boards

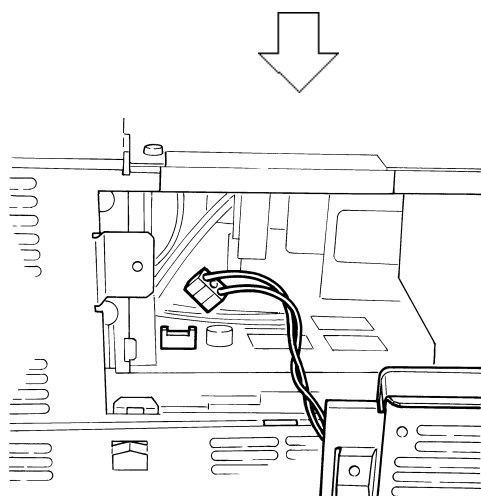

- 4) Unplug the fan unit's power cable connector from the PL.**

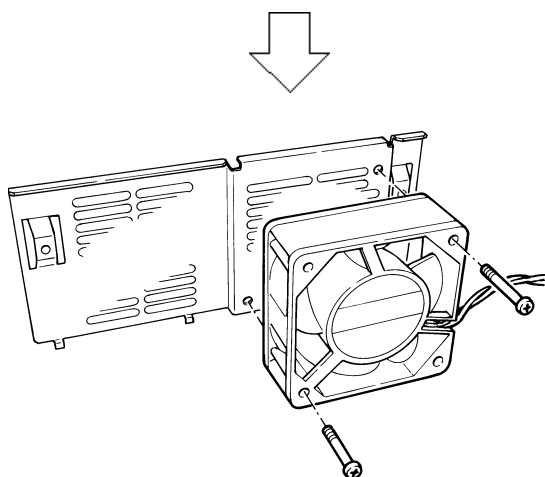


- 5) Unscrew the two (2) attachment screws and remove the fan unit, and then remove the fan unit from the metal plate.**

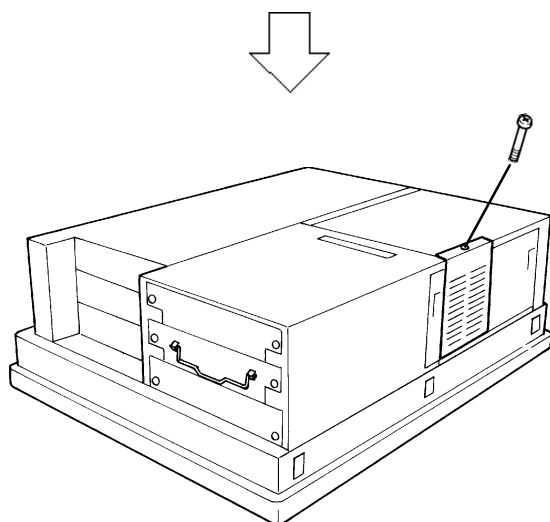


- 6) Secure the metal attachment plate and the cooling filter cover to the PL in place.**

Installing Optional Units and Expansion Boards


■ PL-7900T (4 slot type)

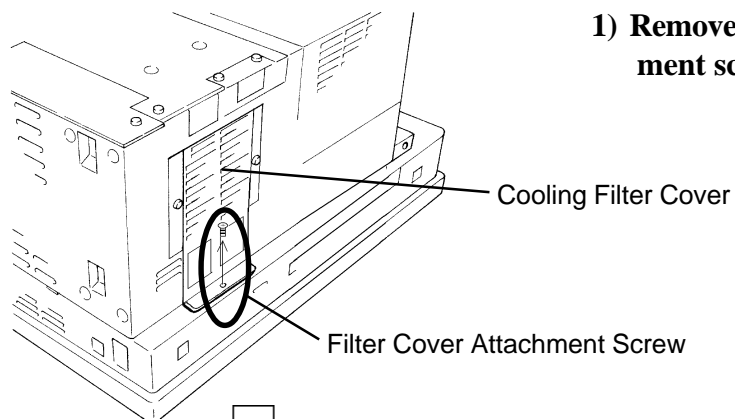

- 1) Remove the cooling filter cover's attachment screws.


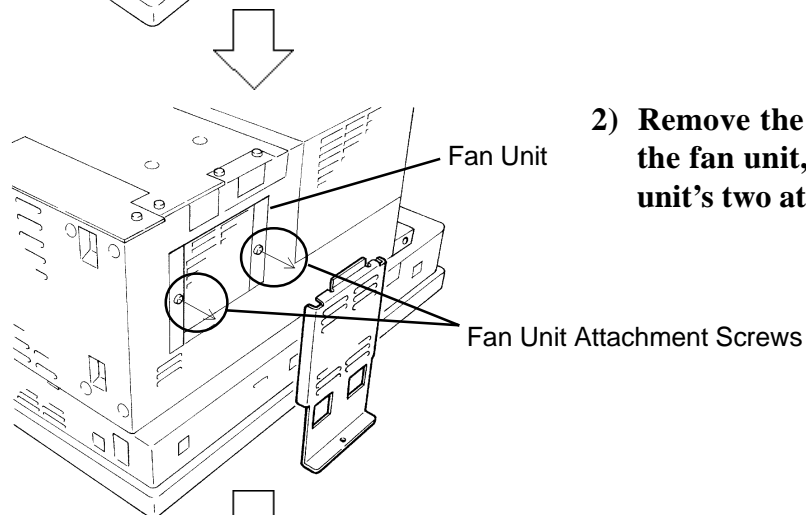


- 2) Remove the cooling filter cover from the fan unit, and then remove the fan unit's two attachment screws.

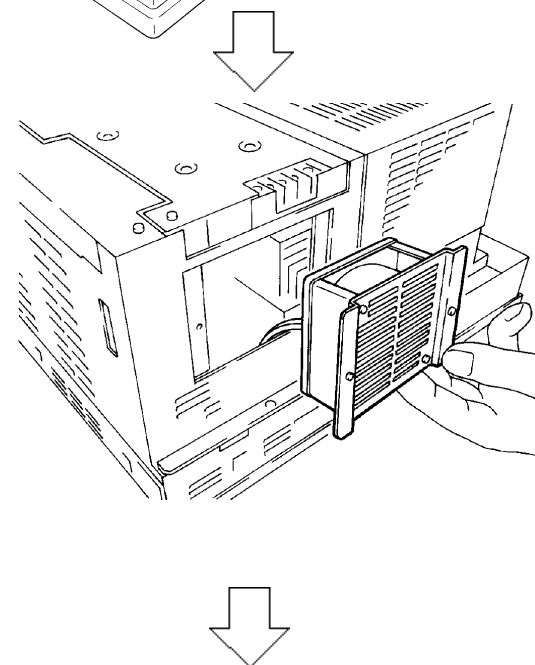

- 3) Remove the fan unit from the PL.

Installing Optional Units and Expansion Boards

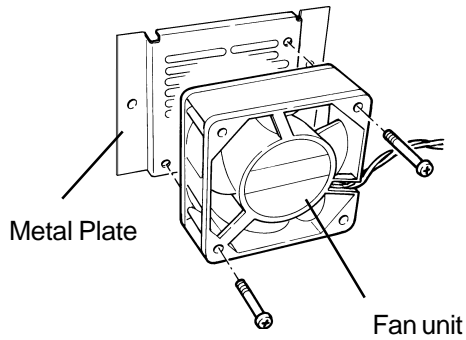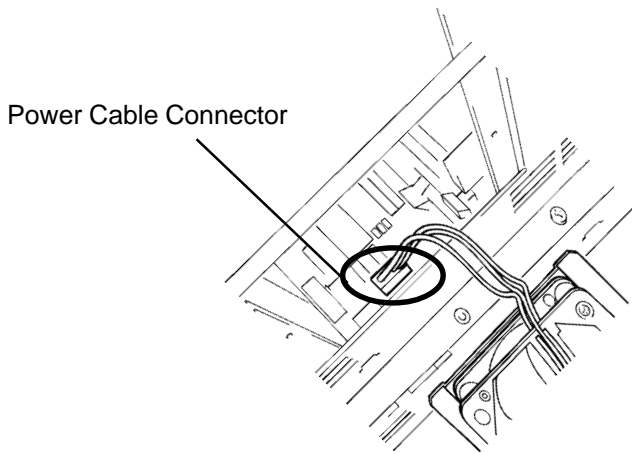

4) Disconnect the fan unit's power cable connector from the PL.

5) Replace the cooling filter cover and re-attach the cooling filter cover's attachment screw.

6) Unscrew the two(2) fan unit's attachment screws and remove the fan unit from the metal plate holding the fan unit.

7) Attach the metal plate and the cooling filter cover to the PL.


MEMO

This page intentionally left blank.

Installation and Wiring

This chapter explains how to install and wire the PL-7900T/PL-7901T, as well as the cautions required both before and during installation.

4-1 Installation Cautions

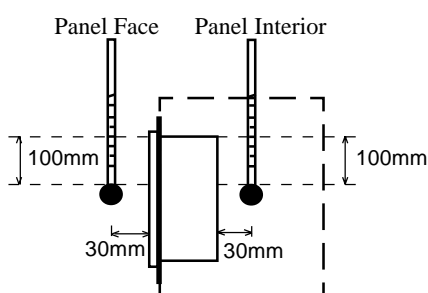


1) Temperature Related Cautions


- The PL should be installed in a vertical position, and forced air cooling should be used, instead of natural air circulation.
- To prevent a machine breakdown, be sure to use the PL within the allowable temperature range as below-listed. Please check “Ambient Operating Temperature” in the position drawn on the left. (“Ambient Operating Temperature” indicates both the panel interior and panel face temperature.)

<Ambient Operating Temperature>

	Panel Interior	Panel Face
W/ PL Fan	5°C to 50°C	5°C to 40°C
W/OUT PL Fan	5°C to 40°C	




Vertical Installation



Horizontal Installation


2) Installation Positioning Cautions

Be sure to install the panel in an upright (vertical) position.

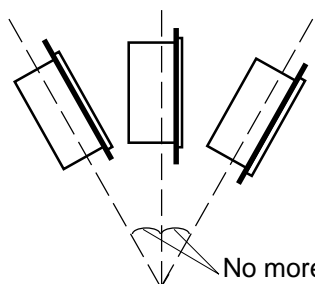

No more than 30 degrees of tilt

Also, be sure that the panel’s viewing angle is tilted no more than 30 degrees from parallel to the operator (i.e. directly in front).

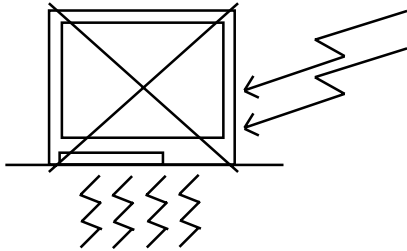

3) Vibration Related Cautions

Be sure to protect the PL from excessive vibration or jolting. These kinds of shocks can cause the PL to malfunction.

PL Condition	Shock Strength
When using the HDD	Up to 0.5G
When using the FDD	Up to 1.0G
When using no drives	Up to 2.0G



Important

- ***Be sure not to move the PL unit while the HDD is starting up. This can lead to a machine breakdown. (Even a slight movement of the PL should not be performed.)***
- ***When using a fan to cool the PL unit, be sure that the fan does not point directly at any of the PL's disk drive units.***

4-2 Installing the PL

1 Installation Procedures


Follow the steps given below when installing the PL-7900 series.

Attaching the Moisture Resistant Gasket

Even if the your PL's Moisture Resistant Gasket is not needed to prevent water from entering the unit, the gasket also acts as a vibration absorber and should always be attached. To install it, place the PL face down on a soft surface and attach the packing to the rear side of the display face, in the plastic bezel's groove. (see picture below)




Before mounting the PL into a cabinet or panel, check that the moisture resistant gasket is attached to the unit.

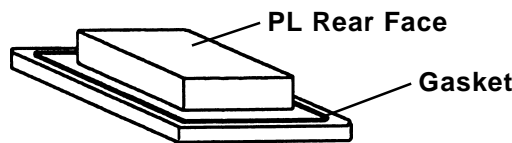

Create an Installation Slot


Create a hole for mounting the PL, like that pictured here. Two additional items, the Moisture Resistant gasket and the mounting brackets are also required when installing the PL. **Reference** 2-5 PL Dimensions




- To obtain the maximum degree of moisture resistance, be sure to mount the PL on a smooth, flat surface.
- The panel itself can be from 1.6 to 10.0 mm thick.



Strengthening may be required for the panel. Be sure to consider the weight of the PL when designing the panel.




Note: To enhance the PL's maintainability, operability and ventilation, allow at least 50mm clearance between the PL and any other objects. (The clearance must be large enough to allow you to insert or remove expansion boards and to attach connectors.)

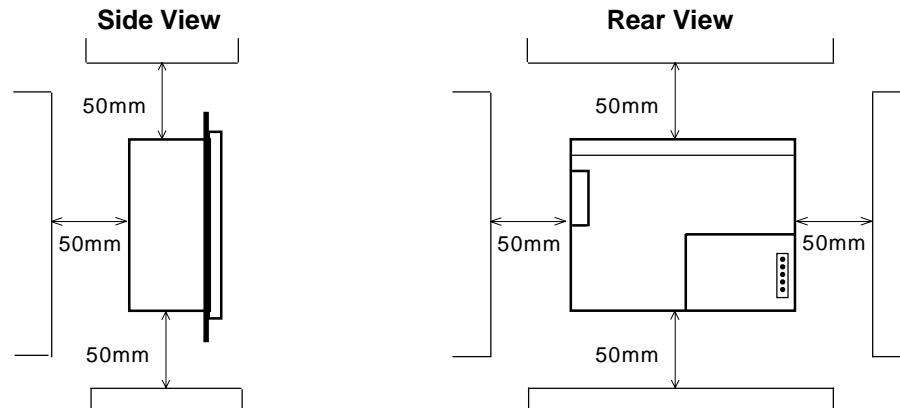


PL Viewing Angle

- Be sure that the panel's viewing angle is tilted no more than 30 degrees from parallel to the operator (i.e. operator is directly in front).

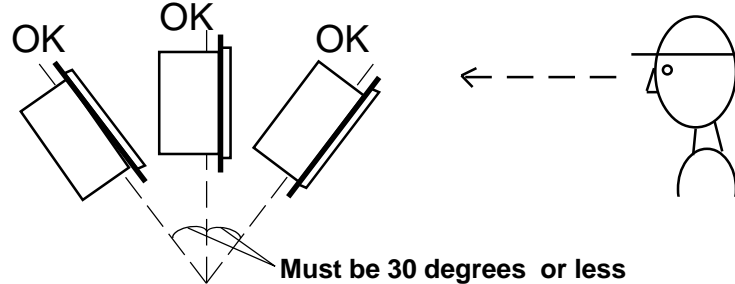

- Avoid placing the PL next to other devices that might cause overheating.
- Avoid using the PL where the ambient temperature will exceed 40°C (50°C when using a cooling fan).
- Keep the PL away from arc-generating devices such as magnetic switches and non-fuse breakers.
- Avoid using the PL in environments where corrosive gases are present.


Insert the PL into the installation slot

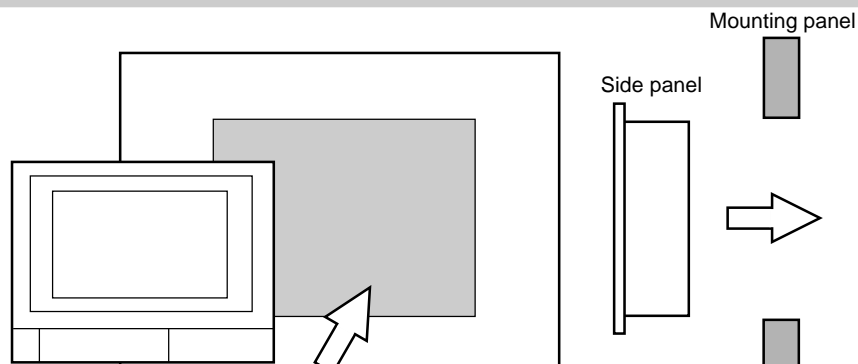


Be sure the installation panel's actual measurements are the same as those given in this chapter, otherwise the PL may move or fall out of the panel.

Attach and Secure the Rear Attachment Brackets


- 1) The PL has twelve attachment holes, located on the top, bottom, and sides of the PL.

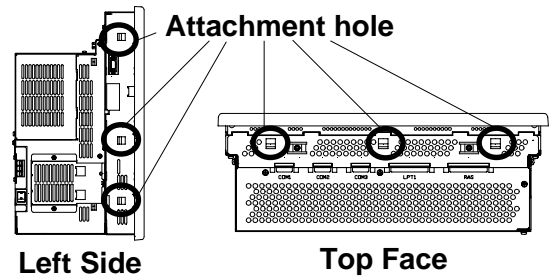


- 2) Insert each bracket into its attachment hole.

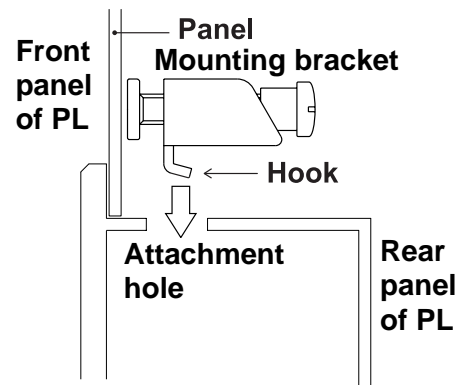

- 3) Slide the bracket backwards until it stops.

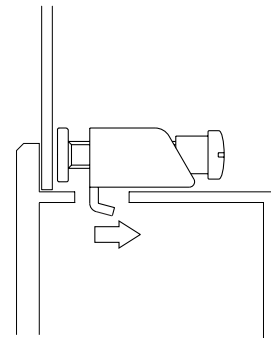

- 4) Use a screwdriver to tighten each bracket's adjustment screw. To ensure a high degree of moisture resistance, the torque should be $0.5\text{N}\cdot\text{m}$.

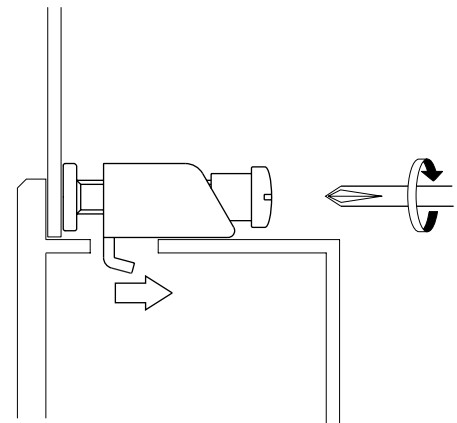


Excessive torque may damage the panel or bracket.

4-3 Wiring the PL

1 Connecting the Power Cord



(Side View)

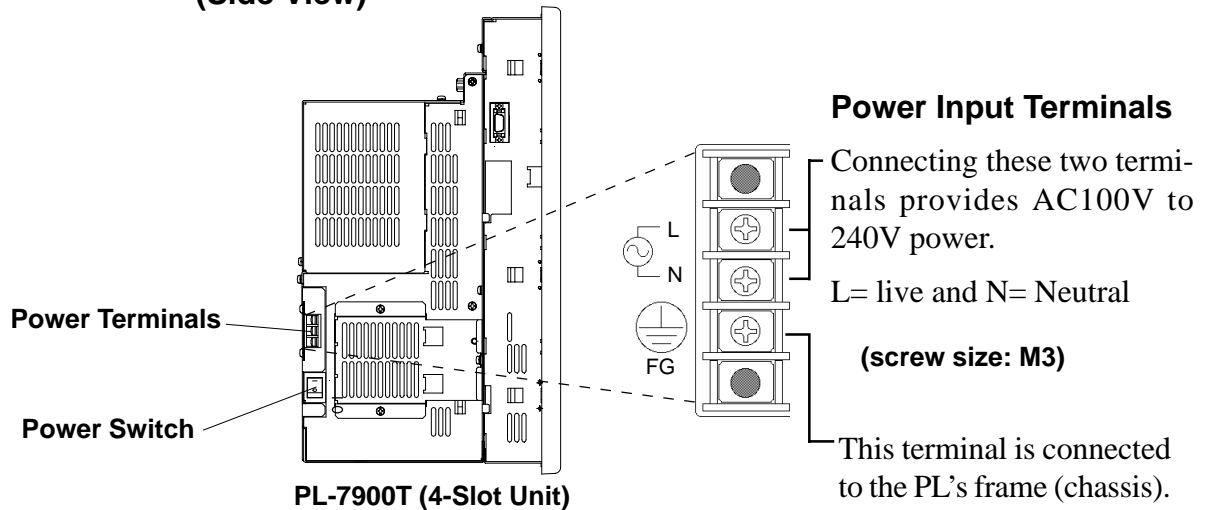


WARNING


- To prevent electric shocks, be sure to turn the PL OFF before connecting the power cord.
- To avoid the dangers of fire, electric hazards and equipment damage, be sure to use only the specified power supply voltage when operating the PL-7900 Series unit.

Use the following steps when connecting the power cord to the PL's power terminals.



- 1) Confirm that the PL's power switch is turned OFF. Then, remove the power terminal's transparent plastic cover.

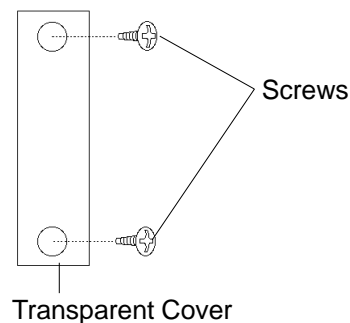

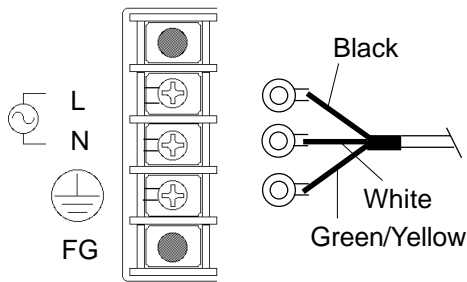

- 2) Loosen and remove the middle three screws from the terminal strip. Align the crimp terminals with each screw hole, and tighten the screws.



Note: • Crimp Terminal Types :
V1.25-3, by J.S.T. or equivalent
(JIS standard part number :
RAV1.25-3)


- Crimp terminals must be the same as shown below.

Max. 6.0 mm $\phi 3.2 \text{ mm or larger}$



Important • The colors used in the figure above are for the cable which came with the PL.






- This power cable is designed only for AC100V/115V use. Be sure to use a different cable when using other than AC100V/115V power.

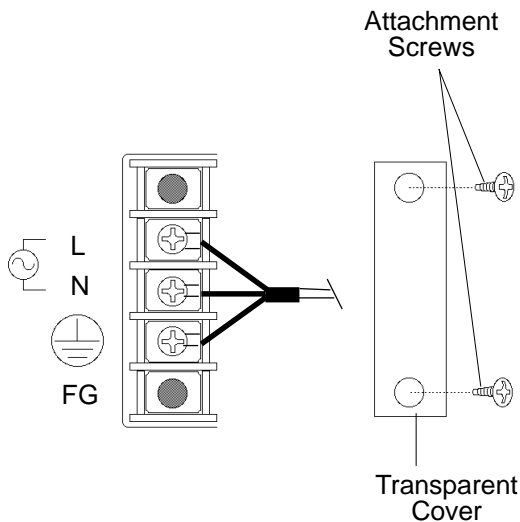

- 3) Reattach the terminal strip's transparent cover and secure it in place with its attachment screws.

2 Power Supply Cautions

When connecting the PL unit's AC power terminals, please be aware of the following:

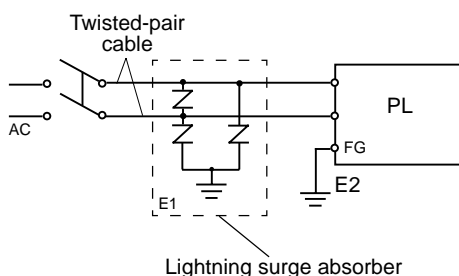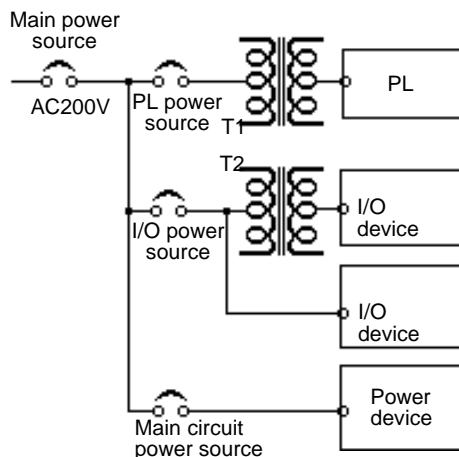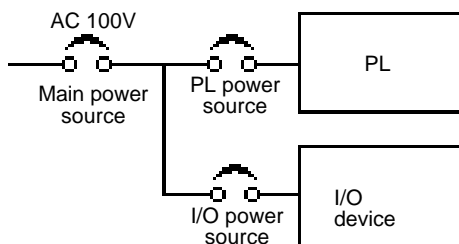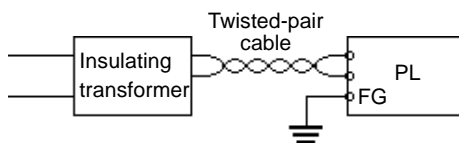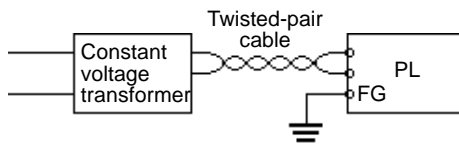

- If voltage fluctuations are expected to vary beyond the specified range, connect a constant voltage transformer.

Reference For information about the specified voltage, refer to **2-1 General Specifications**

- Use a low-noise power supply both between the lines and between the PL and its ground. If there is still excess noise, connect an insulating transformer (noise-prevention type).

Note: Be sure any constant or insulating transformer used has a capacity of 200VA or more.

- Wire the power cords of the PL, I/O devices, and power supply devices separately.

- To improve noise immunity, it is recommended to attach a ferrite core to the power cord.
- Isolate the main circuit (high voltage, large current) line, I/O signal lines, and power cord, and do not bind or group them together.

- To prevent damage from lightning, connect a lightning surge absorber.




- **Ground the lightning surge absorber (E1) and the PL (E2) separately.**

- **Select a lightning surge absorber which will not exceed the allowable circuit voltage, even when the voltage rises to the maximum.**


3 Grounding Cautions

(a) Dedicated Ground - best ^{*1}

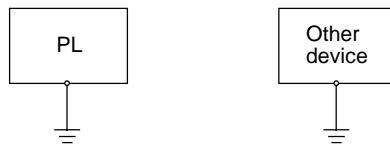


- Set up a dedicated ground when using the rear panel's FG terminal.

(b) Shared Ground - allowed ^{*1}

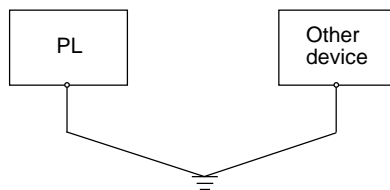

- If a dedicated ground is not possible, use a shared ground, as shown in figure (b).
- The grounding point must be as close to the PL as possible, and the grounding wires must be as short as possible. If the wires must be long, use thick, insulated wires and run them through conduits.

(c) Shared ground - not allowed

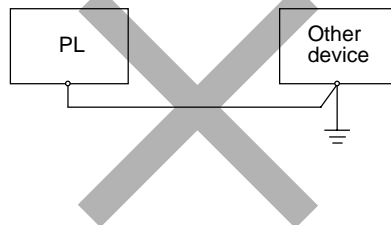

4 Cautions When Connecting I/O Signal Lines

- I/O signal lines must be wired separately from the power cord. If the power cord needs to be wired together with the cord (I/O) signal lines for any reason, use shielded cables and ground one end of the shield to the PL's FG terminal.
- To improve noise immunity, attaching a ferrite core to the power cord is recommended.

^{*1} Use a grounding resistance of 100Ω or less, and a 2mm² or thicker wire, or your country's applicable standard. For details, contact your local PL distributor.

MEMO

This page intentionally left blank.

Chapter

5

5-1 Setup Procedures

5-2 System Parameters

System Setup

This chapter explains how to enter a PL-6900 Series unit's system settings, as well as the cautions required both before and during set up.

5-1 Setup Procedures



Important

Normally, use only the factory (default) settings.



Note: The following settings are those pre-set at the factory.

- 1) Connect a keyboard to the PL.
- 2) Turn the PL's power ON.
- 3) After the message "Press to Enter SETUP" appears, press the [DEL] key until the following screen appears.

ROM PCI/ISA BIOS (2A5LEU1C) CMOS SETUP UTILITY AWARD SOFTWARE, INC.	
STANDARD CMOS SETUP BIOS FEATURES SETUP CHIPSET FEATURES SETUP POWER MANAGEMENT SETUP PNP/PCI CONFIGURATION LOAD BIOS DEFAULTS LOAD SETUP DEFAULTS	SYSTEM MONITOR UTILITY INTEGRATED PERIPHERALS SUPERVISOR PASSWORD USER PASSWORD IDE HDD AUTO DETECTION SAVE & EXIT SETUP EXIT WITHOUT SAVING
ESC : Quit F10 : Save & Exit Setup	↑↓→← : Select Item (Shift)F2 : Change Color
Time, Date, Hard Disk Type ...	

KEYBOARD ACTION KEYS

Provides a summary of the keyboard keys used to carry out the set up.

SYSTEM SETTING SELECTION AREA

Each of the titles (areas) listed here contains system setting items.

- 4) Use the arrow keys to move the cursor to the desired selection.

5-2 System Parameters

1 STANDARD CMOS SETUP

Selecting the STANDARD CMOS SETUP menu item produces the following screen.

ROM PCI/ISA BIOS(2A5LEU1C)						
STANDARD CMOS SETUP						
AWARD SOFTWARE, INC.						
Date (mm:dd:yy): Thu, Jul 2 1998						
Time (hh:mm:ss): 14 : 50 : 3						
		CYLS.	HEADS	PRECOMP	LANDZONE	SECTORS
Drive C	:Auto(0Mb)	0	0	0	0	0
Drive D	:Auto(0Mb)	0	0	0	0	0
Drive A	:1.44M,3.5 in.					
Video :	EGA/VGA					
VGA Text Mode :	Normal					
VGA Graphics Mode :	Normal					
Halt On :	All, But Disk/Key					
Base Memory		: 640K				
Extended Memory		: 645612K				
Other Memory		: 384K				
Total Memory		: 66536K				
ESC	: Quit	↑↓→←	: Select	Item	PU/PD/+/-:Modify	
F1	: Help	(Shift)F2	: Change	Color		

■ Date/Time

This data sets the PL's internal time and date.

Hours :00 - 23

Minutes :00 - 59

Seconds :00 - 59

■ Drive C

This data sets the IDE hard disk's parameters. When this setting is set to [AUTO], the hard disk's parameters are automatically read in. Also, if the "IDE HDD AUTO DETECTION" is in use, the value entered there is automatically set. The three options are [User],[Auto], and [None]. The [Auto] setting is factory set and recommended for most users.

■ Drive D

The three options are [User],[None]and [Auto].

■ Drive A

This setting determines the format used by the PL's internal floppy disk drive. The[1.44M - 3.5in] selection is factory set and recommended for most users. The other available settings are [720K - 3.5in], [1.2M - 5.25in], [360K - 5.25in], [2.88M - 3.5in.], and [None].

■ Video

The selections for the screen (video) mode. The [EGA/VGA] selection is factory set and recommended for most users. The other available settings are [CGA40], [CGA80] and [Mono].

■ VGA Text Mode

This mode changes the screen (video) mode from [Normal](VGA mode) to [Expansion](800×600). The [Normal] selection is factory set and recommended for most users.

■ VGA Graphics Mode

This mode changes the screen (Graphics) mode from [Normal](VGA mode) to [Expansion](800×600). The [Normal] selection is factory set and recommended for most users.

■ Halt On

Designates the type of processing that will be performed when an error occurs during the Initial Start-Up's Self Test. The [All But Disk /Key] selection is factory set and recommended for most users.

- [All Errors] : Displays all errors and stops the unit.
- [No Errors] : Displays all errors and does not stop the unit.
- [All,But Keyboard] : Displays all errors, except for those related to the keyboard, and stops the unit. If the User has no keyboard connected, please use this setting.
- [All,But Diskette] : Displays all errors, except for those related to the disk drive (FDD), and stops the unit.
- [All,But Disk/Key] : Displays all errors, except for those related to the disk drive (FDD) and keyboard, and then stops the unit.

2 BIOS FEATURES SETUP

Selecting the BIOS FEATURES SETUP menu item calls up the following screen.

ROM PCI/ISA BIOS(2A5LEU1C)			
BIOS FEATURES SETUP			
AWARD SOFTWARE, INC.			
Virus Warning	: Disabled	Video BIOS Shadow	: Enabled
CPU Internal Cache	: Enabled	C8000-CBFFF Shadow	: Disabled
External Cache	: Enabled	CC000-CFFFF Shadow	: Disabled
Quick Power On Self Test	: Enabled	D0000-D3FFF Shadow	: Disabled
Boot Sequence	: A,C,SCSI	D4000-D7FFF Shadow	: Disabled
Boot Up Floppy Seek	: Enabled	D8000-DBFFF Shadow	: Disabled
Boot Up NumLock Status	: On	DC000-DFFFF Shadow	: Disabled
Boot Up System Speed	: High		
Gate A20 Option	: Fast		
Memory Parity/ECC Check	: Enabled		
Typematic Rate Setting	: Disabled	ESC : Quit	↑↓→← : Select Item
Typematic Rate(Chars/Sec)	: 6	F1 : Help	PU/PD/+/- : Modify
Typematic Delay (Msec)	: 250	F5 : Old Values	(Shift)F2 : Color
Security Option	: Setup	F6 : Load BIOS Defaults	
		F7 : Load Setup Defaults	
PCI/VGA Palette Snoop	: Disabled		
OS Select For DRAM > 64MB	: Non-OS2		

■ Virus Warning

Designates whether a warning message appears when an error occurs during a write to the Hard Disk's Boot Sector. The two selections are [Disabled] and [Enabled]. The [Disabled] selection is factory set and recommended for most users.

■ CPU Internal Cache

Designates if the CPU's Internal Cache Memory is used or not. The two selections available are [Disabled] and [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ External Cache

Designates if the CPU's External Cache Memory (L2) is used or not. The two selections available are [Disabled] and [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ Quick Power On Self Test

Designates if a simplified Self Test is used after the power is turned ON. The two selections available are [Disabled] and [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ Boot Sequence

Designates the drive order used by the OS during start up.

The [A,C,SCSI] is factory set and recommended for most users. The other available settings are [A,C,SCSI], [C,A,SCSI], [C,CDROM,A], [CDROM,C,A], [D,A,SCSI], [SCSI, A,C,], [SCSI,C,A] and [C Only].

■ Boot Up Floppy Seek

Designates if the floppy disk drive installation check is used or not. The available selections are [Disabled] and [Enabled]. [Enabled] is factory set and recommended for most users.

■ Boot Up NumLock Status

Designates the condition of the NumLock key at startup. The two selections are either [On] or [Off]. The [On] selection is factory set and recommended for most users.

■ Boot Up System Speed

Designates the speed of CPU. [High] is factory set and recommended for most users. The other available selection is [Low].

■ Gate A20 Option

The two selections available are [Fast] and [Normal]. When [Normal] is selected, Keyboard Control is used for Gate A20 control. When [Fast] is selected, the Chipset is used. The [Fast] selection is factory set and recommended for most users.

■ Memory Parity / ECC Check

Designates if a Parity Check is used for Parity Memory. The two selections available are [Disabled] and [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ Typematic Rate Setting

Designates the repeat mode for characters on the keyboard. The selections [Disabled] and [Enabled] are available. [Disabled] is factory set and recommended for most users.

■ Typematic Rate (Chars/Sec)

When [Enabled] is selected on [Typematic Rate Setting], it designates the actual rate (the number of repeating characters per second). [6],[8],[10],[12],[15], [20],[24] and [30] are the available selections.[6] is factory set.

■ Typematic Delay (Msec)

When [Enabled] is selected on [Typematic Rate Setting], it designates the time until repetition of a character starts. The unit is mili-second (msec). The available selections are [250],[500],[750]and [1000]. [250] is factory set.

■ Security Option

Designates the location of the Password Entry. The selection [Setup] is for BIOS setup,and the other selection [System] is for both BIOS setup and Start up.When the [Supervisor Password] or [User Password] has not been designated, this setting is disabled. [Setup] is factory set and recommended for most users.

■ PCI/VGA Palette Snoop

When the PCI/VGA and the MPEG ISA/VESA VAG cards are both used, this setting is set to [Enabled]. In all other cases, this should be set to [Disabled]. The [Disabled] selection is factory set and recommended for most users.

■ OS Select For DRAM >64MB

Select either [Non-OS2] or [OS2]. The [Non-OS2] selection is factory set and recommended for most users.

■ Video BIOS Shadow

Designates whether Video BIOS ROM is expanded into RAM and used from there (C0000-C7FFF). The two selections available are [Disabled] and [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ C8000-CBFFF Shadow to DC000-DFFFF Shadow

When the Expansion Board's ROM is placed in this area, this setting designates if the ROM expands into the RAM area. The two available selections are [Disabled] and [Enabled]. The [Disabled] selection is factory set and recommended for most users.

3 CHIPSET FEATURES SETUP

Selecting the CHIPSET FEATURES SETUP menu item calls up the following screen.

ROM PCI/ISA BIOS(2A5LEU1C) CHOS SETUP UTILITY CHIPSET FEATURES SETUP	
Bank 0/1 DRAM Timing : 70ns	OnChip USB : Disabled
SDRAM Cycle Length : 3	
DRAM Read Pipeline : Enabled	
Sustained 3T Write : Enabled	
Cache Rd+CPU Wt Pipeline : Enabled	
Cache Timing : Fast	
Video BIOS Cacheable : Enabled	
System BIOS Cacheable : Enabled	
Memory Hole At 15Mb Addr. : Disabled	
ESC : Quit ↑↓→← : Select Item F1 : Help PU/PD/+/- : Modify F5 : Old Values (Shift)F2 : Color F6 : Load BIOS Defaults F7 : Load Setup Defaults	

■ Bank 0/1 DRAM Timing

Designates the length of time of accessing to the memory set up on the memory slot 0/1. The available selections are [70ns], [60ns], [Normal], [Medium], [Fast] and [Turbo]. [70ns] is factory set and recommended for most users.

■ SDRAM Cycle Length

Designates the length of the cycle time of SDRAM. The available selections are [3] and [2], [3] is factory set and recommended for most users.

■ DRAM Read Pipeline

Designates if the DRAM performs the pipeline read. The available selections are [Enabled] and [Disabled], [Enabled] is factory set and recommended for most users.

■ Sustained 3T Write

Designates if the DRAM performs the write back and the write through in the secondary cache. The available selections are [Enabled] and [Disabled]. [Enabled] is factory set and recommended for most users.

■ Cache Rd+CPU Wt Pipeline

Designates the length of time of waiting for the cache performance. The available selections are [Enabled] and [Disabled], [Enabled] is factory set and recommended for most users.

■ Cache Timing

Designates the access speed of the cache. The available selections are [Fast] and [Fastest]. [Fast] is factory set and recommended for most users.

■ Video BIOS Cacheable

Designates if the cache performs on the Video BIOS. The available selections are [Enabled] and [Disabled], [Enabled] is factory set and recommended for most users.

■ System BIOS Cacheable

Designates if the cache performs on the System BIOS. Using System BIOS speeds up the program operation. The available selections are [Enabled] and [Disabled], [Enabled] is factory set and recommended for most users.

■ Memory Hole At 15Mb Addr.

Designates if the memory hole 15MB to 16MB is allocated to the buffer memory for the ISA bus card. The available selections are [15M-16M] and [Disabled], [Disabled] is factory set and recommended for most users.

■ On Chip USB

Used for USB type peripheral equipment. The available selections are [Enabled] and [Disabled], [Disabled] is factory set and recommended for most users.

4 POWER MANAGEMENT SETUP

Selecting the POWER MANAGEMENT SETUP menu item calls up the following screen.

ROM PCI/ISA BIOS(2A5LEU1C)	
POWER MANAGEMENT SETUP	
AWARD SOFTWARE, INC.	
Power Management : User Define	Primary INTR : ON
PM Control by APM : No	IRQ3 (COM 2) : Primary
Video Off Option : Suspend→Off	IRQ4 (COM 1) : Primary
Video Off method : V/H SYNC+Blank	IRQ5 (LPT 2) : Primary
MODEM Use IRQ : NA	IRQ6 (Floppy Disk) : Primary
	IRQ7 (LPT 1) : Primary
	IRQ8 (RTC Alarm) : Primary
	IRQ9 (IRQ2 Redir) : Primary
	IRQ10 (Reserved) : Primary
	IRQ11 (Reserved) : Primary
	IRQ12 (PS/2 Mouse) : Primary
	IRQ13 (Coprocessor) : Primary
	IRQ14 (Hard Disk) : Primary
	IRQ15 (Reserved) : Primary
PM Timers HDD Power Down : 10Min Doze Mode : Disable Suspend Mode : Disable	
PM Events VGA : OFF LPT & COM : LPT/COM HDD & FDD : ON DMA/master : OFF	
ESC :Quit ↑↓→← : Select Item F1 : Help PU/PD/+/- : Modify F5 : Old Values (Shift)F2 : Color F6 : Load BIOS Defaults F7 : Load Setup Defaults	

■ Power Management

You can choose from three power management options. These are [User Define], [Min Saving] or [Max Saving]. The [User Define] selection is factory set and recommended for most users.

■ PM Control by APM

Designates if the power management is controlled by the APM. The two selections available are [Yes] and [No]. The [No] selection is factory set and recommended for most users.

■ Video Off Option

Turns the display off. The selections are [Always On], [Suspend→Off],[All Modes→Off]. [Suspend→Off] is factory set and recommended for most users.

■ Video Off Method

Designates the method of turning the display off. The available selections are [V/H SYNC+Blank], [Blank Screen] and [DPMS Support]. To turn off both the display and the Vertical / Horizontal synchronous signal, select [V/H SYNC+Blank]. To turn off the display only, select [Blank Screen]. Select [DPMS support] when the CRT display is supported by DPMS. [V/H SYNC+Blank] is factory set and recommended for most users.

■ MODEM Use IRQ

Selections for this feature include [NA],[3],[4],[5],[7],[9],[10],[11]. The [NA] selection is factory set and recommended for most users.

■ HDD Power Down

Designates the length of time until the motor of the hard disk stops. The available selections are [1Min]→[15Min] and [Disabled]. [10Min] is factory set and recommended for most users.

■ Doze Mode

When there is no reply from the system within designated time, by using this mode the CPU operation will be automatically stopped. [Disable] is factory set and recommended for most users.

■ Suspend Mode

When there is no reply from the system within designated time, by using this mode all peripheral equipment operation will be stopped. [Disable] is factory set and recommended for most users.

■ VGA

Designates if the system is turned on when any event is driven in the VGA port. The available selections are [ON] and [OFF]. [OFF] is factory set and recommended for most users.

■ LPT & COM

Designates if the system is turned on when any event is driven in the serial port or the printerport. The available selections are [None], [LPT], [COM] and [LPT /COM]. [LPT/COM] is factory set and recommended for most users.

■ HDD & FDD

Designates if the system is turned on when any event is driven in the hard disk or floppy disk. The available selections are [ON] and [OFF]. [ON] is factory set and recommended for most users.

■ DMA / master

Designates if the system is turned on when any event is driven in the DMA controller. The available selections are [ON] and [OFF]. [OFF] is factory set and recommended for most users.

■ Primary INTR

Designates if the system is turned on when any event is driven in the Primary Interrupt Controller. The available selections are [ON] and [OFF]. [ON] is factory set and recommended for most users.

■ IRQ3-IRQ15

Designates if the COM Port is monitored or not. The available selections are [Disabled], [Primary] and [Secondary].

5 PNP/PCI CONFIGURATION SETUP

Selecting the PNP/PCI CONFIGURATION SETUP menu item displays the following screen.

ROM PCI/ISA BIOS(2A5LEU1C)			
PNP/PCI CONFIGURATION			
AWARD SOFTWARE, INC.			
PNP OS Installed	: No	CPU to PCI Write Buffer	: Enabled
Resources Controlled By	: Manual	PCI Dynamic Bursting	: Enabled
Reset Configuration Data	: Disabled	PCI Master 0 WS Write	: Enabled
ACPI I/O Device Node	: Enabled	PCI Delay Transaction	: Enabled
IRQ-3 assigned to	: Legacy ISA	PCI Master Read Prefetch	: Enabled
IRQ-4 assigned to	: Legacy ISA	PCI#2 Access #1 Retry	: Disabled
IRQ-5 assigned to	: PCI/ISA PnP		
IRQ-7 assigned to	: Legacy ISA		
IRQ-9 assigned to	: Legacy ISA	PCI IRQ Activated By	: Level
IRQ-10 assigned to	: Legacy ISA	Assign IRQ For USB	: Disabled
IRQ-11 assigned to	: PCI/ISA PnP		
IRQ-12 assigned to	: Legacy ISA		
IRQ-14 assigned to	: Legacy ISA		
IRQ-15 assigned to	: PCI/ISA PnP		
DMA-0 assigned to	: PCI/ISA PnP	ESC: Quit	↑↓→← : Select Item
DMA-1 assigned to	: PCI/ISA PnP	F1 : Help	PU/PD/+/-: Modify
DMA-3 assigned to	: PCI/ISA PnP	F5 : Old Values	(Shift)F2: Color
DMA-5 assigned to	: PCI/ISA PnP	F6 : Load BIOS Defaults	
DMA-6 assigned to	: PCI/ISA PnP	F7 : Load Setup Defaults	
DMA-7 assigned to	: PCI/ISA PnP		

■ PNP OS Installed

Setting used when the user's OS complies with Plug-And-Play standards. The selection options are either [Yes] or [No]. The [No] setting is factory set and recommended for most users.

■ Resources Controlled By

The Plug and Play feature allows you to designate whether the allocation of I/O Port, IRQ and DMA resources is performed automatically or manually. The two selections available are [Manual] and [Auto]. The [Manual] selection is factory set and recommended for most users.

■ Reset Configuration Data

Designates whether ESCD (Extended System Configuration Data) data should be erased or not. The two selections available are [Disabled] and [Enabled]. The [Disabled] selection is factory set and recommended for most users.

■ ACPI I/O Device Node

When an I/O device is connected to the PL that is ACPI compliant, The PL's ACPI feature is enabled. The two selections available are [Enabled] and [Disabled]. The [Enabled] selection is factory set and recommended for most users.

■ IRQ-3 assigned to - IRQ-15 assigned to

Only after the "Resources Controlled By" setting is set to [Manual] can the following IRQ-3 assigned to - IRQ-15 assigned to settings be changed. These settings are used for the [PCI/ISA PnP] and [Legacy ISA] items.

[PCI/ISA PnP] : Used for PCI or ISA's PnP Card

[Legacy ISA] : Used for ISA Cards that do not comply with PnP

	INITIAL SETTING		INITIAL SETTING
IRQ-3 assigned to	Legacy ISA	IRQ-10 assigned to	Legacy ISA
IRQ-4 assigned to	Legacy ISA	IRQ-11 assigned to	PCI/ISA PnP
IRQ-5 assigned to	PCI/ISA PnP	IRQ-12 assigned to	Legacy ISA
IRQ-7 assigned to	Legacy ISA	IRQ-14 assigned to	Legacy ISA
IRQ-9 assigned to	Legacy ISA	IRQ-15 assigned to	PCI/ISA PnP

■ DMA-0 assigned to - DMA-7 assigned to

Only after the "Resources Controlled By" setting is set to [Manual] can the following DMA-0 assigned to - DMA-7 assigned to settings be changed. These settings are used for the [PCI/ISA PnP] and [Legacy ISA] items.

[PCI/ISA PnP] : Used for PCI or ISA's PnP Card

[Legacy ISA] : Used for ISA Cards that do not comply with PnP

	INITIAL SETTING		INITIAL SETTING
DMA-0 assigned to	PCI/ISA PnP	DMA-5 assigned to	PCI/ISA PnP
DMA-1 assigned to	PCI/ISA PnP	DMA-6 assigned to	PCI/ISA PnP
DMA-3 assigned to	PCI/ISA PnP	DMA-7 assigned to	PCI/ISA PnP

■ CPU to PCI Write Buffer

Setting for the PCI Write Buffer. If [Disabled] is selected, it becomes the CPU's Read Cycle [Enable] or [Disable] toggle. The [Enabled] selection is factory set and recommended for most users.

■ PCI Dynamic Bursting

Setting for the PCI's Burst Transmission. The available settings are [Enable] and [Disable]. [Enabled] is factory set and recommended for most users.

■ PCI Master 0 WS Write

Sets the duration of the wait for the writing to the PCI Bus to "0". [Enabled] and [Disabled] are available. The [Enabled] setting is factory set and recommended for most users.

■ PCI Delay Transaction

This feature enables or disables the Chip Set's PCI Delay Transaction Cycle's built in 32Bit Posted Buffer support. [Enabled] and [Disabled] are available. The [Enabled] setting is factory set and recommended for most users.

■ PCI Master Read Prefetch

Enables or disables the PCI Master Read Prefetch feature. [Enabled] and [Disabled] are available. The [Enabled] setting is factory set and recommended for most users.

■ PCI #2 Access #1 Retry

Enables or disables the PCI "2 Access #1 Retry feature. [Enabled] and [Disabled] are available. The [Disabled] setting is factory set and recommended for most users.

■ PCI IRQ Activated by

Designates the interrupt method used for the unit's PCI slots. [Level] or [Edge] can be used. [Level] is factory set and recommended for most users.

■ Assign IRQ For USB

Designates if the interrupt is allocated for USB equipment or not. [Enabled] and [Disabled] are available. The [Disabled] setting is factory set and recommended for most users.

6

SYSTEM MONITOR UTILITY

Selecting SYSTEM MONITOR UTILITY menu item displays the following screen.

ROM PCI/ISA BIOS(2A5LEU1C) SYSTEM MONITOR UTILITY AWARD SOFTWARE, INC.	
CPU Warning Temperature : Disabled	
System Warning Temp. : Disabled	
Power FAN : Tolerance : Disabled	
CPU FAN : Tolerance : Disabled	
IN0(Vcore) : Tolerance : Disabled	
IN2(3.3V) : Tolerance : Disabled	
IN3(5V) : Tolerance : Disabled	
IN4(12V) : Tolerance : Disabled	
IN5(-12V) : Tolerance : Disabled	
IN6(-5V) : Tolerance : Disabled	
	ESC: Quit ↑↓→← : Select Item F1 : Help PU/PD/+/-: Modify F5 : Old Values (Shift)F2: Color F6 : Load BIOS Defaults F7 : Load Setup Defaults

■ CPU Warning Temperature

Sets the temperature level that will trigger a CPU overheating alarm. Ten selections are available - [Disabled], [40°C/104°F], [45°C/113°F], [50°C/122°F], [55°C/131°F], [60°C/140°F], [65°C/149°F], [70°C/158°F], [75°C/167°F], [80°C/176°F]. The [Disabled] selection is factory set and recommended for most users.

■ System Warning Temp

Sets the temperature level where a motherboard overheating alarm is triggered. Ten selections are available - [Disabled], [40°C/104°F], [45°C/113°F], [50°C/122°F], [55°C/131°F], [60°C/140°F], [65°C/149°F], [70°C/158°F], [75°C/167°F], [80°C/176°F]. The [Disabled] selection is factory set and recommended for most users.

■ Power FAN

Sets the allowable range for the PL's power supply fan. [Disabled] , [+/-30%] and [+/-50%] are available. The [Disabled] selection is factory set and recommended for most users.

■ CPU FAN

Sets the allowable range for the PL's power supply fan. [Disabled] , [+/-30%] and [+/-50%] are available. The [Disabled] selection is factory set and recommended for most users.

■ INO(Vcore)

Sets the allowable range for the INO(Vcore) voltage. [Disabled], [+/-4%] and [+/-6%] are available. The [Disabled] selection is factory set and recommended for most users.

■ IN2(3.3V)

Sets the allowable range for the IN2(3.3V) voltage. [Disabled], [+/-4%] and [+/-6%] are available. The [Disabled] selection is factory set and recommended for most users.

■ IN3(5V)

Sets the allowable range for the IN3(5V) voltage. [Disabled], [+/-4%] and [+/-6%] are available. The [Disabled] selection is factory set and recommended for most users.

■ IN4(12V)

Sets the allowable range for the IN4(12V) voltage. [Disabled], [+/-4%] and [+/-6%] are available. The [Disabled] selection is factory set and recommended for most users.

■ IN5(-12V)

Sets the allowable range for the IN5(-12V) voltage. [Disabled], [+/-4%] and [+/-6%] are available. The [Disabled] selection is factory set and recommended for most users.

■ IN6(-5V)

Sets the allowable range for the IN6(-5V) voltage. [Disabled], [+/-4%] and [+/-6%] are available. The [Disabled] selection is factory set and recommended for most users.

7 INTEGRATED PERIPHERALS

Selecting INTEGRATED PERIPHERALS SETUP menu item displays the following screen.

ROM PCI/ISA BIOS(2A5LEU1C)			
INTEGRATED PERIPHERALS			
AWARD SOFTWARE, INC.			
OnChip IDE First Channel	: Enabled	Onboard Serial Port 3	: 3E8H
IDE Prefetch Mode	: Disabled	Serial Port 3 Use IRQ	: IRQ9
IDE HDD Block Mode	: Disabled	Onboard Serial Port 4	: 2E8H
IDE Primary Master PIO	: Auto	Serial Port 4 Use IRQ	: IRQ10
IDE Primary Slave PIO	: Auto		
IDE Primary Master UDMA	: Auto		
IDE Primary Slave UDMA	: Auto		
Onboard FDC Controller	: Enabled	ESC: Quit	↑↓→← : Select Item
Onboard Serial Port 1	: 3F8/IRQ4	F1 : Help	PU/PD/+/-: Modify
Onboard Serial Port 2	: 2F8/IRQ3	F5 : Old Values	(Shift)F2: Color
UR2 Mode	: Standard	F6 : Load BIOS Defaults	
Onboard Parallel Port	: 3BC/IRQ7	F7 : Load Setup Defaults	
Parallel Port Mode	: SPP		

■ OnChip IDE First Channel

Designates the internal IDE port's setting. The two selections available are [Disabled] and [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ IDE Prefetch Mode

Designates if the IDE drive's high speed access is performed by enabling the Prefetch Mode. The two selections available are [Disabled] and [Enabled]. The [Disabled] selection is factory set and recommended for most users.

■ IDE HDD Block Mode

Designates the Hard disk's Block Operation Mode. The two selections available are [Disabled] and [Enabled]. The [Disabled] selection is factory set and recommended for most users.

■ IDE Primary Master PIO

Designates the Master Drive's Operation Mode. Only after the "Internal PCI/IDE" has been set to [Primary] can these IDE Primary Master PIO settings be entered. The two selections available are [Auto], [Mode0], [Mode1], [Mode2], [Mode3], and [Mode4]. The [Auto] selection is factory set and recommended for most users.

■ IDE Primary Slave PIO

Designates the Slave Drive's Operation Mode. Only after the "Internal PCI/IDE" has been set to [Primary] can these IDE Primary Slave PIO settings be entered. The two selections available are [Auto], [Mode0], [Mode1], [Mode2], [Mode3], and [Mode4]. The [Auto] selection is factory set and recommended for most users.

■ IDE Primary Master UDMA

Designates the Master Drive's UDMA Operation Mode. The two selections available are [Auto] or [Disabled]. The [Auto] selection is factory set and recommended for most users.

■ IDE Primary Slave UDMA

Designates the Slave Drive's UDMA Operation Mode. The two selections available are [Auto] or [Disabled]. The [Auto] selection is factory set and recommended for most users.

■ Onboard FDC Controller

Designates whether the PL's FDD(Floppy Disk Drive) controller is used or not. The two selections available are [Disabled] or [Enabled]. The [Enabled] selection is factory set and recommended for most users.

■ Onboard Serial Port1

Designates the PL's Serial Port1 address setting. The selections include [Disabled], [Auto], [3F8/IRQ4], [2F8/IRQ3], [3E8/IRQ4] or [2E8/IRQ3]. The [3F8/IRQ4] selection is factory set and recommended for most users.

■ Onboard Serial Port2

Designates the PL's Serial Port2 address setting. The selections include [Disabled], [Auto], [3F8/IRQ4], [2F8/IRQ3], [3E8/IRQ4] or [2E8/IRQ3]. The [2F8/IRQ3] selection is factory set and recommended for most users.

■ UR2 Mode

Designates the IR function used by the PL's onboard I/O chip. The selections include [Standard], [Sharp IR], [IrDA SIR]. The [Standard] selection is factory set and recommended for most users. When serial port 2 is used for RS-232C communication, and the [standard] option's PL-IR100 selection is used, set this item to [IrDA/SIR].

■ Onboard Parallel Port

Selects the PL Parallel Port 1's I/O Address. The selections include [Disabled], [3BC/IRQ7], [378/IRQ7] or [278/IRQ5]. The [3BC/IRQ7] selection is factory set and recommended for most users.

■ Parallel Port Mode

Here, the parallel port's operation mode can be selected ([SPP], [EPP1.7], [EPP1.9], [ECP], or [ECP + EPP]). Normally, [SPP] is used and recommended for most users. When either [ECP] or [ECP+EPP] is selected, the [ECP Mode Use DMA] setting can be used.

■ ECP Mode Use DMA

Designates the ECP mode's DMA channel. [1] and [3] are available selections, however, this item can be set only when the Parallel Port Mode is set to either [ECP] or [ECP+EPP].

■ Onboard Serial Port 3

Designates the PL's Serial port 3 address setting. The selections include [Disabled], [3F8H], [2F8H], [3E8H], or [2E8H]. The [3E8H] selection is factory set and recommended for most users.

■ Serial Port 3 Use IRQ

Designates the PL's Serial Port 3, which is internally connected to the touch panel, allocation numbers. The selections include [IRQ3], [IRQ4], [IRQ9], [IRQ10], or [IRQ15]. The [IRQ9] selection is factory set and recommended for most users.

■ Onboard Serial Port 4

Designates the PL's Serial Port 4, which is internally connected to the touch panel, address setting. The selections include [Disabled], [3F8H], [2F8H], [3E8H], or [2E8H]. The [2E8H] selection is factory set and recommended for most users.

■ Serial Port 4 Use IRQ

Designates the PL's Serial Port 4 allocation numbers. The selections include [IRQ3], [IRQ4], [IRQ9], [IRQ10], or [IRQ15]. The [IRQ10] selection is factory set and recommended for most users.

8 IDE HDD AUTO DETECTION SETUP

Selecting the IDE HDD AUTO DETECTION menu item produces the following screen.

Provides automatic detection of any hard disk connected to the IDE. Normally unused.

ROM PCI/ISA BIOS(2A51IU1C)
CMOS SETUP UTILITY
AWARD SOFTWARE, INC.

	CYLS.	HEADS	PRECOMP	LANDZONE	SECTORS	MODE
Drive C : (Mb)						

Select Drive C Option(N=Skip) : N

OPTIONS	SIZE	CYLS.	HEADS	PRECOMP	LANDZONE	SECTORS	MODE
2(Y)	2167	525	128	0	4199	63	LBA
1	2167	4200	16	65535	4199	63	NORMAL
3	2167	525	128	65535	4199	63	LARGE

Note : Some OSes (like SCO-UNIX) must use "NORMAL" for Installation

ESC:Skip

Chapter

6-1 Setting Up Your PL OS

6

OS Setup

This chapter provides information about the set up of the PL's Windows® 95 or Windows NT® operating systems (OS).

6-1 Setting Up Your PL OS

The Digital Electronics Corporation has prepared the following additional program files which are not supported by the standard versions of the Windows® 95 and Windows NT® 4.0 operating systems. These files must be installed from the additional “PL-X900 Series Driver & Utility Disk”.

To set up the OS with these files, you will need to prepare one of the FDD units, the PL-FD200 or the PL-FD210 (only for the PL-7900), and a PS/2 compatible keyboard.

The software contained in the PL's accompanying “PL-X900 Series Driver & Utility Disk” is designed specifically for use with only the Windows® type of OS. If this software is used with other OS types, its performance cannot be guaranteed.

**Note:**

Be sure to read “PL-X900 Series Driver and Utility Disk” README documents prior to using the PL unit, since they contain the latest PL related information and manual updates.

The README file contains the following information.

Windows® 95 (README.95)

- I. Preface
- II. Cautions
- III. Software Configuration
- IV. Installation Method
- V. Software Installation

Windows NT® 4.0 (README.NT)

- 1. Preface
- II. Cautions
- III. Software Configuration
- IV. Installation Method
- V. Software Installation
- VI. System Automatic Log-On Settings
- VII. Uninterrupted Power Supply

1 Touch Panel Device Driver Settings

When using the Touch Panel display, the following touch panel drivers will be needed.

With Windows® 95: Digital Electronics Corporation's PL-ME000

With Windows NT® 4.0: Gunze Corporation's TT-WINNT



The PL-ME000 software is designed exclusively by Digital for the Windows® 95 OS. The Gunze corporation's TT-WINNT software's performance is still being evaluated by Digital for the Windows NT® 4.0 system.

When installing the Touch Panel's device driver, the following page's dialog boxes will be used. Enter the settings given here in these screens.

◆ Hardware Controls(Serial)

COM Port	:COM 4
Configuration	
Address	: 2E8h
Irq	: 10
Baud rate	: 9600
Parity	: None
Data Bits	: 8
Stop Bits	: 1

◆ Button Modes

Current Button Mode	: Time/Tap
---------------------	------------

◆ User Controls

Miscellaneous Settings

Click time	: One level slower than Fast
Double Click speed	: Slow
Lift off time	: Fast
Stabilization	: Low
Touch Offset	: Leave unselected
Sound	: Select (check mark)
Button simulation	: Left

◆ Advanced Settings

Miscellaneous

Swap X/Y	: Leave unselected
Initialize	: Leave unselected


MEMO

This page intentionally left blank.


Maintenance and Inspection

7-1 Regular Cleaning


1 Cleaning the Display




Neutral
detergent

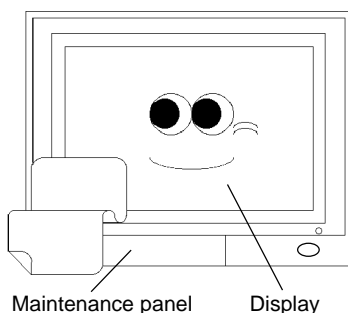


When the display surface or frame become dirty, use a soft cloth moistened with neutral detergent to wipe away any dust or stains.




Thinner
Organic solvent
Strong acid

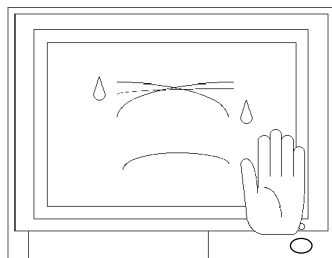

Do not clean the unit with thinner, organic solvents, or strong acids.

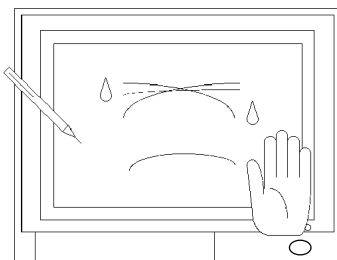

Do not use sharp or hard objects, such as a mechanical pencil or screwdriver, to push on the display. This could damage the unit.

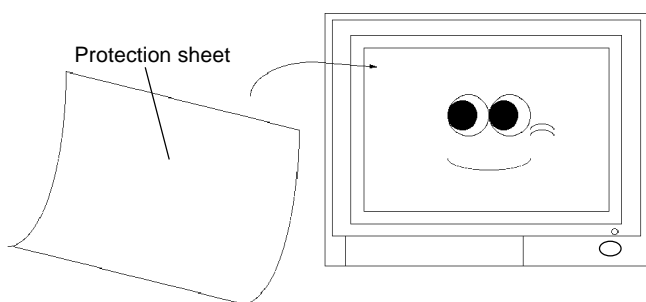

Protection sheet

Use the screen protection sheet when using the PL in extremely dirty or dusty areas.

2 Moisture Resistant Gasket Replacement

The moisture resistant gasket protects the PL and improves its water resistance.

For instructions on installing the PL's gasket, **Reference** 4-2 *Installing the PL*




Note: A gasket which has been used for a long period of time may have scratches or dirt on it, and could have lost much of its water resistance. Be sure to change the gasket periodically (or when scratches or dirt become visible).


7-2 Cleaning the Filter

Since excessive dirt and dust in the filter of the PL-7900T/PL-7901T's cooling fan can potentially affect the performance of the unit, regular inspection and cleaning of the filter is strongly recommended.


■ PL-7900T(4 slot type)

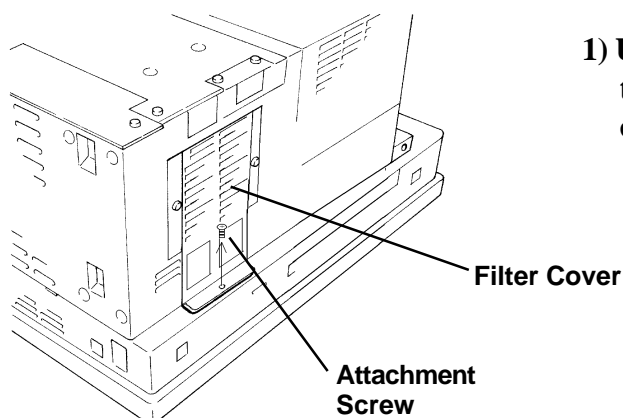

- 1) Unscrew the cooling fan filter cover's attachment screw and remove the filter cover.



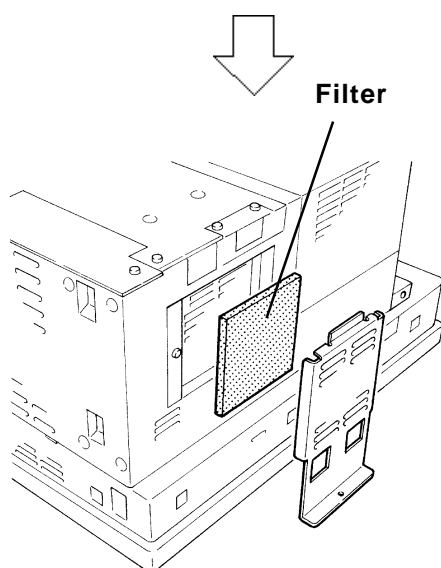


- 2) Remove the filter from the fan cover.

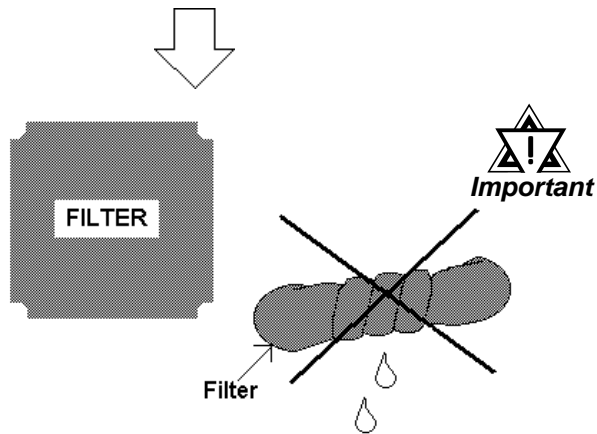

- 3) Clean the filter completely.
If stubborn dirt or stains are present, wash the filter with a neutral detergent.
 - **Do not wring the filter to dry it.**
 - **Be sure the filter is completely dry before reattaching the filter to the fan cover.**
 - **Allow it to air dry. Do not leave the filter in direct sunlight.**
- 4) After reattaching the filter to the filter cover, reattach the cover to the cooling unit with the filter cover attachment screw.

■PL-7901T(2 slot type)

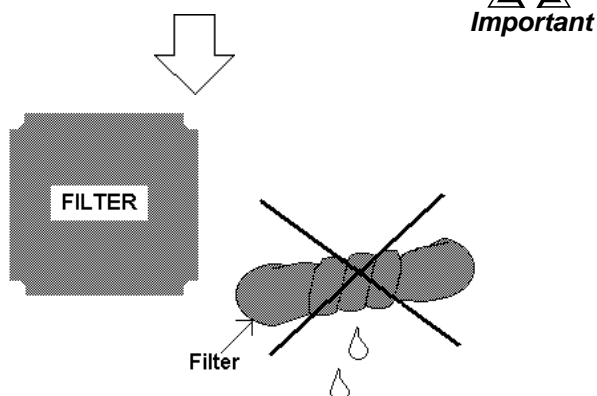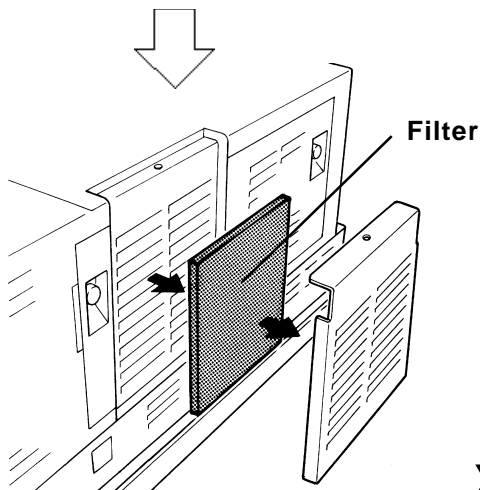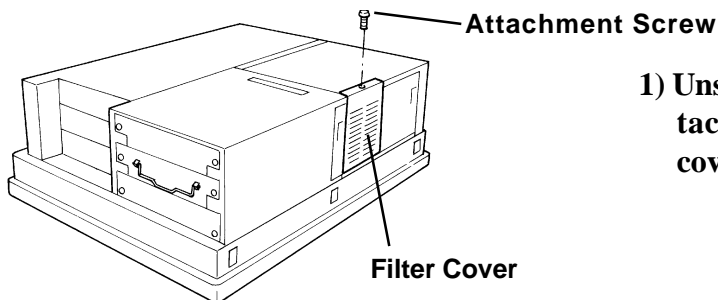

- 1) Unscrew the cooling fan filter cover's attachment screw and remove the filter cover.
- 2) Remove the filter from the fan cover.
- 3) Clean the filter completely.
If stubborn dirt or stains are present, wash the filter with a neutral detergent.
 - **Do not wring the filter to dry it.**
 - **Be sure the filter is completely dry before reattaching the filter to the fan cover.**
 - **Allow it to air dry. Do not leave the filter in direct sunlight.**
- 4) After reattaching the filter to the filter cover, reattach the cover to the cooling unit with the cover attachment screw.

7-3 Replacing the PL Backlight

The PL-7900T/PL-7901T's backlight can be changed after it wears out. The steps involved are outlined below.



Note: Please use the following table to identify which backlight model number to use when ordering your backlight.

PL Type	Backlight Type
PL-7900/ PL-7901	PL7900T-BL00-MS



Important

If the backlight or the display unit are damaged, the screen display will go out. Even if the screen goes out, however, there is a possibility that the touch panel is still operating correctly. Therefore, since any type of touch panel contact could have an unexpected or dangerous effect or result, be sure not to touch the screen when this condition occurs.




WARNING


- Whenever changing the backlight, be sure the PL's power cord has been disconnected and that the unit is cooled down.
- When the PL's power cord is connected and the PL is ON, high voltage runs through the *wires in the backlight area—do not touch them!*
- When the PL's power has just been turned OFF, the backlight area is still very hot! Be sure to wear gloves to prevent being burned.
- Do not try to replace the backlight while the PL is installed in a cabinet or panel. Remove the PL first, then begin the backlight replacement procedures.

Reference 3-1-1 Installing Options and Expansion Boards

Follow the steps given below to change the PL-7900T/PL-7901T's backlight. Be sure to wear cotton gloves when performing this work to prevent burns.

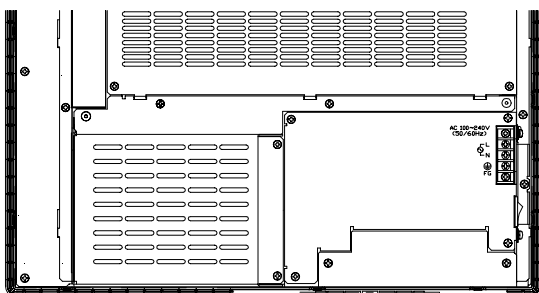

Model:PL7900T



Power Cord



Important

- 1) Unplug the PL's power cord from the main power supply.
- 2) Disconnect the PL power cord terminals from the PL's power terminal block.



Be sure to perform the backlight changeover on a flat, level surface. This will prevent damage to the PL unit and the accidental cutting of any of its power cord terminals.

With a pre-installed PL-FD210, unscrew these attachment screws to take the unit out.


- 3) Remove the PL's four chassis attachment screws.



With a pre-installed PL-FD210 (can only be installed in the PL-7900T), unscrew the attachment screws and remove the unit.

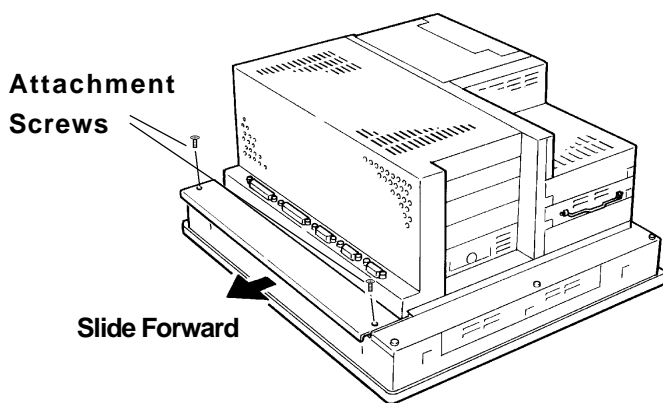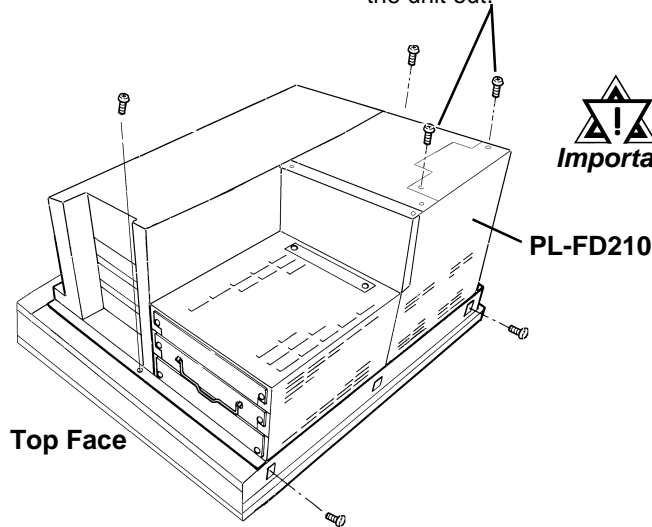


- 4) Remove the last two (2) attachment screws. Next, hold both sides of the PL's front panel section and use your thumbs to slide (push) the chassis forward in the direction shown here (see figure).

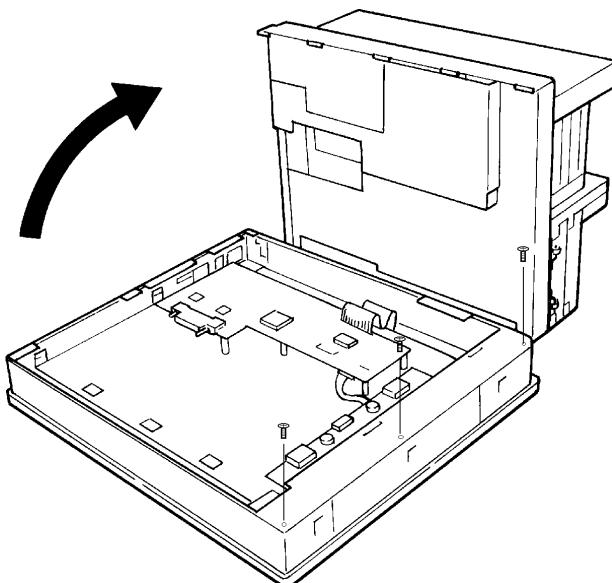


- 5) The chassis can then be pivoted back and open. Remove the three (3) attachment screws from inside the cover.


Maintenance and inspection

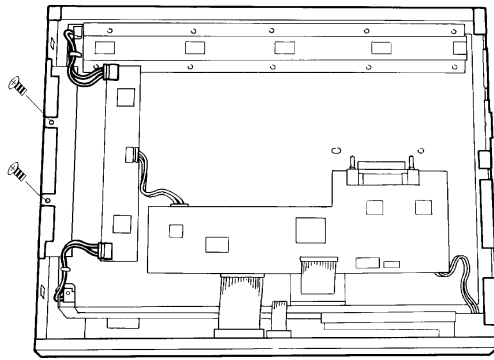

- 6) The PL's LCD display unit is fixed in place with two attachment screws. Remove these screws.

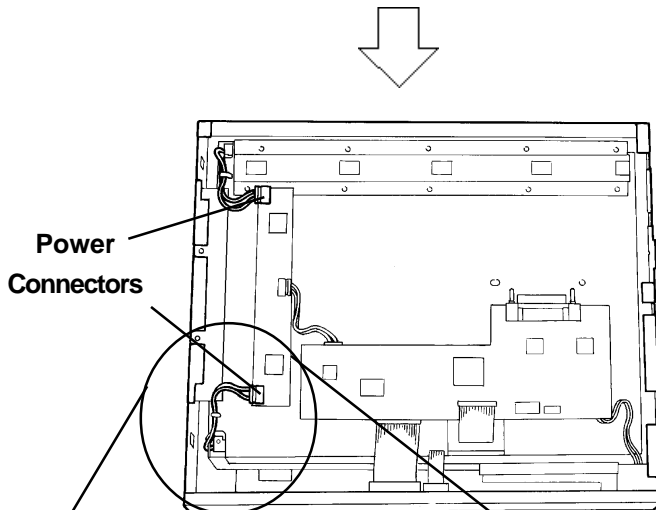

- 7) Disconnect both backlight power connectors from the inverter board.

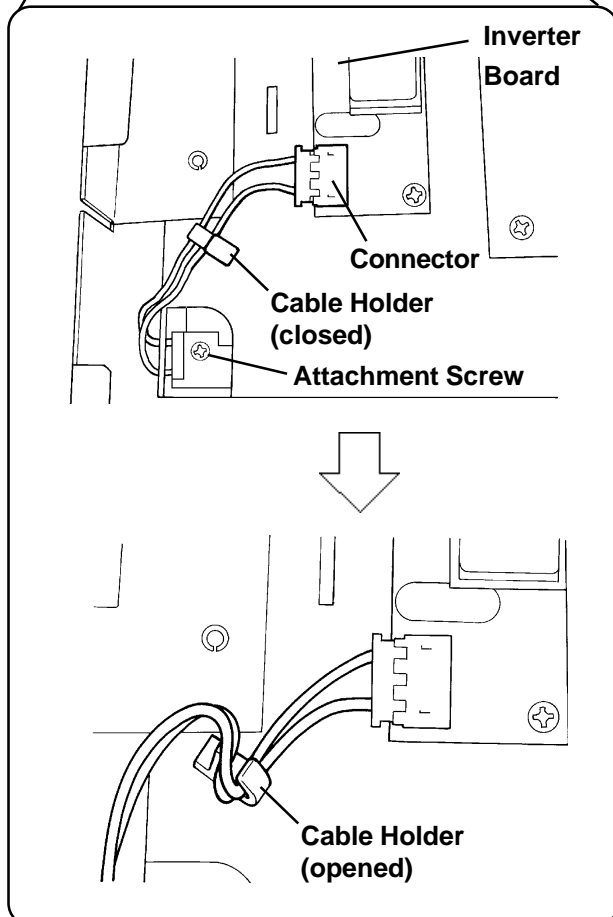


- Use an "0" sized Phillips screwdriver to remove the backlight attachment screws.

- Be careful not to lose any of the small attachment screws.
- Do not let any of attachment screws fall inside the PL unit's chassis or front panel area, since it could cause an electrical short.

- 9) Open/release each plastic cable holder.



Each backlight uses a cable holder to prevent the cable from becoming caught or pinched when the PL's rear cover is opened or closed. Be sure both cables are secured by their holder before closing the rear cover.

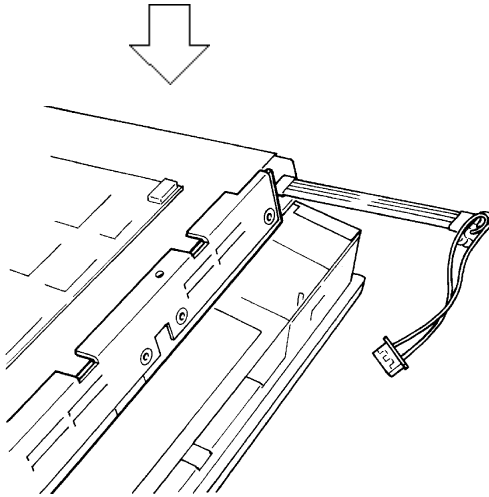

10) Remove each backlight unit.

11) Insert each new backlight.

12) After installing both new backlights, replace and tighten all backlight and LCD panel attachment screws (total of 4 screws). Then, re-connect both inverter board power connectors.



- ***Be sure to always change both of the PL backlights at the same time.***
- ***Be sure that the backlight's power cord connector is inserted completely into the Inverter Board's receptacle. If not, the PL may be damaged.***
- ***The PL-FD210 can only be used in the PL-7900T.***

13) Reassemble the rear cover, being careful not to pinch any internal electrical wires.

14) Replace the PL-FD210's two attachment screws (only PL-7900).

15) Replace and tighten the PL's four chassis attachment screws.

7-4 Periodic Check

Check the PL periodically to ensure it is in good working condition.

Ambient environment check

- Is the ambient temperature within the specified range?

	Panel Interior	Panel Face
W/ PL Fan	5°C to 50°C	5°C to 40°C
W/OUT PL Fan	5°C to 40°C	

- Is the ambient humidity within the specified range (30 %RH to 85 %RH) ?
- Is the atmosphere free of corrosive gas ?

Electrical specifications check

- Is the voltage adequate (AC85 to 265V, 50/60 Hz) ?

Installation check points

- Is the connection cable firmly connected (not loose) ?
- Are any bolts or screws loose ?
- Are there any flaws or tears in the moisture resistant gasket ?

Display check

- Is the display bright enough ?



When the PL's backlight needs to be replaced, please contact your local PL distributor.

A

ppendix

1. Hardware Configuration

1 Hardware Configuration


1 I/O Mapping

Address	AT system device	System device
0000H - 001FH	DMA controller (8237)	
0020H - 003FH	Interrupt controller (8259A)	
0040H - 005FH	System timer (8254)	
0060H - 006FH	Keyboard Controller	
0070H - 007FH	Real-time clock, NMI mask	
0080H - 009FH	DMA page register	
00A0H - 00BFH	Interrupt controller 2 (8259A)	
00C0H - 00DFH	DMA controller 2 (8237)	
00F0H - 00FFH	Numeric data processor	
01F0H - 01FFH	Hard disk (IDE)	
0200H - 0207H	Game I/O *1	
0290H - 0297H	Reserved	System Monitor
0298H - 029FH	Reserved	RAS
02E8H - 02EFH	Reserved	Touch Panel Serial Port 4 (COM4)
02F8H - 02FFH	Serial port 2 (COM2) : General Use	
03B0H - 03BBH	Video controller (VGA)	
03BCH - 03BFH	Parallel port 1 (LPT1)	
03C0H - 03DFH	Video controller (VGA)	
03E8H - 03EFH	Reserved	Serial port 3 (COM3)
03F0H - 03F7H	Floppy disk controller	
03F8H - 03FFH	Serial port 1 (COM1) :General Use	

*1 : The game I/O is not used by the PL system, but is normally reserved.

2

Memory Mapping

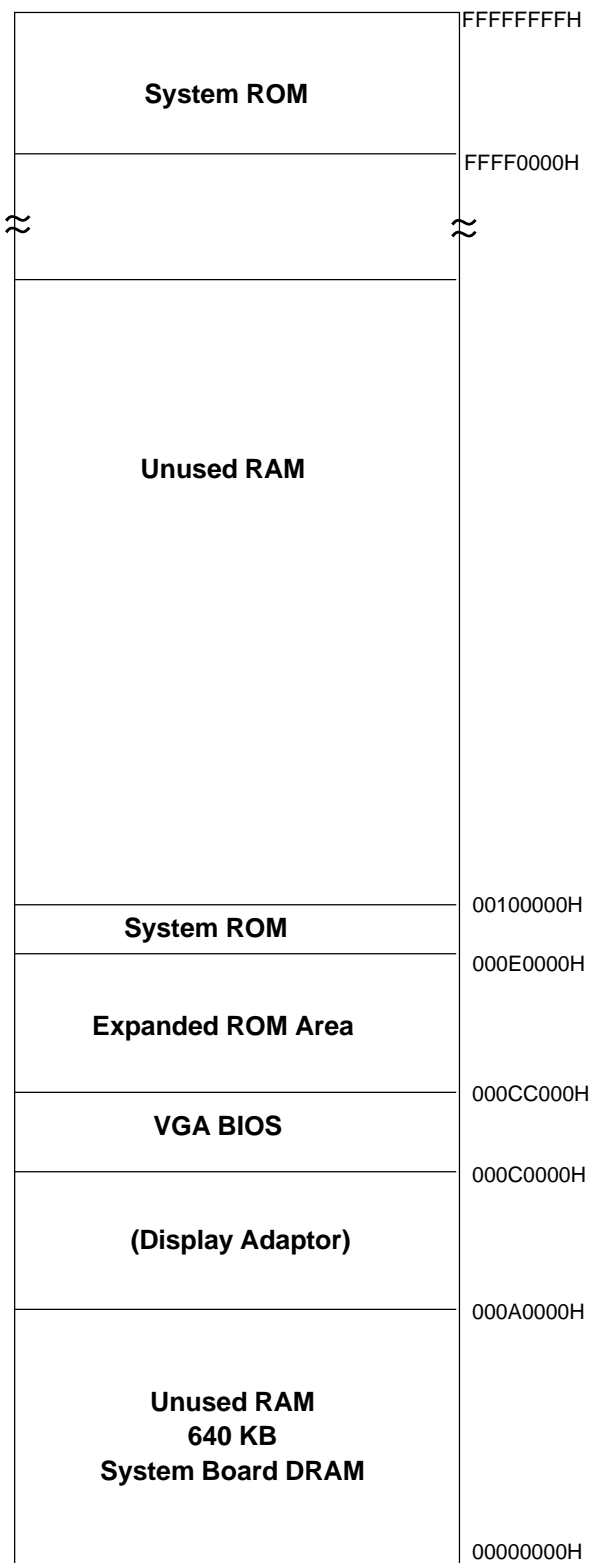

3 IRQ Mapping

■ Hardware Interruption List

	Description
NMI	Parity Error or I/O Channel Check
IRQ 0	Timer (in the Chipset)
IRQ 1	Keyboard
IRQ 2	Cascade from Controller 2
IRQ 3	Serial Port 2 (COM2): General Use Port
IRQ 4	Serial Port 1 (COM1): General Use Port
IRQ 5	Available for users
IRQ 6	Floppy Disk Controller
IRQ 7	Parallel Port 1 (LPT1) : Printer Port
IRQ 8	Real Time Clock
IRQ 9	Serial Port 3 (COM3): General Use Port
IRQ 10	Serial Port 4 (COM4): Touch Panel
IRQ 11	Available for users
IRQ 12	PS/2 Mouse
IRQ 13	Numeric Data Processor
IRQ 14	Hard Disk (IDE)
IRQ 15	Available for users

■ DMA Channel List

	Description	
DMA 0		For 8-bit transmission
DMA 1		
DMA 2	Floppy disk controller	
DMA 3		
DMA 4	Cascade to controller 1	For 16-bit transmission
DMA 5		
DMA 6		
DMA 7		

2

RAS Feature

1

PL's RAS Features

RAS, which stands for Reliability, Availability and Serviceability, is a device-level monitoring function that provides a variety of features to improve the reliability of your PL system.

Though the standard set of RAS features used will vary depending on the devices used, the following features are used to provide Alarm Monitoring and External Input Signal support.

Alarm Monitoring	Power Voltage Alarm Cooling Fan Alarm Internal Temperature Alarm Watchdog Timer Time Up Mirror Disk Alarm
External Input Signal	Standard Signal Input (DIN 2 bit) Remote Reset Input

Also, when either the one of the above mentioned alarms occurs, or an external signal input is received, the following types of alarm processing output signals and features are supported.

External Output Signal	Standard Signal Output (DOUT 1 bit) Alarm Output (1 point) Lamp Output (1 point)
Types of Processing (all units)	LED Indicator (3-state display – 1 point) Pop-up Message Output Buzzer Output System Shutdown

Furthermore, using the PL's System Monitor feature (included in the PL's software utility disk), allows the easy setting and control (Enable/Disable) of the aforementioned Alarm Monitor and External Input Signals.

Last, the system monitor feature's use of an Application Link Library (API-DLL) allows it to also be used with other applications.

**1 When a Mirror Disk Alarm occurs and the standard RAS feature settings are used, the alarm output is limited to the Mirror Disk unit's LED indicator. (Alternately flashing orange and green)*

**2 The remote reset feature's input can be either enabled or disabled, the alarm output setting cannot be set to trigger a forced system reset.*

**3 For System Monitor Feature details, refer to the accompanying Driver and Utility disk.*

2 RAS Feature Details

■ Alarm Monitoring

◆ Power Voltage Alarm

Monitors the condition of the PL's internal and CPU power.

◆ Cooling Fan Alarm

Monitors the condition of the PL's internal power and CPU cooling fans.

◆ Internal Temperature Alarm

Monitors the PL's internal and CPU vicinity temperatures.

The degree of monitoring (3 levels) and the enabling or disabling of the above three items is performed via the System Setup Area's settings.

For detailed information about the monitoring level settings,

▼Reference▲ 5.2.6 SYSTEM MONITOR UTILITY

This utility can also be used to enable or disable the above mentioned features, as well as designate what type of processing is to be performed.

◆ Watchdog Timer Time Up

This feature alternately writes Time Up Count values from the CPU to the RAS feature's special programmable timer and then periodically clears them, which provides a means of monitoring the CPU's performance. If the clearing of this count value is stopped, the timer will overflow and an alarm will be detected. The System Monitor utility can be used to enable or disable this feature, as well as designate what type of processing is to be performed.

◆ Mirror Disk Alarm

Whenever a disk crash, or other alarm event occurs to the optional Mirror Disk unit, this unit's LED indicator will flash (either orange or green) to indicate there is a problem.

This unit's error detection occurs independently of and cannot be set by the RAS feature.

■ External Input Signal

The PL's RAS interface connector uses the following input signals.

Standard Signal Input (DIN)

This standard digital input is used for alarm detection in external devices. The input signal uses two bits.

The System Monitor utility can be used to enable or disable this feature, as well as designate what type of processing is to be performed once a signal is received.

Remote Reset Input

This is the reset signal sent from an external device to the PL. When this signal is enabled, a forced reset of the PL is performed.


The System Monitor utility can be used to enable or disable this feature

External Input Signal (for both DIN and Remote Reset Input)

- External Power DC12V to DC24V connections are possible
- Input Protection Protection Diode
- Isolation Used (photo-isolation)

(Interface Circuit)

(Connection Example)

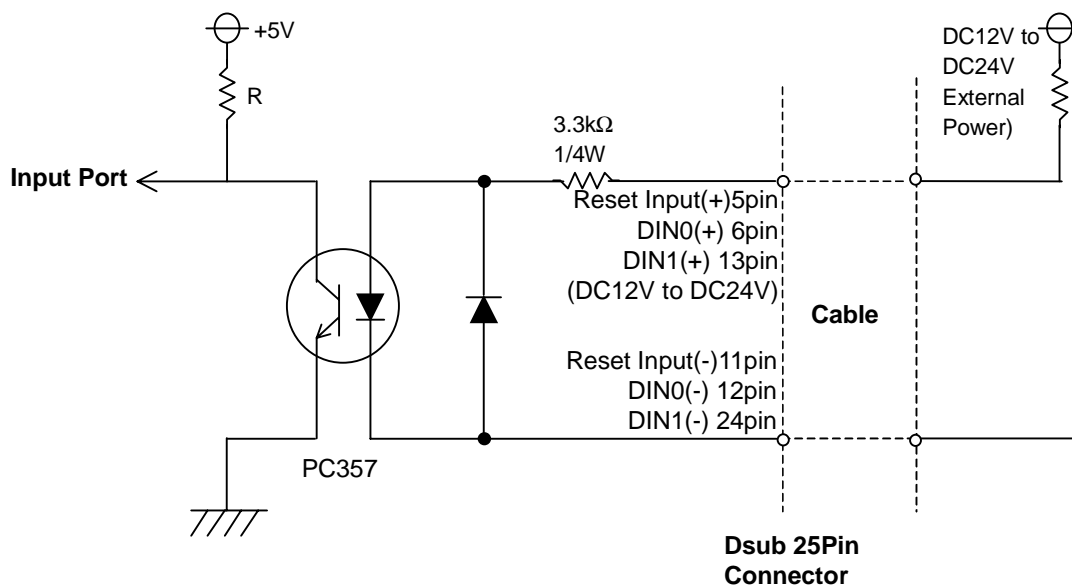

For connection pin location details,

Reference 2.3.5 RAS Interface

■ External Output Signal

The PL's RAS interface connector uses the following output signals.

General Purpose Signal Output (DOUT)

This general purpose digital output signal provides system condition information to external devices.

The System Monitor's API-DLL are used by applications to control this signal.

Alarm Output (1 point)

Lamp Output (1 point)

The above mentioned general purpose digital output signals provide system condition information to external devices.

The System Monitor utility can be used to enable or disable any of these output signals.


Also, when alarm output is enabled, the orange colored LED indicator will also blink.

External Output Signal (used for DOUT, Alarm Output, Lamp Output)

- Output Specification DC24V 100mA (MAX)
- Isolation Used (photo-isolation)

(Interface Circuit)

(Connection Example)

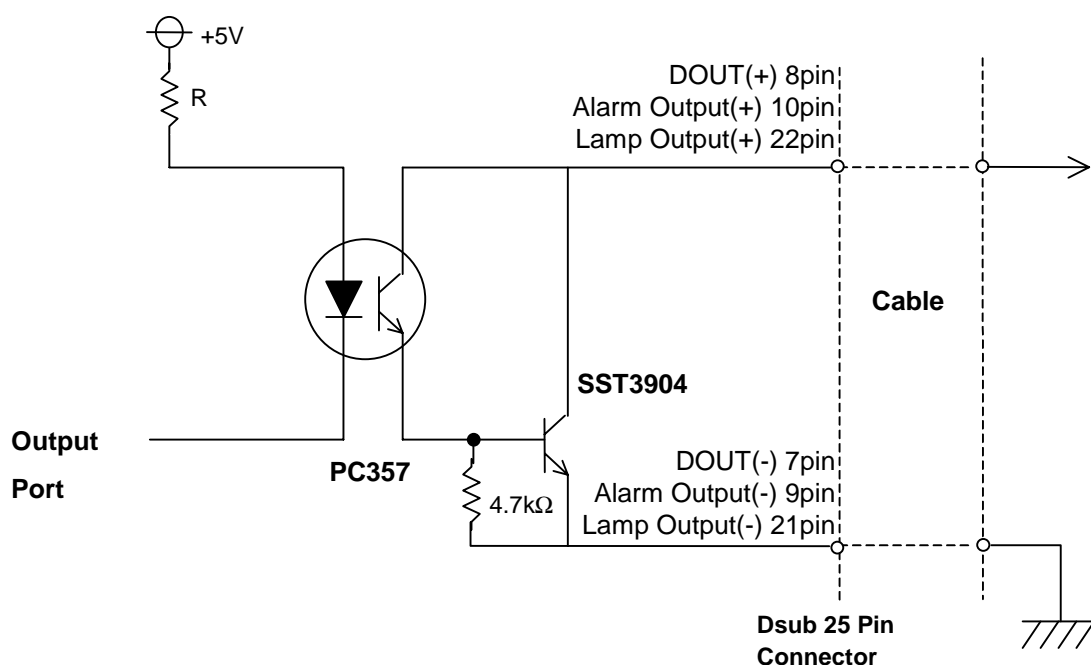

For connection pin location details,

Reference 2.3.5 RAS Interface

■ Types of Processing (all units)

The PL provides system condition information via the following methods.

LED Indicator (3-state display – 1 point)

In addition to indicating if the unit's power is ON or OFF, the 3-state LED indicator (power lamp) provides the following system condition information.

Color	System Condition	Output Created
Green	Normal Operation (Power ON)	None
Orange	RAS has detected a system alarm.	The alarm output set in the system monitor is enabled.
Flashing Orange/ Green	Mirror Disk Alarm has occurred	None

Pop-up Message Output

This feature uses the Windows® system's pop-up message feature to indicate that an alarm has occurred.


Buzzer Output

This feature uses the PL's internal speaker to indicate the system's condition.

System Shutdown

This feature shuts down the PL's OS (Windows® 95/ Windows® 98 Second Edition/ Windows® NT 4.0). The System Monitor utility can be used to enable or disable this feature.

3 RAS Feature Overview

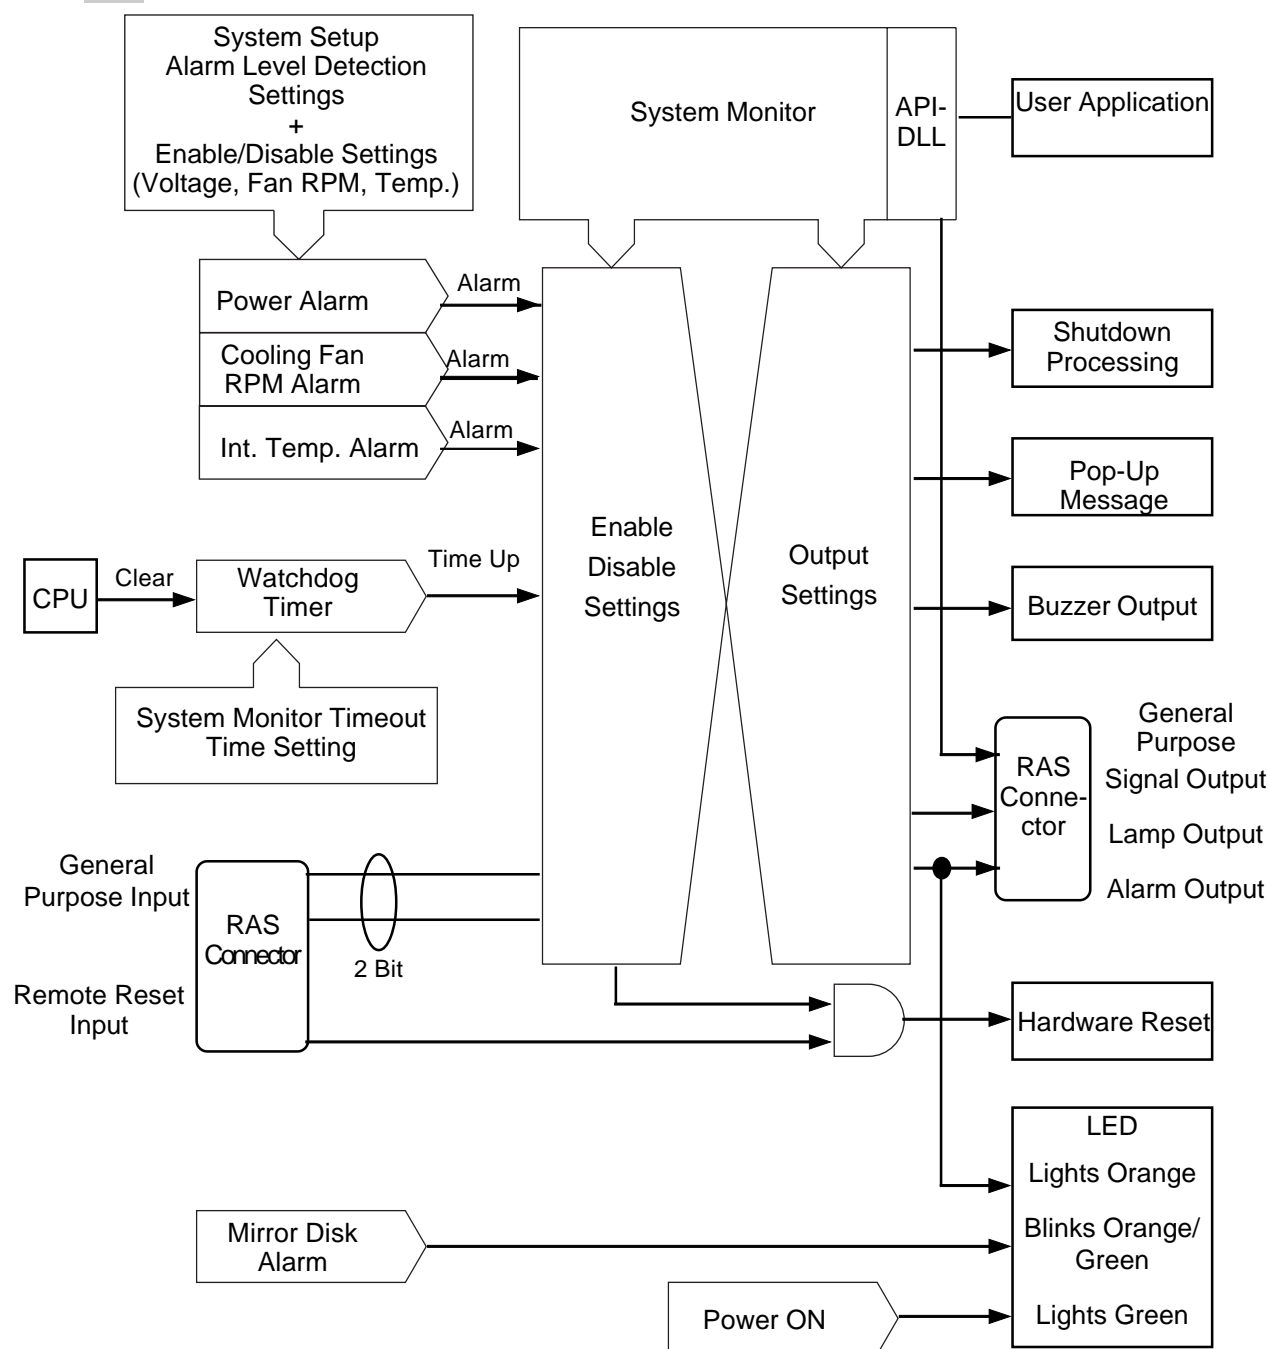

MEMO

Index

A

AC power terminals	4- 8
Accessories	1- 2
ACPI I/O Device Node	5- 10
aerospace equipment	iv
Afterimage	vi
air circulation vents	v
Ambient environment	7- 8
Ambient environment check	7- 8
ambient humidity	7- 8
ambient temperature	4- 4
Analog-Resistance-Film	xiii
Appendix	A-1
arc-generating devices	4- 4
Assign IRQ For USB	5- 12
Attachment Brackets	4- 5
automatic detection	5- 16

B

backlight	7- 8
Bank 0/1 DRAM Timing	5- 6
BIOS FEATURES SETUP	5- 4
Boot Sequence	5- 4
Boot Up Floppy Seek	5- 5
Boot Up NumLock Status	5- 5
Boot Up System Speed	5- 5
Brightness Adjustment Slide	2- 9

C

Cache Rd+CPU Wt Pipeline	5- 7
Cache Timing	5- 7
Cautions When Connecting I/O Signal Lines	4- 9
CE Marking	xv
CHIPSET FEATURES SETUP	5- 6
Cleaning the Display	7- 1
Cleaning the Filter	7- 2
Commercially Available Boards	1- 4
Commercially Available Products	1- 3
condensation	v
conduits	4-9
Connecting the CD-ROM Unit	3-8

Connecting the Power Cord	4-6
connection cable	7-8
Constant voltage transformer	4-8
corrosive gas	4-4, 7-8
CPU FAN	5-13
CPU Internal Cache	5-4
CPU to PCI Write Buffer	5-11
CPU Warning Temperature	5-12
Create an Installation Slot	4-3
crime prevention devices	iv
crimp terminals	4-7

D

damages	v
Date/Time	5- 2
deadman (two-handed) start switch	ii
Dedicated ground	4- 9
DIM modules	1- 4
Dimensions	vii, 3, 3
DIMM module sockets	3- 4
direct sunlight	v
Display Area	2- 10, 2- 9
Display check	7- 8
Display Functions	vii, 5, 5
Displayed color	vi
DMA / master	5- 9
DMA-0 assigned to - DMA-7 assigned to	5- 11
Doze Mode	5- 9
DRAM Read Pipeline	5- 7
Drive A	5- 2
Drive C	5- 2
Drive D	5- 2

E

Essential Safety Precautions	ii, vii
Excessive torque	4- 5
excessive vibration	4- 2
expansion boards	xiii
Expansion Options	1- 2
Expansion Slot's Width and Power Supply	1- 4
Expansion Slots	vii, 2- 10
External Cache	5- 4
external data backup	v

F

factory automation	i
failsafe system design	iv
FDD Slot	2- 10
FDD Slot (only for PL-7900T)	2- 9
Features	vii, xiii
ferrite core	4- 8
FG terminal	4- 9
fire	4- 6
fire or electrical shock	ii
flammable gases	iv
front and side connectors	7
Front Maintenance Cover	2- 9
Front Panel Installation	xiii
Full Sized Cover Attachment Dimensions	2- 13

G

Gate A20 Option	5- 5
Grounding Cautions	4- 9
grounding point	4- 9

H

Half Cover	2- 10
Halt On	5- 3
Hardware Configuration	11
Hardware Interruption List	13
Hardware Reset Switch	2- 9
hardware setup	x
HDD & FDD	5- 9
HDD Power Down	5- 9
HDD/FFD Expansion Unit Slot	2- 10
high temperatures	v
high voltages	ii
High-Performance Architecture	xiii
humidity	v

I

IDE HDD Block Mode	5- 14
IDE HDD AUTO DETECTION	5- 16
IDE HDD AUTO DETECTION SETUP	5- 16
IDE I/F Cover	2- 9
IDE Prefetch Mode	5- 14
IDE Primary Master PIO	5- 14
IDE Primary Master UDMA	5- 15
IDE Primary Slave PIO	5- 14
IDE Primary Slave UDMA	5- 15
IN2(3.3V)	5- 13
IN3(5V)	5- 13
IN4(12V)	5- 13
IN5(-12V)	5- 13
IN6(-5V)	5- 13
incompatible boards	1- 4
Information Symbols	vii
INO(Vcore)	5- 13
Insert the PL into the installation slot	4- 4
Install the OS	x
Installation and Wiring	iii, 4- 1, 6-1
Installation Brackets	xii
Installation Cautions	4- 1, 6-1
Installation check points	7- 8
Installation Positioning Cautions	4- 1
Installation Procedures	4- 3
Installation Slot Dimensions	2- 14
Installing an Expansion Board	3- 8
Installing Optional Units and Expansion Boards	3- 1
Installing Options and Expansion Boards	3- 1
Installing the DIM Module	3- 4
Installing the FDD Unit	3- 4
Installing the FDD Unit (PL-FD200)	3- 4
Installing the FDD Unit (PL-FD210)	3- 6
Installing the IDE Slave Adaptor	3- 8, 3- 10
Installing the PL	4- 3
insulating transformer	4- 8
INTEGRATED PERIPHERALS	5- 14
INTEGRATED PERIPHERALS SETUP	5- 14
interface connector	iii
Interface Specifications	vii
internal data flow	1- 1
IrDA	2- 9
IRQ Mapping	13
IRQ-3 assigned to - IRQ-15 assigned to	5- 11
IRQ3-IRQ15	5- 9
ISA(AT)-bus compatible boards	1- 4

K

Keyboard Connector 2- 9, 2- 10

L

lightning 4- 8
lightning surge absorber 4- 8
low-noise power supply 4- 8
LPT & COM 5- 9

M

Moisture Resistant Gasket 4- 3
machine breakdown 4- 2
magnetic switches 4- 4
main circuit 4- 8
Main Memory 1- 4
Main power source 4- 8
Maintenance and Inspection 7- 1
Maintenance Options 1- 3
medical devices iv
Memory Hole At 15Mb Addr. 5- 7
Memory Parity / ECC Check 5- 5
metal particles iii
Model number 1- 5
MODEM Use IRQ 5- 9
moisture resistance 4- 3, 4- 5
Moisture Resistant Gasket Replacement 7- 2
moisture resistant packing 7- 8
Mouse Connector 2- 10
mouse emulation utility xiii

N

neutral detergent 7- 1
New PL-7900 Series Features xiii
noise immunity 4- 8
non-fuse breakers 4- 4
nuclear power control devices iv

O

On Chip USB 5- 7
Onboard FDC Controller 5- 15
Onboard Parallel Port 5- 15
Onboard Serial Port 3 5- 15
Onboard Serial Port 4 5- 16
Onboard Serial Port1 5- 15
Onboard Serial Port2 5- 15, 5- 16
OnChip IDE First Channel 5- 14
operator 4- 4

Options 1- 2
organic solvents 7- 1
OS Select For DRAM >64MB 5- 6
overheating v
Overview vii, 1- 1

P

Package Contents xii
panel 2- 14, 4- 3
panel's viewing angle 4- 4, 4- 1
Parallel Port Mode 5- 15
PCI #2 Access #1 Retry 5- 12
PCI Bus 1- 4
PCI Delay Transaction 5- 11
PCI Dynamic Bursting 5- 11
PCI IRQ Activated by 5- 12
PCI Master 0 WS Write 5- 11
PCI Master Read Prefetch 5- 11
PCI slots xiii
PCI/VGA Palette Snoop 5- 5
Performance Specifications vii, 2- 2
Periodic Check 7- 8
peripheralconnection 1- 1
PL Dimensions 2- 11
PL External Features 2- 9
PL power source 4- 8
PL Series Panel Types vii, 1- 5
PL Viewing Angle 4- 4
PL-6700 Unit xii
PL-7900T General Dimensions 2- 11
PL-7901T General Dimensions 2- 12
Plastic Cover 4- 6
PL's backlight 7- 8
PL's frame 4- 6
PM Control by APM 5- 8
PNP OS Installed 5- 10
possible explosion iv
Power Cord xii
power cord 2- 10, 4- 6
Power FAN 5- 13
Power Input Terminals 4- 6
Power Lamp LED 2- 9
Power Lamp LED Error Display 7
Power Management 5- 2, 5- 3, 5- 4, 5- 5, 5- 6, 5- 7, 5- 8, 5- 9
POWER MANAGEMENT SETUP 5- 8
Power Supply Cautions 4- 8

Index

power supply devices	4- 8
power supply voltage	4- 6
Power Switch	2- 10
Power Terminals	2- 9
pre-set	5- 1
Preface	i
Primary INTR	5- 9
Printer Connector (LPT1)	2- 9
Printer Interface	vii
Prior To Using the PL	x
Protection sheet	7- 1
PS/2 type keyboard	x

Q

Quick Power On Self Test	5- 4
--------------------------------	------

R

Rear Attachment Brackets	4- 5
Removing/ Installing the HDD Unit	3- 7
RAS Connector	2- 9
Rear Maintenance Cover	2- 10
rear maintenance cover	3- 2, 3- 3
Regular Cleaning	7- 1
Removing the Cooling Fan Unit	3- 10
Removing the Rear Maintenance Cover	3- 2
Replacing the PL Backlight	7- 4
Reset Configuration Data	5- 10
Resources Controlled By	5- 10
RS-232C Connector (COM1)	2- 9
RS-232C Connector (COM2)	2- 9
RS-232C Connector (COM3)	2- 9

S

Safety Precautions	ii
Screen display	vi
screen protection sheet	7- 1
screw size	4- 6
SDRAM Cycle Length	5- 7
Security Option	5- 5
separate control system	ii
Serial Port 3 Use IRQ	5- 16
Serial Port 4 Use IRQ	5- 16
Set-up Procedures	5- 1
Shared ground	4- 9
Specifications	2
specified view angle	vi

specified voltage	4- 8
STANDARD CMOS SETUP	5- 2
strong acids	7- 1
Suspend Mode	5- 9
Sustained 3T Write	5- 7
Symbol Information	x
System BIOS Cacheable	5- 7
System Configuration	vii, 1- 1
System Monitor feature	14
SYSTEM MONITOR UTILITY	5- 12
System Parameters	5- 2
System Setup	5- 1
System Warning Temp	5- 13

T

Table of Contents	vii
Temperature Related Cautions	4- 1
terminal strip	4- 7
Touch Panel	2- 9
touch panel switches	ii
transparent plastic cover	4- 6
transportation vehicles	iv
Twisted-pair cable	4- 8
Typematic Delay (Msec)	5- 5
Typematic Rate (Chars/Sec)	5- 5
Typematic Rate Setting	5- 5

U

UL/cUL Application Notes	xiv
Unpacking the PL	xii
UR2 Mode	5- 15
User Controls	6- 3
utility software	x

V

VGA	5- 9
VGA Graphics Mode	5- 3
VGA Text Mode	5- 3
Vibration Related Cautions	4- 2
Video	5- 2
Video BIOS Cacheable	5- 7
Video BIOS Shadow	5- 6
Video Off Method	5- 8
Video Off Option	5- 8
Virus Warning	5- 4

W

warranty 1- 4

water resistance 2- 14

When Installing Commercially Available Products
1- 3

When using Standard PC Peripheral Devices .. 1- 4