

Easy! Smooth!

GP4100(Monochrome) ->

GP4100(Color)

Replacement Guidebook

Preface

This guidebook introduces the procedures to replace a unit in GP4100(Monochrome) with a unit in GP4100(Color) series.

Model in use	Model No.	Recommended Substitution
GP-4104G	PFXGP4104G1D	GP-4114T
GP-4104W	PFXGP4104W1D	
GP-4105G	PFXGP4105G1D	GP-4115T
GP-4105W	PFXGP4105W1D	
GP-4106G	PFXGP4106G1D	GP-4116T
GP-4106W	PFXGP4106W1D	

The backlight color of GP410xG : Green/Orange/Red

The backlight color of GP410xW : White/Pink/Red

Safety Information

HAZARD OF OPERATOR INJURY, OR UNINTENDED EQUIPMENT DAMAGE

Before operating any of these products, be sure to read all related manuals thoroughly.

Failure to follow these instructions can result in death, serious injury or unintended equipment damage.



Contents

<u>PREFACE</u>	<u>2</u>
<u>SAFETY INFORMATION</u>	<u>2</u>
<u>HAZARD OF OPERATOR INJURY, OR UNINTENDED EQUIPMENT DAMAGE</u>	<u>2</u>
<u>CONTENTS</u>	<u>3</u>
<u>CHAPTER 1 SPECIFICATION COMPARISON</u>	<u>5</u>
1.1 SPECIFICATIONS OF GP4100(MONOCHROME) AND GP4100(COLOR)	5
<u>CHAPTER 2 COMPATIBILITY OF HARDWARE</u>	<u>6</u>
2.1 LOCATIONS OF CONNECTOR	6
2.2 EXTERNAL DIMENSIONS AND PANEL CUTOUT	7
2.3 DISPLAY COLORS	7
2.4 RESOLUTION	8
2.5 TRANSFER CABLE	9
2.6 GP-PRO EX TRIAL VERSION	9
2.7 PERIPHERAL UNITS AND OPTIONS	9
2.5.1 BARCODE READER CONNECTION	9
2.6.2 PRINTER CONNECTION	9
2.8 POWER CONSUMPTION	10
2.9 COLORS OF THE BODY	10
2.10 CHANGING BACKLIGHT COLOR	11
2.11 BACKUP BATTERY	11
2.12 OTHER NOTES	11
<u>CHAPTER 3 REPLACEMENT PROCEDURE</u>	<u>12</u>

3.1 WORK FLOW	12
3.2 PREPARATION	13
3.3 RECEIVE SCREEN DATA FROM GP4100 (MONOCHROME)	14
3.4 CHANGE THE DISPLAY UNIT TYPE	19
3.5 TRANSFER SCREEN DATA TO GP4100 (COLOR)	20
3.6 DIFFERENCES OF SOFTWARE	24
<u>CHAPTER 4 COMMUNICATION WITH DEVICE/PLC</u>	<u>25</u>
4.1 DRIVERS	25
4.5 SPECIFICATION OF SERIAL INTERFACE	25

Chapter 1 Specification Comparison

1.1 Specifications of GP4100(Monochrome) and GP4100(Color)


		GP4100(Monochrome)	GP4100(Color)
			
Display Size		3.5"	4.3" UP!
Display Type		STN monochrome LCD	TFT color LCD UP!
Display Colors		256 colors (without blink)	65,536 colors (without blink) UP! -> See 2.3
Display Resolution		200 x 80 pixels	480 x 272 pixels UP! -> See 2.4
Panel Cutout Dimensions (mm)		W 105mm x H 66mm	W 112.5mm x H 77.5mm -> See 2.2
External Dimensions (mm)		W 116.5mm x H 77.5mm x D 28.8mm	W 124.9mm x H 90.4mm x D 38.8mm → See 2.2
Touch Panel Type		Resistive film (Analog)	
Application Memory		2.2MB	UP! 8MB
Backup Memory		FLASH EPROM 128KB	
Backup Battery		None	UP! Option RTC Battery Set (PFXZGPRTC1)
Serial I/F	RS-232C	Only GP4105 9-pin, 2-piece terminal block	Only GP4115T 9-pin, 2-piece terminal block
	RS-422/485	Only GP4106 9-pin, 2-piece terminal block	Only GP4116T 9-pin, 2-piece terminal block
Ethernet Interface		Only GP4104 10BASE-T/100BASE-TX	Only GP4114T 10BASE-T/100BASE-TX
USB I/F	Type A	✓ -> See 2.5	
	Type mini B	✓ -> See 2.5	

Chapter 2 Compatibility of Hardware

2.1 Locations of connector

Connector locations on GP4100 (Monochrome) and GP4100 (Color) are as follows:


GP4100 (Monochrome)

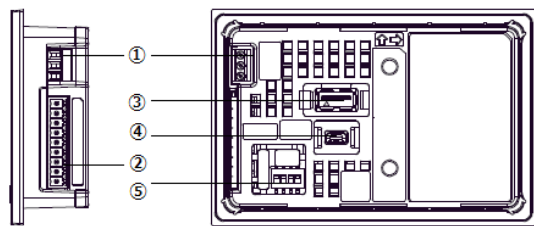

Right

GP4105/GP4106

Back

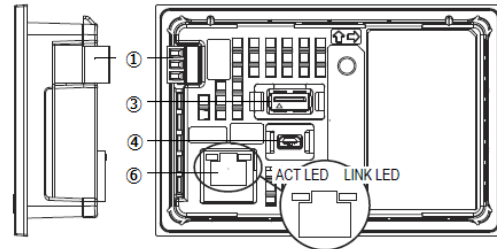


Right

GP4104


Back

GP4100 (Color)

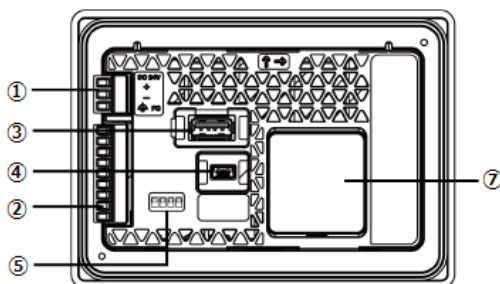

GP4115T/GP4116T

Back

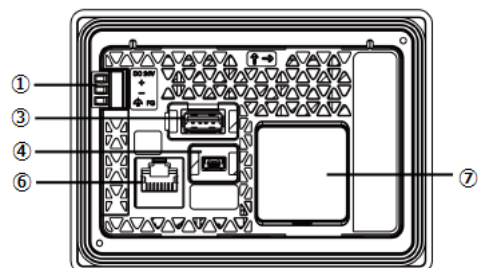

GP4114T

Back

Interface names

	GP4100(Monochrome)	GP4100(Color)
1	Power Supply Connector	
2	Serial Interface (COM1)	
3	USB Interface (Type A) Ethernet Interface	
4	USB Interface (Type mini B)	
5	DIP switch (Only GP4106/GP4116)	
6	Ethernet I/F	
7	-	RTC Battery Set Cover


2.2 External Dimensions and Panel cutout

GP4100(Color) is larger than GP4100(Monochrome).

The Panel Cutout Adapter (model number: PFXZCFAD31) is required for replacement.

However, when attached Panel Cutout Adapter (model number: PFXZCFAD31), GP4100 (Color) protrudes forward **11.3mm**.

External Dimensions with Panel Cutout Adapter

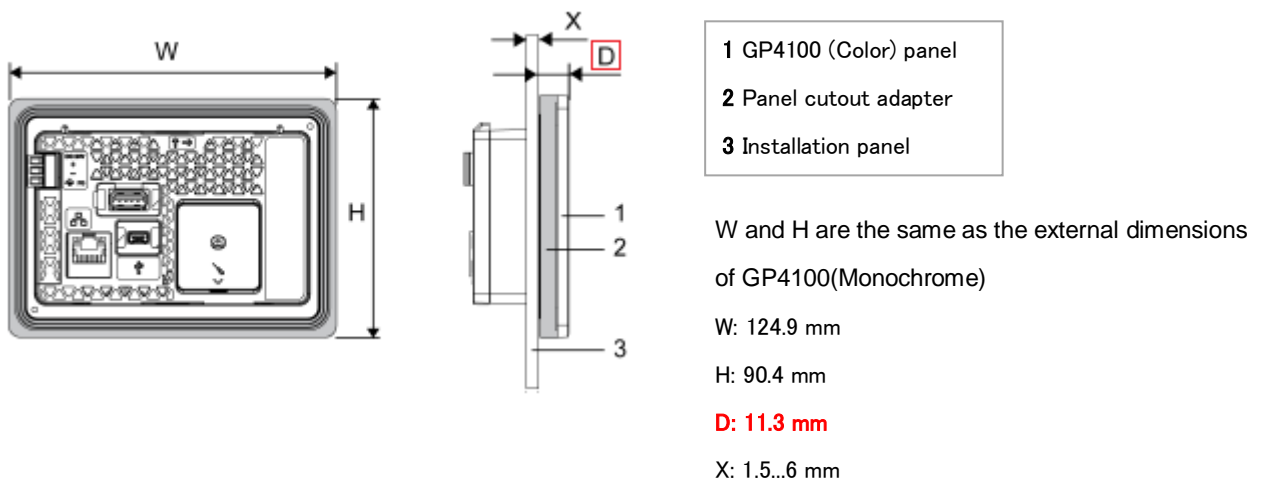

2.3 Display Colors

The display color of GP4104/GP4105/GP4106 is monochrome, but

GP4114/GP4115/GP4116 has a TFT color LCD. After replacement, the display color changes from monochrome to color.

When the setting of the display unit type is changed from a monochrome model to a color one on GP-Pro EX, the data may be displayed in colors depending on the GP-Pro EX version or settings of the drawing/the parts on the screens.

After changing the display unit type, please confirm the display colors of the drawing or the parts on the screens just in case.

2.4 Resolution


The display resolution of GP4100 (Monochrome) is different from that of GP4100 (Color).

For GP4100 (Color), the screen area gets larger.

When the setting of the display unit type is changed from GP410x to GP411x on GP-Pro EX, 'Convert Resolution' can be selected.

'Convert Resolution' is the function for adjusting the size and layout of each object automatically.

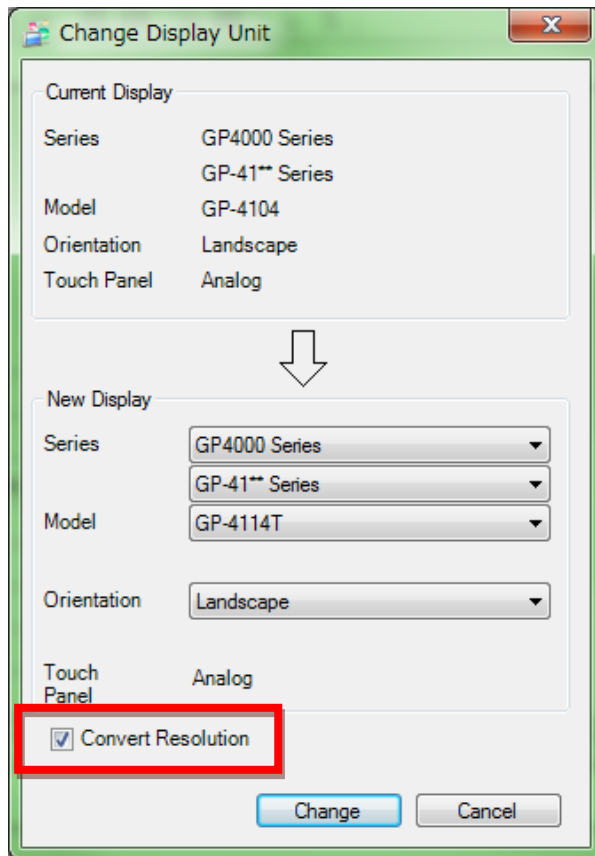

(But some objects can be adjusted automatically. After changing the display unit type, please confirm the size/layout of the drawing or the parts on the screens just in case.)



2.5 Transfer cable

To transfer screen data to GP4100 (Color), use a USB transfer cable or Ethernet.

The USB cables that can be used for GP4100 (Color) are as follows;

	Model	Connector Type	Connector on GP
Options	CA3-USBCB-01	 Type A Type A	USB (Type A)
	ZC9USCBMB1	 Type A Type mini B	USB (Type mini B)
Commercial Item	-		

The same USB transfer cable as the one for GP4100 (Monochrome) can be used.

2.6 GP-Pro EX Trial version

GP-Pro EX Trial version supports to edit and transfer to GP4100 (Monochrome) .

But for GP4100 (Color), it supports to [edit only](#).

If you want to transfer to GP4100 (Color), please purchase the liscence of GP-Pro EX.

2.7 Peripheral units and options

2.5.1 Barcode reader connection

Like GP4100 (Monochrome), GP4100 (Color) allows you to connect a barcode reader on its USB interface (TypeA) or its serial interface. However,

The models GP4100 (Color) supports will be announced at Pro-face support web.

(http://www.pro-face.com/otasuke/qa/3000/0056_connect_e.html).

2.6.2 Printer Connection

Like GP4100 (Monochrome), GP4100 (Color) allows you to connect a printer on its USB interface (Type A).

The models GP4100 (Color) supports will be announced at Pro-face support web.

(http://www.pro-face.com/otasuke/qa/3000/0056_connect_e.html).

2.8 Power Consumption

The power consumption of GP4100 (Monochrome) is different from that of GP4100 (Color).

power consumption	GP4100 (Monochrome)			GP4100 (Color)		
	GP4104	GP4105	GP4106	GP4114	GP4115	GP4116
When power is not supplied to USB devices	2.7W or less	3.0W or less	3.0W or less	3.9W or less	3.4W or less	3.6W or less
When power is supplied to USB devices	6.0W or less	6.2W or less	6.2W or less	8.1W or less	7.5W or less	7.7W or less

For the detailed electric specifications, see the hardware manual.

2.9 Colors of the body

The colors of GP4100 (Monochrome) and GP4100 (Color) are as follows:

	GP4100 (Monochrome)	GP4100 (Color)
Color	White	Light Gray

2.10 Changing Backlight Color

GP4100(Color) doesn't support the function of changing backlight color. Please substitute another function as follows.

How to change	GP4100 (Monochrome)	GP4100(Color)
Set the backlight attributes for each screen	Set [Backlight color] at [Screen attributes]	Substitute [Background color] at [Screen attributes]
Switch the backlight attributes from D-Script	Write data to System variable "#H_BackLightColor"	Substitute Scrolling alarm message or Lamp

FAQ: How can I switch the backlight of GP4100(Monochrome)?

http://global.pro-face.com/faq/index.html?page=content&id=FA61008&actp=search&viewlocale=en_US&searchid=1456907989927&answerid=16777216&searchid=&locale=en_US&redirect=true

2.11 Backup Battery

Turning OFF or resetting GP4100(Monochrome) initializes the clock.


But if you use RTC Battery Set (model number PFXZGPRTC1) in GP4100(Color), you can backup clock data.

2.12 Other Notes

- Do not expose GP4100 (Color) to direct sunlight.
- Do not use GP4100 (Color) outdoors.
- Do not turn on GP4100 (Color) if condensation has occurred inside the device.
- When you are continuously using GP4100 (Color) without oxygen, the brightness might decrease. Please ventilate the control panel periodically.

Chapter 3 Replacement Procedure

3.1 Work Flow

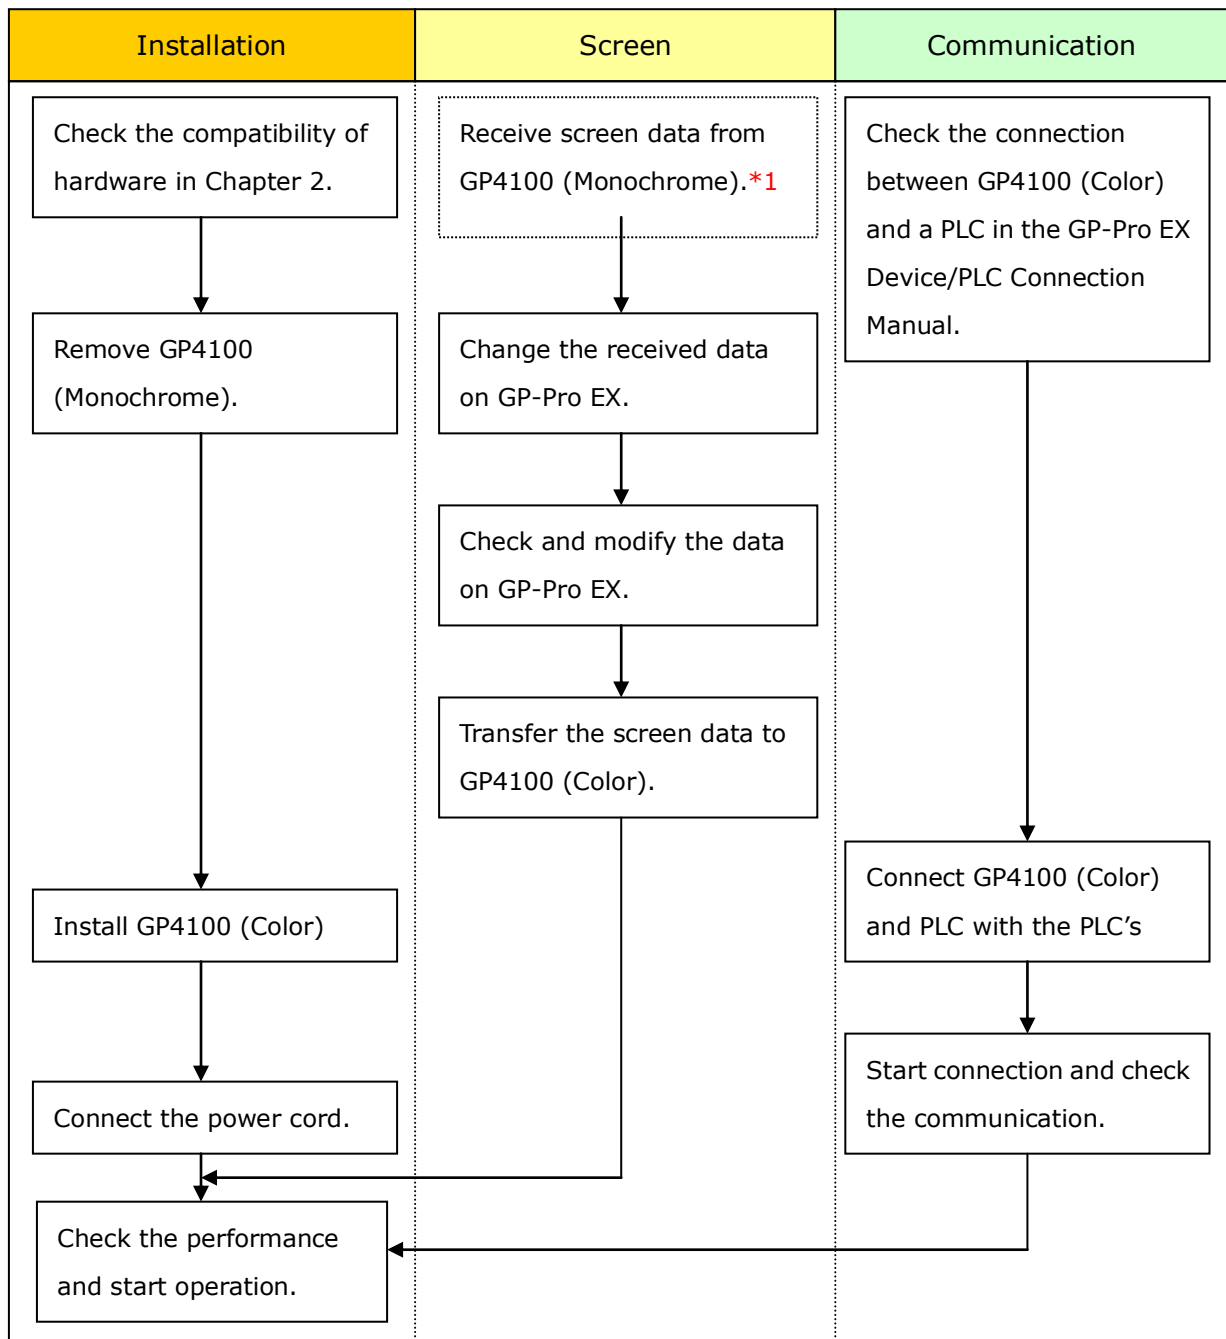

*1: This step is required if screen data is saved only in the GP unit, not in any other device.

3.2 Preparation

Requirements for receiving screen data from GP4100 (Monochrome). *1	GP4105/4016 GP-Pro EX Ver. 2.6 or later GP4107 GP-Pro EX Ver. 2.7 or later (Available GP-Pro EX trial version /Transfer Tool) *2
	Transfer Cable (The following three types of cables are available) <ul style="list-style-type: none"> · An USB transfer cable (model: CA3-USBCB-01) · An USB data-transfer cable (model: ZC9USCBMB1) · A commercial USB cable (USB Type A/mini B) * Possible to send/receive a screen data via an USB storage or Ethernet (GP-4104 only).
Requirements for converting screen data of GP4100 (Monochrome) and transferring the converted data to GP4100 (Color)	PC in which GP-Pro EX Ver.4.05 or later is installed.
	Transfer Cable (The following three types of cables are available) <ul style="list-style-type: none"> · An USB transfer cable (model: CA3-USBCB-01) · An USB data-transfer cable (model: ZC9USCBMB1) · A commercial USB cable (USB Type A/mini B) * Possible to send/receive a screen data via an USB storage or Ethernet (GP-4114 only).

*1: This step is required if screen data is saved only in the GP unit, not in any other device

*2: Please use the same version or later as or than that of the software used during creating screens on GP4100 (Monochrome). If you don't know the version, we recommend you to use the newest version. For the newest version, you can download the transfer tool from Pro-face Support web.

(http://www.pro-face.com/otasuke/download/freesoft/gpproex_transfer.htm)

3.3 Receive screen data from GP4100 (Monochrome)

You can transfer data to GP4100 (Monochrome) via;

- An USB transfer cable (model: CA3-USBCB-01)
- An USB data-transfer cable (model: ZC9USCBMB1)
- A commercial USB cable (USB Type A/mini B)
- An USB storage device
- Via Ethernet (for GP4104 only)

But this section explains, as an example, how to receive screen data from GP4100 (Monochrome) using an USB transfer cable (model: CA3-USBCB-01).

If you have backed up screen data, this step is unnecessary, skip to the next section [[3.4 Change the Display Unit Type](#)].



PC



USB transfer cable
(CA3-USBCB-01)




GP

(1) Connect your PC and GP4100 (Monochrome) with a USB transfer cable.

If the driver of the cable has not been installed on your PC yet, a dialog box will appear. Please follow the instructions.


NOTE

- The "Hardware Installation" dialog box as follows may appear during installing the driver of a USB depending on the security level of Windows® XP. Click [Continue Anyway] to start installing the driver. When installation is completed, click [Finish].

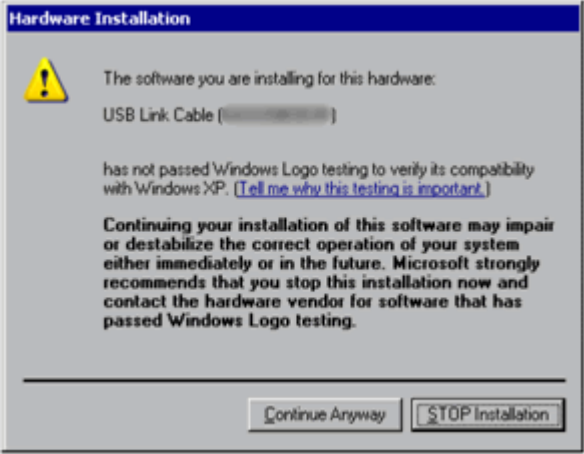

- If the following symptoms appear on Microsoft Windows® 7, go to updating "USB Data Transfer Driver" on [OtasukePro!] for download. (http://www.pro-face.com/otasuke/download/freesoft/gpproex_transfer.htm)
 - An error occurs when GP-Pro EX or Transfer Tool is installed
 - An error occurs when data is transferred via a USB transfer cable (model: CA3-USBCB-01).


(2) Start the Transfer Tool of GP-Pro EX.

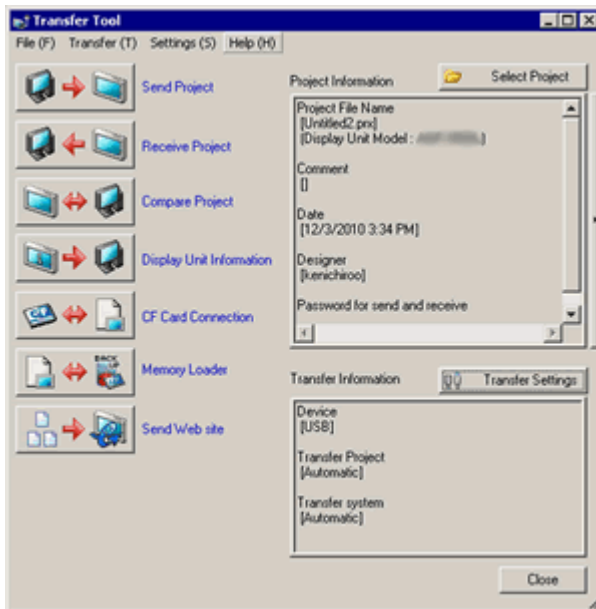


(3) Make sure that the [Device] in the "Transfer Settings Information" is set to [USB]. If not, click the [Transfer Setting] button to open the "Transfer Setting" dialog box. Select [USB] in the Communication Port Settings field and click [OK].



(4) Start GP-Pro EX Transfer Tool and click the [Receive Project] button.

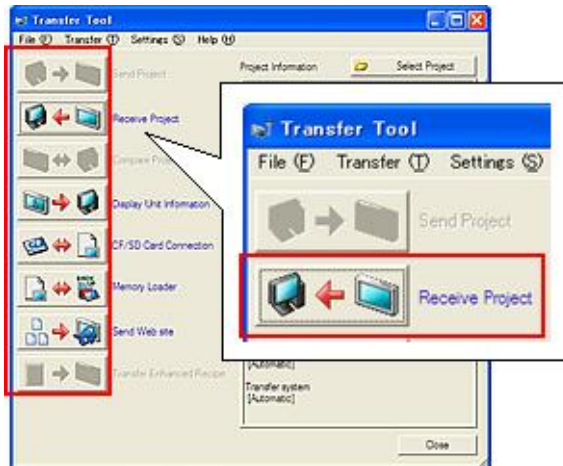


(5) Click [Receive Project], and the following dialog box will appear. Specify a place to save the received data in and a project file name, and then click [Save] to start transfer.


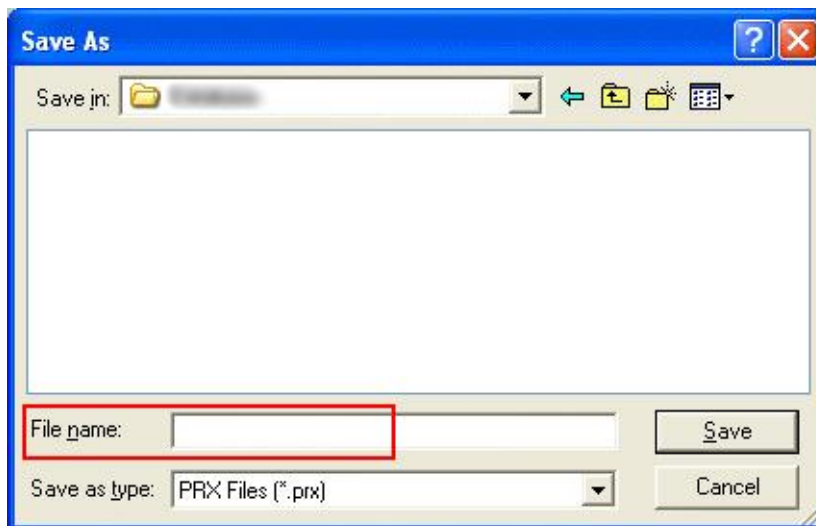


NOTE


When a file exists, the window that confirms whether or not to overwrite the file is displayed.

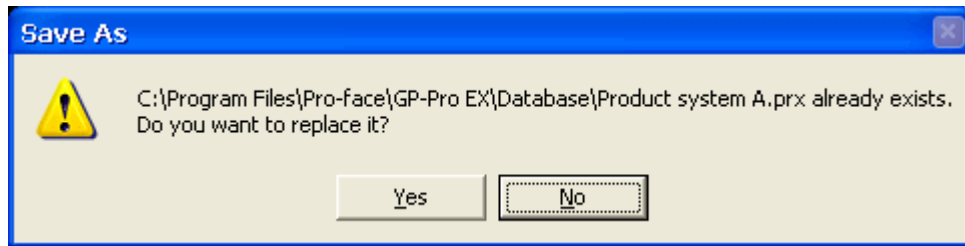

- (6) The following dialog box appears during transfer and you can check the communication status. (The display unit enters the Transferring mode and communication with the device such as a PLC is terminated.)

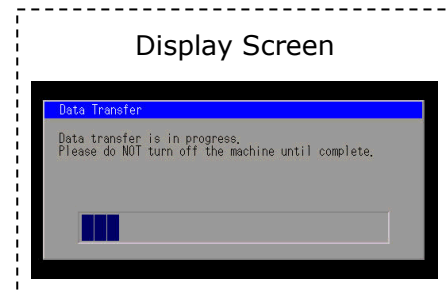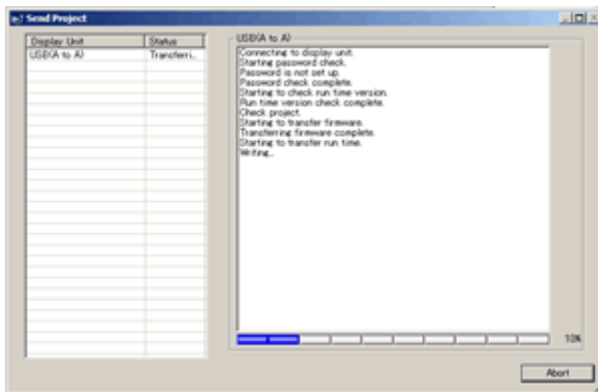

- (7) When transfer is completed, the status displayed in the dialog box will change from [Transferring] to [Complete Transfer]. Click [Close] to close the dialog box.

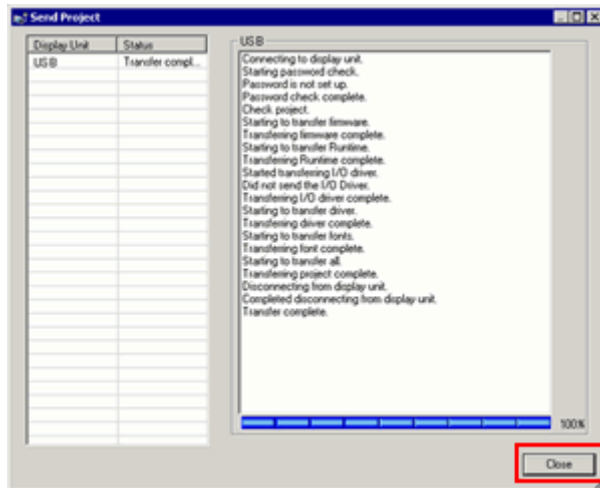


- (8) Close the Transfer Tool.

3.4 Change the Display Unit Type

Open the received project file (*.prx) of GP4100 (Monochrome) on GP-Pro EX and change the display unit type to GP4100 (Color).

- (1) Open the received project file (*.prx) on GP-Pro EX.
- (2) Click [System Settings]->[Display]->[Change Display] in [Project] menu and change the Display Unit type to the replacement model.

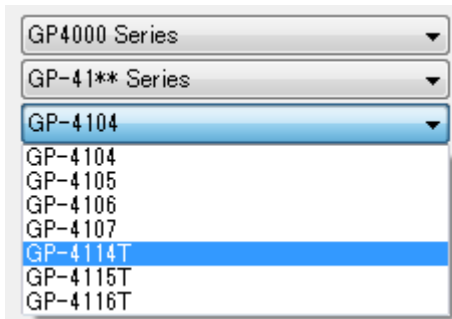

- (3) Click [Project]->[Save As] and save the changed project file.

3.5 Transfer screen data to GP4100 (Color)

Transfer the project file after display unit type change to GP4100 (Color).

You can transfer data to GP4100 (Color) via;

- An USB transfer cable (model: CA3-USBCB-01)
- An USB data transfer cable (model: ZC9USCBMB1)
- A commercial USB cable (USB Type A/mini B)
- An USB storage device
- Ethernet

But this section explains, as an example, how to transfer screen data via an USB transfer cable (model: CA3-USBCB-01).



PC



USB transfer cable
(CA3-USBCB-01)



GP

- (1) Connect your PC and the GP unit of GP4100 (Color) with an USB transfer cable. If the driver of the cable has not been installed on you PC, a dialog box will appear. Please follow the instructions.

NOTE

- The “Hardware Installation” dialog box as follows may appear during installing the driver of a USB depending on the security level of Windows® XP. Click [Continue Anyway] to start installing the driver. When installation is completed, click [Finish].




- If the following symptoms appear on Microsoft Windows® 7, go to updating “USB Data Transfer Driver” on [OtasukePro!] for download. (http://www.pro-face.com/otasuke/download/freesoft/gpproex_transfer.htm)
 - An error occurs when GP-Pro EX or Transfer Tool is installed
 - An error occurs when data is transferred via a USB transfer cable (model: CA3-USBCB-01).

- (2) Turn on the power of GP4100 (Color). The “Initial Start Mode” screen will appear on the display unit. After transferring a project file once, this screen will not appear again.



- (3) On the GP-Pro EX’s State Toolbar, click the [Transfer Project] icon to open the Transfer Tool.

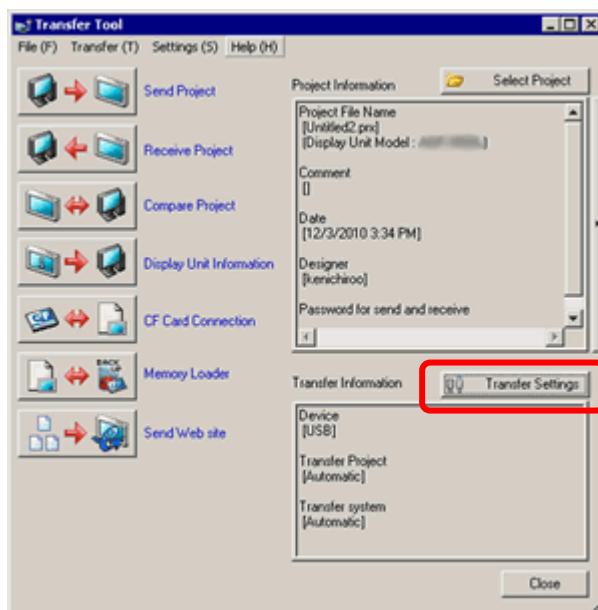


To transfer a different project file, click the [Select Project] button and select a project file.

- (4) Make sure that the [Device] in the “Transfer Settings Information” is set to [USB].



If not, click the [Transfer Setting] button to open the "Transfer Setting" dialog box. Select [USB] in the Communication Port Settings field and click [OK].



(5) Click [Send Project] to start transfer. When the following dialog box appears, click [Yes]. This dialog box doesn't appear when the same project file is sent again.

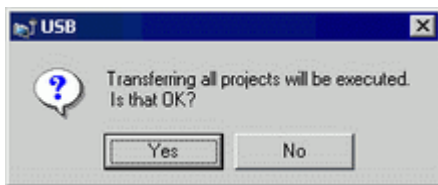


(6) The following dialog box appears during transfer and you can check the communication status. (The display unit enters the Transferring mode and communication with the device such as a PLC is terminated.)

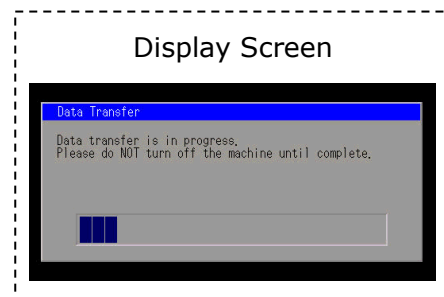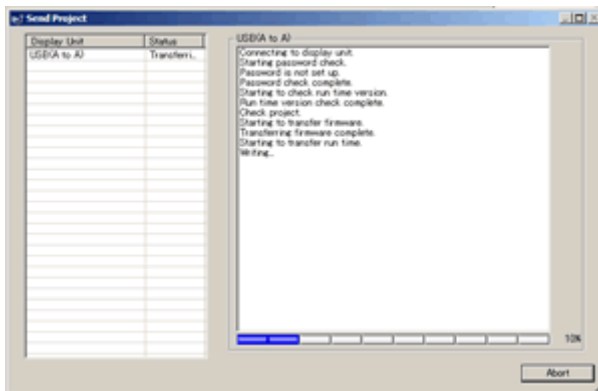

(7) When transfer is completed, the status displayed in the dialog box will change

from [Transferring] to [Complete Transfer]. Click [Close] to close the dialog box.

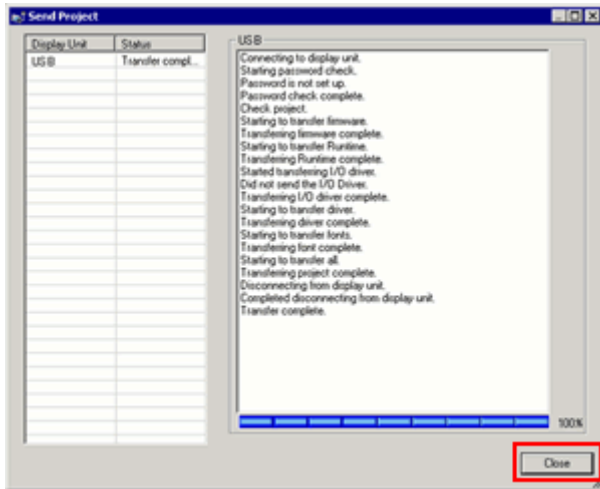

The display unit will be reset and a screen of the transferred project file will be displayed.

(8) Close the Transfer Tool.

(9) Click the [X] mark on top right of the screen or [Project]->[Exit] to close GP-Pro EX.

3.6 Differences of software

Some functions supported by GP4100 (Monochrome) are not supported by GP4100 (Color). For details of the supported parts and functions, refer to [Supported Features] of GP-Pro EX Reference Manual

(<http://www.pro-face.com/otasuke/files/manual/gpproex/new/refer/gpproex.htm>).

Chapter 4 Communication with Device/PLC

4.1 Drivers

More connectable drivers will be added.

For the devices/PLC each driver supports, see [Connectable Devices]
(<http://www.pro-face.com/product/soft/gpproex/driver/driver.html>).

4.5 Specification of Serial Interface

The specification (signal and shape) of GP4100 (Color) is same as GP4100 (Monochrome).

The same connection cable as the one for GP4100 (Monochrome) can be used.